



IEC 60502-2

Edition 3.1 2024-05
CONSOLIDATED VERSION

INTERNATIONAL STANDARD



**Power cables with extruded insulation and their accessories for rated voltages from 1 kV ($U_m = 1,2$ kV) up to 30 kV ($U_m = 36$ kV) –
Part 2: Cables for rated voltages from 6 kV ($U_m = 7,2$ kV) up to 30 kV ($U_m = 36$ kV)**





THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2024 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Secretariat
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee, ...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

IEC Products & Services Portal - products.iec.ch

Discover our powerful search engine and read freely all the publications previews, graphical symbols and the glossary. With a subscription you will always have access to up to date content tailored to your needs.

Electropedia - www.electropedia.org

The world's leading online dictionary on electrotechnology, containing more than 22 500 terminological entries in English and French, with equivalent terms in 25 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.



IEC 60502-2

Edition 3.1 2024-05
CONSOLIDATED VERSION

INTERNATIONAL STANDARD



**Power cables with extruded insulation and their accessories for rated voltages
from 1 kV ($U_m = 1,2$ kV) up to 30 kV ($U_m = 36$ kV) –
Part 2: Cables for rated voltages from 6 kV ($U_m = 7,2$ kV) up to 30 kV ($U_m = 36$ kV)**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

ICS 29.060.20

ISBN 978-2-8322-9033-0

Warning! Make sure that you obtained this publication from an authorized distributor.

CONTENTS

FOREWORD.....	11
1 Scope	13
2 Normative references	13
3 Terms and definitions	15
3.1 Definitions of dimensional values (thicknesses, cross-sections, etc.)	15
3.2 Definitions concerning the tests	16
4 Voltage designations and materials	16
4.1 Rated voltages.....	16
4.2 Insulating compounds	17
4.3 Sheathing compounds.....	18
5 Conductors	19
6 Insulation.....	19
6.1 Material	19
6.2 Insulation thickness	19
7 Screening	20
7.1 General.....	20
7.2 Conductor screen.....	20
7.3 Insulation screen	20
8 Assembly of three-core cables, inner coverings and fillers	21
8.1 General.....	21
8.2 Inner coverings and fillers	21
8.2.1 Construction	21
8.2.2 Material	21
8.2.3 Thickness of extruded inner covering.....	21
8.2.4 Thickness of lapped inner covering.....	21
8.3 Cables having a collective metal layer (see Clause 9).....	22
8.4 Cables having a metal layer over each individual core (see Clause 10).....	22
9 Metal layers for single-core and three-core cables.....	22
10 Metal screen.....	22
10.1 Construction	22
10.2 Requirements	23
10.3 Metal screens not associated with semi-conducting layers	23
11 Concentric conductor	23
11.1 Construction	23
11.2 Requirements	23
11.3 Application.....	23
12 Metal sheath.....	23
12.1 Lead sheath.....	23
12.2 Other metal sheaths.....	23
13 Metal armour	24
13.1 Types of metal armour	24
13.2 Materials.....	24
13.3 Application of armour	24
13.3.1 Single-core cables.....	24
13.3.2 Three-core cables.....	24

13.3.3	Separation sheath	24
13.3.4	Lapped bedding under armour for lead sheathed cables	25
13.4	Dimensions of the armour wires, and armour tapes and armour strips	25
13.5	Correlation between cable diameters and armour dimensions	25
13.6	Round or flat wire armour	26
13.7	Double tape armour	26
13.8	Interlock metal tape armour	27
14	Oversheath	27
14.1	General	27
14.2	Material	27
14.3	Thickness	28
15	Test conditions	28
15.1	Ambient temperature	28
15.2	Frequency and waveform of power frequency test voltages	28
15.3	Waveform of impulse test voltages	28
15.4	Determination of the cable conductor temperature	28
16	Routine tests	29
16.1	General	29
16.2	Electrical resistance of conductors	29
16.3	Partial discharge test	29
16.4	Voltage test	29
16.4.1	General	29
16.4.2	Test procedure for single-core cables	30
16.4.3	Test procedure for three-core cables	30
16.4.4	Test voltage	30
16.4.5	Requirement	30
16.5	Electrical test on oversheath of the cable	30
17	Sample tests	30
17.1	General	30
17.2	Frequency of sample tests	31
17.2.1	Conductor examination and check of dimensions	31
17.2.2	Electrical and physical tests	31
17.3	Repetition of tests	31
17.4	Conductor examination	31
17.5	Measurement of thickness of insulation and of non-metal sheaths (including extruded separation sheaths, but excluding inner extruded coverings)	31
17.5.1	General	31
17.5.2	Requirements for the insulation	31
17.5.3	Requirements for the non-metal sheaths	32
17.6	Measurement of thickness of lead sheath	32
17.6.1	General	32
17.6.2	Strip method	32
17.6.3	Ring method	32
17.7	Measurement of armour wires, and tapes and armour strips	33
17.7.1	Measurement on wires	33
17.7.2	Measurement on tapes and armour strips	33
17.7.3	Requirements	33

17.8	Measurement of external diameter	33
17.9	Voltage test for 4 h	33
17.9.1	Sampling	33
17.9.2	Procedure	33
17.9.3	Test voltages	33
17.9.4	Requirements	34
17.10	Hot set test for EPR, HEPR and XLPE insulations and elastomeric sheaths	34
17.10.1	Procedure	34
17.10.2	Requirements	34
17.11	Bending test on interlock armour cable followed by examination	34
18	Type tests, electrical	34
18.1	General	34
18.2	Cables having conductor screens and insulation screens	34
18.2.1	General	34
18.2.2	Sequence of tests	35
18.2.3	Special provisions	35
18.2.4	Bending test	35
18.2.5	Partial discharge test	36
18.2.6	Tan δ measurement for cables of rated voltage 6/10 (12) kV and above	36
18.2.7	Heating cycle test	36
18.2.8	Impulse test followed by a voltage test	37
18.2.9	Voltage test for 4 h	37
18.2.10	Resistivity of semi-conducting screens	37
18.3	Cables of rated voltage 3,6/6 (7,2) kV having unscreened insulation	38
18.3.1	General	38
18.3.2	Insulation resistance measurement at ambient temperature	38
18.3.3	Insulation resistance measurement at maximum conductor temperature	39
18.3.4	Voltage test for 4 h	39
18.3.5	Impulse test	39
19	Type tests, non-electrical	40
19.1	General	40
19.2	Measurement of thickness of insulation	40
19.2.1	Sampling	40
19.2.2	Procedure	40
19.2.3	Requirements	40
19.3	Measurement of thickness of non-metal sheaths (including extruded separation sheaths, but excluding inner coverings)	40
19.3.1	Sampling	40
19.3.2	Procedure	40
19.3.3	Requirements	40
19.4	Measurement of thickness of lead sheath	40
19.4.1	Sampling	40
19.4.2	Procedure	40
19.4.3	Requirements	40
19.5	Tests for determining the mechanical properties of insulation before and after ageing	40

19.5.1	Sampling	40
19.5.2	Ageing treatments	41
19.5.3	Conditioning and mechanical tests.....	41
19.5.4	Requirements	41
19.6	Tests for determining the mechanical properties of non-metal sheaths before and after ageing.....	41
19.6.1	Sampling	41
19.6.2	Ageing treatments	41
19.6.3	Conditioning and mechanical tests.....	41
19.6.4	Requirements	41
19.7	Additional ageing test on pieces of completed cables.....	41
19.7.1	General	41
19.7.2	Sampling	41
19.7.3	Ageing treatment	41
19.7.4	Mechanical tests.....	42
19.7.5	Requirements	42
19.8	Loss of mass test on PVC sheaths of type ST ₂	42
19.8.1	Procedure.....	42
19.8.2	Requirements	42
19.9	Pressure test at high temperature on insulations and non-metal sheaths	42
19.9.1	Procedure.....	42
19.9.2	Requirements	42
19.10	Test on PVC insulation, and PVC sheaths and halogen free sheaths at low temperatures	42
19.10.1	Procedure.....	42
19.10.2	Requirements	42
19.11	Test for resistance of PVC insulation and sheaths to cracking (heat shock test).....	42
19.11.1	Procedure.....	42
19.11.2	Requirements	42
19.12	Ozone resistance test for EPR and HEPR insulations	43
19.12.1	Procedure.....	43
19.12.2	Requirements	43
19.13	Hot set test for EPR, HEPR and XLPE insulations and elastomeric sheaths.....	43
19.14	Oil immersion test for elastomeric sheaths	43
19.14.1	Procedure.....	43
19.14.2	Requirements	43
19.15	Water absorption test on insulation	43
19.15.1	Procedure.....	43
19.15.2	Requirements	43
19.16	Flame spread test on single cables	43
19.16	Test under fire conditions.....	43
19.16.1	General	43
19.16.2	Flame spread test for single cables	43
19.16.3	Flame spread test for bunched cables	44
19.16.4	Measurement of smoke density of cables burning under defined conditions	44

19.16.5	Determination of acidity (by pH measurement) and conductivity of gases evolved during combustion of the non-metallic materials in the cable.....	44
19.16.6	Fire performance tests on halogen free oversheath material ST ₈	44
19.16.7	Fire performance tests on halogen free oversheath material ST ₁₂	45
19.16.8	Measurement of halogen content of gases evolved during combustion of the non-metallic materials in the cable	45
19.17	Measurement of carbon black content of black PE oversheaths	45
19.17.1	Procedure.....	45
19.17.2	Requirements	45
19.18	Shrinkage test for XLPE insulation	46
19.18.1	Procedure.....	46
19.18.2	Requirements	46
19.19	Thermal stability test for PVC insulation	46
19.19.1	Procedure.....	46
19.19.2	Requirements	46
19.20	Determination of hardness of HEPR insulation	46
19.20.1	Procedure.....	46
19.20.2	Requirements	46
19.21	Determination of the elastic modulus of HEPR insulation	46
19.21.1	Procedure.....	46
19.21.2	Requirements	46
19.22	Shrinkage test for PE and halogen free oversheaths	46
19.22.1	Procedure.....	46
19.22.2	Requirements	46
19.23	Strippability test for insulation screen.....	47
19.23.1	General	47
19.23.2	Procedure.....	47
19.23.3	Requirements	47
19.24	Water penetration test.....	47
19.25	Additional tests on halogen free oversheath of type ST ₈	48
19.25.1	General	48
19.25.2	Water absorption test for halogen free oversheath of type ST ₈	48
19.25.3	Abrasion test on halogen free oversheath of type ST ₈	48
19.26	Bending test on interlock armour.....	48
20	Electrical tests after installation	48
20.1	General.....	48
20.2	DC voltage test of the oversheath	48
20.3	Insulation test AC voltage test of the insulation	48
Annex A (normative) Fictitious calculation method for determination of dimensions of protective coverings.....		58
A.1	General.....	58
A.2	Method	58
A.2.1	Conductors	58
A.2.2	Cores	59
A.2.3	Diameter over laid-up cores.....	59
A.2.4	Inner coverings.....	59
A.2.5	Concentric conductors and metal screens.....	60

A.2.6	Lead sheath.....	61
A.2.7	Separation sheath	61
A.2.8	Lapped bedding.....	61
A.2.9	Additional bedding for tape-armoured cables (provided over the inner covering).....	62
A.2.10	Armour	62
Annex B (informative)	Tabulated continuous current ratings for cables having extruded insulation and a rated voltage from 3,6/6 kV up to 18/30 kV	63
B.1	General.....	63
B.2	Cable constructions	63
B.3	Temperatures	63
B.4	Soil thermal resistivity	64
B.5	Methods of installation	64
B.5.1	General	64
B.5.2	Single-core cables in air	64
B.5.3	Single-core cables buried direct.....	64
B.5.4	Single-core cables in earthenware ducts.....	65
B.5.5	Three-core cables.....	65
B.6	Screen bonding.....	66
B.7	Cable loading.....	66
B.8	Rating factors for grouped circuits	66
B.9	Correction factors	66
Annex C (normative)	Rounding of numbers.....	82
C.1	Rounding of numbers for the purpose of the fictitious calculation method.....	82
C.2	Rounding of numbers for other purposes	82
Annex D (normative)	Method of measuring resistivity of semi-conducting screens	83
Annex E (normative)	Determination of hardness of HEPR insulations	86
E.1	Test piece.....	86
E.2	Test procedure.....	86
E.2.1	General	86
E.2.2	Surfaces of large radius of curvature	86
E.2.3	Surfaces of small radius of curvature	86
E.2.4	Conditioning and test temperature	86
E.2.5	Number of measurements.....	87
Annex F (normative)	Water penetration test.....	88
F.1	Test piece.....	88
F.2	Test.....	88
F.3	Requirements	89
Annex G (informative)	Determination of the cable conductor temperature	90
G.1	Purpose	90
G.2	Calibration of the temperature of the main test loop	90
G.2.1	General	90
G.2.2	Installation of cable and temperature sensors	90
G.2.3	Calibration method	92
G.3	Heating for the test	93
G.3.1	Method 1 – Test using a reference cable	93
G.3.2	Method 2 – Test using conductor temperature calculations and measurement of the surface temperature	93

Annex H (normative) Test for water penetration in the conductor	95
H.1 General.....	95
H.2 Test piece	95
H.3 Test	95
H.4 Requirements	95
Annex I (normative) Methods of determining the weighted value of halogen content of the non-metallic materials in the cable	97
I.1 Calculating the weighted value of the cable when the halogen content of individual materials is tested	97
I.2 Preparation of the test sample for measurement of halogen content on a sample representative of the non-metallic materials in the cable	97
Bibliography.....	98
Figure B.1 – Single-core cables in air	64
Figure B.2 – Single-core cables buried direct.....	65
Figure B.3 – Single-core cables in earthenware ducts	65
Figure B.4 – Three-core cables.....	66
Figure D.1 – Preparation of samples for measurement of resistivity of conductor and insulation screens.....	85
Figure E.1 – Test on surfaces of large radius of curvature	87
Figure E.2 – Test on surfaces of small radius of curvature	87
Figure F.1 – Schematic diagram of apparatus for water penetration test	89
Figure G.1 – Typical test set-up for the reference loop and the main test loop	91
Figure G.2 – Example of an arrangement of the temperature sensors on the conductor of the reference loop.....	92
Figure H.1 – Schematic diagram of apparatus for water penetration test in the conductor.....	96
Table 1 – Recommended rated voltages U_0	17
Table 2 – Insulating compounds.....	17
Table 3 – Maximum conductor temperatures for different types of insulating compound.....	18
Table 4 – Maximum conductor temperatures for different types of sheathing compound	18
Table 5 – Nominal thickness of PVC/B insulation	19
Table 6 – Nominal thickness of cross-linked polyethylene (XLPE) insulation	19
Table 7 – Nominal thickness of ethylene propylene rubber (EPR) and hard ethylene propylene rubber (HEPR) insulation.....	20
Table 8 – Thickness of extruded inner covering	21
Table 9 – Nominal diameter of round armour wires	26
Table 10 – Nominal thickness of armour tapes.....	26
Table 24 – Nominal thickness of armour strips.....	26
Table 11 – Routine test voltages.....	30
Table 12 – Number of samples for sample tests.....	31
Table 13 – Sample test voltages	34
Table 14 – Impulse voltages	37
Table 15 – Electrical type test requirements for insulating compounds.....	49
Table 16 – Non-electrical type tests (see Table 17 to Table 23 and Table 25).....	50

Table 17 – Test requirements for mechanical characteristics of insulating compounds (before and after ageing)	51
Table 18 – Test requirements for particular characteristics for PVC insulating compound	52
Table 19 – Test requirements for particular characteristics of various crosslinked insulating compounds	53
Table 20 – Test requirements for mechanical characteristics of sheathing compounds (before and after ageing)	54
Table 21 – Test requirements for particular characteristics for PVC sheathing compounds	54
Table 22 – Test requirements for particular characteristics of PE (thermoplastic polyethylene) sheathing compounds	55
Table 23 – Test requirements for particular characteristics of elastomeric sheathing compound	55
Table 25 – Test requirements for particular characteristics of halogen free sheathing compounds	56
Table A.1 – Fictitious diameter of conductor	59
Table A.2 – Increase of diameter for concentric conductors and metal screens	60
Table A.3 – Increase of diameter for additional bedding	62
Table A.4 – Increase of diameter over interlocked armour	62
Table B.1 – Nominal screen cross-sectional areas	63
Table B.2 – Current ratings for single-core cables with XLPE insulation – Rated voltage 3,6/6 kV to 18/30 kV * – Copper conductor	67
Table B.3 – Current ratings for single-core cables with XLPE insulation – Rated voltage 3,6/6 kV to 18/30 kV * – Aluminium conductor	68
Table B.4 – Current ratings for single-core cables with EPR insulation – Rated voltage 3,6/6 kV to 18/30 kV * – Copper conductor	69
Table B.5 – Current ratings for single-core cables with EPR insulation – Rated voltage 3,6/6 kV to 18/30 kV * – Aluminium conductor	70
Table B.6 – Current rating for three-core XLPE insulated cables – Rated voltage 3,6/6 kV to 18/30 kV * – Copper conductor, armoured and unarmoured	71
Table B.7 – Current rating for three-core XLPE insulated cables – Rated voltage 3,6/6 kV to 18/30 kV * – Aluminium conductor, armoured and unarmoured	72
Table B.8 – Current rating for three-core EPR insulated cables – Rated voltage 3,6/6 kV to 18/30 kV * – Copper conductor, armoured and unarmoured	73
Table B.9 – Current rating for three-core EPR insulated cables – Rated voltage 3,6/6 kV to 18/30 kV * – Aluminium conductor, armoured and unarmoured	74
Table B.10 – Correction factors for ambient air temperatures other than 30 °C	74
Table B.11 – Correction factors for ambient ground temperatures other than 20 °C	75
Table B.12 – Correction factors for depths of laying other than 0,8 m for direct buried cables	75
Table B.13 – Correction factors for depths of laying other than 0,8 m for cables in ducts	75
Table B.14 – Correction factors for soil thermal resistivities other than 1,5 K·m/W for direct buried single-core cables	76
Table B.15 – Correction factors for soil thermal resistivities other than 1,5 K·m/W single-core cables in buried ducts	76
Table B.16 – Correction factors for soil thermal resistivities other than 1,5 K·m/W for direct buried three-core cables	77

Table B.17 – Correction factors for soil thermal resistivities other than 1,5 K·m/W for three-core cables in ducts	77
Table B.18 – Correction factors for groups of three-core cables in horizontal formation laid direct in the ground	78
Table B.19 – Correction factors for groups of three-phase circuits of single-core cables laid direct in the ground	78
Table B.20 – Correction factors for groups of three-core cables in single way ducts in horizontal formation	79
Table B.21 – Correction factors for groups of three-phase circuits of single-core cables in single-way ducts	79
Table B.22 – Reduction factors for groups of more than one multi-core cable in air – To be applied to the current-carrying capacity for one multi-core cable in free air	80
Table B.23 – Reduction factors for groups of more than one circuit of single-core cables (Note 2) – To be applied to the current-carrying capacity for one circuit of single-core cables in free air	81

INTERNATIONAL ELECTROTECHNICAL COMMISSION

POWER CABLES WITH EXTRUDED INSULATION AND THEIR ACCESSORIES FOR RATED VOLTAGES FROM 1 kV ($U_m = 1,2$ kV) UP TO 30 kV ($U_m = 36$ kV) –

Part 2: Cables for rated voltages from 6 kV ($U_m = 7,2$ kV) up to 30 kV ($U_m = 36$ kV)

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) IEC draws attention to the possibility that the implementation of this document may involve the use of (a) patent(s). IEC takes no position concerning the evidence, validity or applicability of any claimed patent rights in respect thereof. As of the date of publication of this document, IEC had not received notice of (a) patent(s), which may be required to implement this document. However, implementers are cautioned that this may not represent the latest information, which may be obtained from the patent database available at <https://patents.iec.ch>. IEC shall not be held responsible for identifying any or all such patent rights.

This consolidated version of the official IEC Standard and its amendment has been prepared for user convenience.

IEC 60502-2 edition 3.1 contains the third edition (2014-02) [documents 20/1469A/FDIS and 20/1472/RVD] and its amendment 1 (2024-05) [documents 20/2166/FDIS and 20/2181/RVD].

In this Redline version, a vertical line in the margin shows where the technical content is modified by amendment 1. Additions are in green text, deletions are in strikethrough

red text. A separate Final version with all changes accepted is available in this publication.

International Standard IEC 60502-2 has been prepared by IEC technical committee 20: Electric cables.

This third edition cancels and replaces the second edition, published in 2005, and constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- a) a simplified calculation procedure for the thickness of the lead sheath and the oversheath;
- b) a new subclause for the determination of the cable conductor temperature;
- c) a modified procedure for the routine voltage test;
- d) a new subclause for a routine electrical test on oversheath;
- e) modified requirements for the non-metal sheaths including semi-conductive layer;
- f) modified tolerances for the bending test cylinder;
- g) the inclusion of a 0,1Hz test after installation.

In addition, the modified structure of the IEC 60811 series has been adopted for this third edition.

The following editorial changes have been made within the English version:

- 'metallic' has been replaced by 'metal';
- 'thermosetting' has been replaced by 'crosslinked'.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts in the IEC 60502 series, published under the general title *Power cables with extruded insulation and their accessories for rated voltages from 1kV ($U_m = 1,2$ kV) up to 30 kV ($U_m = 36$ kV)*, can be found on the IEC website.

The committee has decided that the contents of this document and its amendment will remain unchanged until the stability date indicated on the IEC website under webstore.iec.ch in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn, or
- revised.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

POWER CABLES WITH EXTRUDED INSULATION AND THEIR ACCESSORIES FOR RATED VOLTAGES FROM 1 kV ($U_m = 1,2$ kV) UP TO 30 kV ($U_m = 36$ kV) –

Part 2: Cables for rated voltages from 6 kV ($U_m = 7,2$ kV) up to 30 kV ($U_m = 36$ kV)

1 Scope

This part of IEC 60502 specifies the construction, dimensions and test requirements of power cables with extruded solid insulation from 6 kV up to 30 kV for fixed installations such as distribution networks or industrial installations.

When determining applications, it is recommended that the possible risk of radial water ingress is considered. Cable designs with barriers claimed to prevent longitudinal water penetration and an associated test are included in this part of IEC 60502.

Cables for special installation and service conditions are not included, for example cables for overhead networks, the mining industry, nuclear power plants (in and around the containment area) nor for submarine use or shipboard application.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60038, *IEC standard voltages*

IEC 60060-1, *High-voltage test techniques – Part 1: General definitions and test requirements*

IEC 60060-3, *High-voltage test techniques – Part 3: Definitions and requirements for on-site testing*

IEC 60183, *Guide to the selection of high-voltage cables*

IEC 60228, *Conductors of insulated cables*

IEC 60229:2007, *Tests on cable oversheaths which have a special protective function and are applied by extrusion*

IEC 60230, *Impulse tests on cables and their accessories*

IEC 60287-3-1, *Electric cables – Calculation of the current rating – Part 3: Sections on operating conditions – Section 1: Reference operating conditions and selection of cable type*

IEC 60332-1-2, *Tests on electric and optical fibre cables under fire conditions – Part 1-2: Test for vertical flame propagation for a single insulated wire or cable – Procedure for 1 kW pre-mixed flame*

IEC 60332-3-24, *Tests on electric and optical fibre cables under fire conditions – Part 3-24: Test for vertical flame spread of vertically-mounted bunched wires or cables – Category C*

IEC 60684-2, *Flexible insulating sleeving – Part 2: Methods of test*

IEC 60754-1, *Test on gases evolved during combustion of materials from cables – Part 1: Determination of the halogen acid gas content*

IEC 60754-2, *Test on gases evolved during combustion of materials from cables – Part 2: Determination of acidity (by pH measurement) and conductivity*

IEC 60754-3, *Test on gases evolved during combustion of materials from cables – Part 3: Measurement of low level of halogen content by ion chromatography*

IEC 60811 (all parts), *Electric and optical fibre cables – Test methods for non-metallic materials*

IEC 60811-201, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 201: General tests – Measurement of insulation thickness*

IEC 60811-202, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 202: General tests – Measurement of thickness of non-metallic sheath*

IEC 60811-203, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 203: General tests – Measurement of overall dimensions*

IEC 60811-401, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 401: Miscellaneous tests – Thermal ageing methods – Ageing in an air oven*

IEC 60811-402, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 402: Miscellaneous tests – Water absorption tests*

IEC 60811-403, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 403: Miscellaneous tests – Ozone resistance test on cross-linked compounds*

IEC 60811-404, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 404: Miscellaneous tests – Mineral oil immersion tests for sheaths*

IEC 60811-405, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 405: Miscellaneous tests – Thermal stability test for PVC insulations and PVC sheaths*

IEC 60811-409, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 409: Miscellaneous tests – Loss of mass test for thermoplastic insulations and sheaths*

IEC 60811-501, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 501: Mechanical tests – Tests for determining the mechanical properties of insulating and sheathing compounds*

IEC 60811-502, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 502: Mechanical tests – Shrinkage test for insulations*

IEC 60811-503, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 503: Mechanical tests – Shrinkage test for sheaths*

IEC 60811-504, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 504: Mechanical tests – Bending tests at low temperature for insulation and sheaths*

IEC 60811-505, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 505: Mechanical tests – Elongation at low temperature for insulations and sheaths*

IEC 60811-506, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 506: Mechanical tests – Impact test at low temperature for insulations and sheaths*

IEC 60811-507, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 507: Mechanical tests – Hot set test for cross-linked materials*

IEC 60811-508, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 508: Mechanical tests – Pressure test at high temperature for insulation and sheaths*

IEC 60811-509, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 509: Mechanical tests – Test for resistance of insulations and sheaths to cracking (heat shock test)*

IEC 60811-605, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 605: Physical tests – Measurement of carbon black and/or mineral filler in polyethylene compounds*

IEC 60811-606, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 606: Physical tests – Methods for determining the density*

IEC 60853 (all parts), *Calculation of the cyclic and emergency current rating of cables*

IEC 60853-2, *Calculation of the cyclic and emergency current rating of cables – Part 2: Cyclic rating of cables greater than 18/30 (36) kV and emergency ratings for cables of all voltages*

IEC 60885-3, *Electrical test methods for electric cables – Part 3: Test methods for partial discharge measurements on lengths of extruded power cables*

IEC 60986, *Short-circuit temperature limits of electric cables with rated voltages from 6 kV ($U_m = 7,2$ kV) up to 30 kV ($U_m = 36$ kV)*

IEC 61034-2, *Measurement of smoke density of cables burning under defined conditions – Part 2: Test procedure and requirements*

ISO 48, *Rubber, vulcanized or thermoplastic – Determination of hardness (hardness between 10 IRHD and 100 IRHD)*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

3.1 Definitions of dimensional values (thicknesses, cross-sections, etc.)

3.1.1

nominal value

value by which a quantity is designated and which is often used in tables

Note 1 to entry: Usually, in this standard, nominal values give rise to values to be checked by measurements taking into account specified tolerances.

3.1.2**approximate value**

value which is neither guaranteed nor checked; it is used, for example, for the calculation of other dimensional values

3.1.3**median value**

when several test results have been obtained and ordered in an increasing (or decreasing) succession, the median value is the middle value if the number of available values is odd, and the mean of the two middle values if the number is even

3.1.4**fictitious value**

value calculated according to the "fictitious method" described in Annex A

3.2 Definitions concerning the tests**3.2.1****routine tests**

tests made by the manufacturer on each manufactured length of cable to check that each length meets the specified requirements

3.2.2**sample tests**

tests made by the manufacturer on samples of completed cable or components taken from a completed cable, at a specified frequency, so as to verify that the finished product meets the specified requirements

3.2.3**type tests**

tests made before supplying, on a general commercial basis, a type of cable covered by this standard, in order to demonstrate satisfactory performance characteristics to meet the intended application

Note 1 to entry: These tests are of such a nature that, after they have been made, they need not be repeated, unless changes are made in the cable materials or design or manufacturing process which might change the performance characteristics.

3.2.4**electrical tests after installation**

tests made to demonstrate the integrity of the cable and its accessories as installed

4 Voltage designations and materials**4.1 Rated voltages**

The rated voltages $U_0/U(U_m)$ of the cables considered in this standard are as follows:

$$U_0/U(U_m) = 3,6/6 (7,2) - 6/10 (12) - 8,7/15 (17,5) - 12/20 (24) - 18/30 (36) \text{ kV.}$$

NOTE The voltages given above are the correct designations although in some countries other designations are used, e.g. 3,5/6 – 5,8/10 – 11,5/20 – 17,3/30 kV.

In the voltage designation of cables $U_0/U(U_m)$:

U_0 is the rated power frequency voltage between conductor and earth or metal screen for which the cable is designed;

U is the rated power frequency voltage between conductors for which the cable is designed;

U_m is the maximum value of the "highest system voltage" for which the equipment may be used (see IEC 60038).

The rated voltage of the cable for a given application shall be suitable for the operating conditions in the system in which the cable is used. To facilitate the selection of the cable, systems are divided into three categories:

- category A: this category comprises those systems in which any phase conductor that comes in contact with earth or an earth conductor is disconnected from the system within 1 min;
- category B: this category comprises those systems which, under fault conditions, are operated for a short time with one phase earthed. This period, according to IEC 60183, should not exceed 1 h. For cables covered by this standard, a longer period, not exceeding 8 h on any occasion, can be tolerated. The total duration of earth faults in any year should not exceed 125 h;
- category C: this category comprises all systems which do not fall into category A or B.

It should be realized that in a system where an earth fault is not automatically and promptly isolated, the extra stresses on the insulation of cables during the earth fault reduce the life of the cables to a certain degree. If the system is expected to be operated fairly often with a permanent earth fault, it may be advisable to classify the system in category C.

The values of U_0 recommended for cables to be used in three-phase systems are listed in Table 1.

Table 1 – Recommended rated voltages U_0

Highest system voltage (U_m) kV	Rated voltage (U_0) kV	
	Categories A and B	Category C
7,2	3,6	6,0
12,0	6,0	8,7
17,5	8,7	12,0
24,0	12,0	18,0
36,0	18,0	–

4.2 Insulating compounds

The types of insulating compound covered by this standard are listed in Table 2, together with their abbreviated designations.

Table 2 – Insulating compounds

Insulating compound	Abbreviated designation
a) <i>Thermoplastic</i> polyvinyl chloride intended for cables with rated voltages $U_0/U = 3,6/6$ kV	PVC/B*
b) <i>Crosslinked</i> : ethylene propylene rubber or similar (EPM or EPDM) high modulus or hard grade ethylene propylene rubber cross-linked polyethylene	EPR HEPR XLPE
* Insulating compound based on polyvinyl chloride intended for cables with rated voltages $U_0/U \leq 1,8/3$ kV is designated PVC/A in IEC 60502-1.	

The maximum conductor temperatures for different types of insulating compound covered by this standard are given in Table 3.

Table 3 – Maximum conductor temperatures for different types of insulating compound

Insulating compound		Maximum conductor temperature °C	
		Normal operation	Short-circuit (5 s maximum duration)
Polyvinyl chloride (PVC/B)	Conductor cross-section $\leq 300 \text{ mm}^2$	70	160
	Conductor cross-section $> 300 \text{ mm}^2$	70	140
Cross-linked polyethylene (XLPE)		90	250
Ethylene propylene rubber (EPR and HEPR)		90	250

The temperatures in Table 3 are based on the intrinsic properties of the insulating materials. It is important to take into account other factors when using these values for the calculation of current ratings.

For example, in normal operation, if a cable directly buried in the ground is operated under continuous load (100 % load factor) at the maximum conductor temperature shown in the table, the thermal resistivity of the soil surrounding the cable may, in the course of time, increase from its original value as a result of drying-out processes. As a consequence, the conductor temperature may greatly exceed the maximum value. If such operating conditions are foreseen, adequate provisions shall be made.

For guidance on continuous current ratings, reference should be made to Annex B, including the ratings under standard laying conditions, in Tables B.2 to B.9, and correction factors for deviation laying conditions, in Tables B.10 to B.23.

For guidance on the short-circuit temperatures, reference should be made to IEC 60986.

4.3 Sheathing compounds

The maximum conductor temperatures for the different types of sheathing compound covered by this standard are given in Table 4.

Table 4 – Maximum conductor temperatures for different types of sheathing compound

Sheathing compound	Abbreviated designation	Maximum conductor temperature in normal operation °C
a) <i>Thermoplastic</i> :		
polyvinyl chloride (PVC)	ST ₁	80
	ST ₂	90
polyethylene	ST ₃	80
	ST ₇	90
halogen free	ST ₈	90
	ST ₁₂	90
b) <i>Elastomeric</i> :		
polychloroprene, chlorosulfonated polyethylene or similar polymers	SE ₁	85

5 Conductors

The conductors shall be either of class 1 or class 2 of plain or metal-coated annealed copper or of plain aluminium or aluminium alloy in accordance with IEC 60228. For class 2 conductors measures may be taken to achieve longitudinal watertightness.

6 Insulation

6.1 Material

Insulation shall be extruded dielectric of one of the types listed in Table 2.

6.2 Insulation thickness

The nominal insulation thicknesses are specified in Tables 5 to 7.

The thickness of any separator or semi-conducting screen on the conductor or over the insulation shall not be included in the thickness of the insulation.

Table 5 – Nominal thickness of PVC/B insulation

Nominal cross-sectional area of conductor mm ²	Nominal thickness of insulation at rated voltage 3,6/6 (7,2) kV mm
10 to 1 600	3,4

NOTE 1 Any smaller conductor cross-section than those given in this table is not recommended. However, if a smaller cross-section is needed, either the diameter of the conductor may be increased by a conductor screen (see 7.2), or the insulation thickness may be increased in order to limit, at the values calculated with the smallest conductor size given in this table, the maximum electrical stresses applied to the insulation under test voltage.

NOTE 2 For conductor cross-sections larger than 1 000 mm², the insulation thickness may be increased to avoid any mechanical damage during installation and service.

Table 6 – Nominal thickness of cross-linked polyethylene (XLPE) insulation

Nominal cross-sectional area of conductor mm ²	Nominal thickness of insulation at rated voltage U_0/U (U_m)				
	3,6/6 (7,2) kV mm	6/10 (12) kV mm	8,7/15 (17,5) kV mm	12/20 (24) kV mm	18/30 (36) kV mm
10	2,5	–	–	–	–
16	2,5	3,4	–	–	–
25	2,5	3,4	4,5	–	–
35	2,5	3,4	4,5	5,5	–
50 to 185	2,5	3,4	4,5	5,5	8,0
240	2,6	3,4	4,5	5,5	8,0
300	2,8	3,4	4,5	5,5	8,0
400	3,0	3,4	4,5	5,5	8,0
500 to 1 600	3,2	3,4	4,5	5,5	8,0

NOTE 1 Any smaller conductor cross-section than those given in this table is not recommended. However, if a smaller cross-section is needed, either the diameter of the conductor may be increased by a conductor screen (see 7.2), or the insulation thickness may be increased in order to limit, at the values calculated with the smallest conductor size given in this table, the maximum electrical stresses applied to the insulation under test voltage.

NOTE 2 For conductor cross-sections larger than 1 000 mm², the insulation thickness may be increased to avoid any mechanical damage during installation and service.

**Table 7 – Nominal thickness of ethylene propylene rubber (EPR)
and hard ethylene propylene rubber (HEPR) insulation**

Nominal cross-sectional area of conductor mm ²	Nominal thickness of insulation at rated voltage U_0/U (U_m)					
	3,6/6 (7,2) kV		6/10 (12) kV	8,7/15 (17,5) kV	12/20 (24) kV	18/30 (36) kV
	Unscreened mm	Screened mm	mm	mm	mm	mm
10	3,0	2,5	–	–	–	–
16	3,0	2,5	3,4	–	–	–
25	3,0	2,5	3,4	4,5	–	–
35	3,0	2,5	3,4	4,5	5,5	–
50 to 185	3,0	2,5	3,4	4,5	5,5	8,0
240	3,0	2,6	3,4	4,5	5,5	8,0
300	3,0	2,8	3,4	4,5	5,5	8,0
400	3,0	3,0	3,4	4,5	5,5	8,0
500 to 1 600	3,2	3,2	3,4	4,5	5,5	8,0

NOTE 1 Any smaller conductor cross-section than those given in this table is not recommended. However, if a smaller cross-section is needed, either the diameter of the conductor may be increased by a conductor screen (see 7.2), or the insulation thickness may be increased in order to limit, at the values calculated with the smallest conductor size given in this table, the maximum electrical stresses applied to the insulation under test voltage.

NOTE 2 For conductor cross-sections larger than 1 000 mm², the insulation thickness may be increased to avoid any mechanical damage during installation and service.

7 Screening

7.1 General

All cables shall have a metal layer surrounding the cores, either individually or collectively.

Screening of individual cores in single or three-core cables, when required, shall consist of a conductor screen and an insulation screen. These shall be employed in all cables with the following exceptions:

- at rated voltage 3,6/6 (7,2) kV cables insulated with EPR and HEPR may be unscreened, provided the larger insulation thickness in Table 7 is used;
- at rated voltage 3,6/6 (7,2) kV cables insulated with PVC shall be unscreened.

7.2 Conductor screen

The conductor screen shall be non-metal and shall consist of an extruded semi-conducting compound, which may be applied on top of a semi-conducting tape. The extruded semi-conducting compound shall be firmly bonded to the insulation.

7.3 Insulation screen

The insulation screen shall consist of a non-metal, semi-conducting layer in combination with a metal layer.

The non-metal layer shall be extruded directly upon the insulation of each core and consist of either a bonded or strippable semi-conducting compound.

A layer of semi-conducting tape or compound may then be applied over the individual cores or the core assembly.

The metal layer shall be applied over either the individual cores or the core assembly collectively and shall comply with the requirements of Clause 10.

8 Assembly of three-core cables, inner coverings and fillers

8.1 General

The assembly of three-core cables depends on the rated voltage and whether a metal screen is applied to each core.

Subclauses 8.2 to 8.4 do not apply to assemblies of sheathed single-core cables.

8.2 Inner coverings and fillers

8.2.1 Construction

The inner coverings may be extruded or lapped.

For cables with circular cores, a lapped inner covering shall be permitted only if the interstices between the cores are substantially filled.

A suitable binder is permitted before application of an extruded inner covering.

8.2.2 Material

The materials used for inner coverings and fillers shall be suitable for the operating temperature of the cable and compatible with the insulating material.

8.2.3 Thickness of extruded inner covering

The approximate thickness of extruded inner coverings shall be derived from Table 8.

Table 8 – Thickness of extruded inner covering

Fictitious diameter over laid-up cores		Thickness of extruded inner covering (approximate values) mm
Above mm	Up to and including mm	
–	25	1,0
25	35	1,2
35	45	1,4
45	60	1,6
60	80	1,8
80	–	2,0

8.2.4 Thickness of lapped inner covering

The approximate thickness of lapped inner coverings shall be 0,4 mm for fictitious diameters over laid-up cores up to and including 40 mm and 0,6 mm for larger diameters.

8.3 Cables having a collective metal layer (see Clause 9)

Cables shall have an inner covering over the laid-up cores. The inner covering and fillers shall comply with 8.2 and shall be non-hygroscopic except if the cable is claimed to be longitudinally watertight.

For cables having a semi-conducting screen over each individual core and a collective metal layer, the inner covering shall be semi-conducting; the fillers may be semi-conducting.

8.4 Cables having a metal layer over each individual core (see Clause 10)

The metal layers of the individual cores shall be in contact with each other.

Cables with an additional collective metal layer (see Clause 9) of the same material as the underlying individual metal layers shall have an inner covering over the laid-up cores. The inner covering and fillers shall comply with 8.2 and shall be non-hygroscopic except if the cable is claimed to be longitudinally watertight. The inner covering and fillers may be semi-conducting.

When the underlying individual metal layers and the collective metal layer are of different materials, they shall be separated by an extruded sheath of one of the materials specified in 14.2. For lead sheathed cables, the separation from the underlying individual metal layers may be obtained by an inner covering according to 8.2.

For cables without a collective metal layer (see Clause 9), the inner covering may be omitted provided the outer shape of the cable remains practically circular.

9 Metal layers for single-core and three-core cables

The following types of metal layers are included in this standard:

- a) metal screen (see Clause 10);
- b) concentric conductor (see Clause 11);
- c) metal sheath (see Clause 12);
- d) metal armour (see Clause 13).

The metal layer(s) shall comprise one or more of the types listed above and shall be non-magnetic when applied to either single-core cables or individual cores of three-core cables.

Measures may be taken to achieve longitudinal watertightness in the region of the metal layers.

10 Metal screen

10.1 Construction

The metal screen shall consist of one or more tapes, or a braid, or a concentric layer of wires or a combination of wires and tape(s).

It may also be a sheath or, in the case of a collective screen, an armour which complies with 10.2.

When choosing the material of the screen, special consideration shall be given to the possibility of corrosion, not only for mechanical safety but also for electrical safety.

Gaps in the screen shall comply with the national regulations and/or standards.

10.2 Requirements

The dimensional, physical and electrical requirements of the metal screen shall be determined by national regulations and/or standards.

10.3 Metal screens not associated with semi-conducting layers

Where metal screens are employed at rated voltage of 3,6/6 (7,2) kV with PVC, EPR and HEPR insulations, these need not be associated with semi-conducting layers.

11 Concentric conductor

11.1 Construction

Gaps in the concentric conductor shall comply with national regulations and/or standards.

When choosing the material of the concentric conductor, special consideration shall be given to the possibility of corrosion, not only for mechanical safety but also for electrical safety.

11.2 Requirements

The dimensional and physical requirements of the concentric conductor and its electrical resistance shall be determined by national regulations and/or standards.

11.3 Application

When a concentric conductor is required, it shall be applied over the inner covering in the case of three-core cables; in the case of single-core cables, it shall be applied either directly over the insulation or over the semi-conducting insulation screen or over a suitable inner covering.

12 Metal sheath

12.1 Lead sheath

The sheath shall consist of lead or lead alloy and shall be applied as a reasonably tight-fitting seamless tube.

The nominal thickness shall be calculated by the following formula:

$$t_{pb} = 0,03 D_g + 0,7$$

where

t_{pb} is the nominal thickness of the lead sheath, in millimetres;

D_g is the fictitious diameter under the lead sheath, in millimetres (rounded to the first decimal place in accordance with Annex C).

In all cases, the smallest nominal thickness shall be 1,2 mm. Calculated values shall be rounded to the first decimal place (see Annex C).

12.2 Other metal sheaths

Under consideration.

13 Metal armour

13.1 Types of metal armour

The armour types covered by this standard are as follows:

- a) flat wire armour;
- b) round wire armour;
- c) double tape armour;
- d) interlock metal tape armour.

13.2 Materials

Round or flat wires shall be of galvanized steel, copper or tinned copper, aluminium or aluminium alloy.

Tapes shall be of steel, galvanized steel, aluminium or aluminium alloy. Steel tapes shall be hot or cold rolled of commercial quality.

NOTE Other metal materials can be used upon agreement between the manufacturer and customer.

In those cases where the steel armour wire layer is required to comply with a minimum conductance, it is permissible to include sufficient copper or tinned copper wires in the armour layer to ensure compliance.

When choosing the material of the armour, special consideration shall be given to the possibility of corrosion, not only for mechanical safety, but also for electrical safety, especially when the armour is used as a screen.

The armour of single-core cables for use on a.c. systems shall consist of non-magnetic material, unless a special construction is chosen.

13.3 Application of armour

13.3.1 Single-core cables

In the case of single-core cables, an inner covering, extruded or lapped, of the thickness specified in 8.2.3 or 8.2.4, shall be applied under the armour if there is no screen.

13.3.2 Three-core cables

When an armour is required in the case of three-core cables, it shall be applied on an inner covering complying with 8.2.

13.3.3 Separation sheath

When the underlying metal layer and the armour are of different materials, they shall be separated by an extruded sheath of one of the materials specified in 14.2.

When an armour is required for a lead-sheathed cable, it may be applied over a separation sheath or a lapped bedding according to 13.3.4.

If a separation sheath is used, it shall be applied under the armour instead of, or in addition to, the inner covering.

A separation sheath is not required when measures have been taken to achieve longitudinal watertightness in the region of the metal layers.

The nominal thickness of the separation sheath T_s expressed in millimetres shall be calculated by the following formula:

$$T_s = 0,02 D_u + 0,6$$

where D_u is the fictitious diameter under this sheath, in millimetres, calculated as described in Annex A.

The value resulting from the formula shall be rounded off to the nearest 0,1 mm (see Annex C).

For cables without a lead sheath, the nominal thickness shall be not less than 1,2 mm. For cables where the separation sheath is applied directly over the lead sheath, the nominal thickness shall be not less than 1,0 mm.

13.3.4 Lapped bedding under armour for lead sheathed cables

The lapped bedding applied to the compound coated lead sheath shall consist of either impregnated and compounded paper tapes or a combination of two layers of impregnated and compounded paper tapes followed by one or more layers of compounded fibrous material.

The impregnation of bedding materials may be made with bituminous or other preservative compounds. In case of wire armour, these compounds shall not be applied directly under the wires.

Synthetic tapes may be applied instead of impregnated paper tapes.

The total thickness of the lapped bedding between the lead sheath and the armour after application of the armour shall have an approximate value of 1,5 mm.

13.4 Dimensions of the armour wires, ~~and~~ armour tapes and armour strips

The nominal dimensions of the armour wires, ~~and~~ armour tapes and armour strips shall preferably be one of the following values:

round wires:

0,8 – 1,25 – 1,6 – 2,0 – 2,5 – 3,15 mm diameter;

flat wires:

0,8 mm thickness;

tapes of steel:

0,2 – 0,5 – 0,8 mm thickness;

tapes of aluminium or aluminium alloy:

0,5 – 0,8 mm thickness;

strips of the interlocked armour:

0,65 – 0,90 – 1,05 mm thickness (before forming).

13.5 Correlation between cable diameters and armour dimensions

The nominal diameters of round armour wires, ~~and the~~ nominal thicknesses of ~~the~~ armour tapes and the thickness of armour strips, shall ~~be~~ not be less than the values given in Table 9, Table 10 and Table 24 respectively.

Table 9 – Nominal diameter of round armour wires

Fictitious diameter under the armour		Nominal diameter of armour wire mm
Above mm	Up to and including mm	
–	10	0,8
10	15	1,25
15	25	1,6
25	35	2,0
35	60	2,5
60	–	3,15

Table 10 – Nominal thickness of armour tapes

Fictitious diameter under the armour		Nominal thickness of tape	
Above mm	Up to and including mm	Steel or galvanized steel mm	Aluminium or aluminium alloy mm
–	30	0,2	0,5
30	70	0,5	0,5
70	–	0,8	0,8

Table 24 – Nominal thickness of armour strips

Fictitious diameter under interlock armour		Nominal thickness of strip (before forming) mm
Above mm	Up to and including mm	
–	20	0,65
20	40	0,90
40	–	1,05

For flat wire armour and fictitious diameters under armour greater than 15 mm, the nominal thickness of the flat steel wire shall be 0,8 mm. Cables with fictitious diameters under the armour up to and including 15 mm shall not be armoured with flat wires.

13.6 Round or flat wire armour

The wire armour shall be closed, i.e. with a minimum gap between adjacent wires. An open helix consisting of galvanized steel tape with a nominal thickness of at least 0,3 mm may be provided over flat steel wire armour and over round steel wire armour, if necessary. Tolerances on this steel tape shall comply with 17.7.3.

13.7 Double tape armour

When a tape armour and an inner covering as specified in 8.2 are used, the inner covering shall be reinforced by a taped bedding. The total thickness of the inner covering and the additional taped bedding shall be as given in 8.2 plus 0,5 mm if the armour tape thickness is 0,2 mm, and plus 0,8 mm if the armour tape thickness is more than 0,2 mm.

The total thickness of the inner covering and the additional taped bedding shall be not less than these values by more than 0,2 mm with a tolerance of +20 %.

If a separation sheath is required or if the inner covering is extruded and satisfies the requirements of 13.3.3, the additional taped bedding is not required.

The tape armour shall be applied helically in two layers so that the outer tape is approximately central over the gap of the inner tape. The gap between adjacent turns of each tape shall not exceed 50 % of the width of the tape.

13.8 Interlock metal tape armour

Interlocking armour is the process of continuously forming a metal strip(s) into helical coil(s) in which the leading edge of the formed strip engages with the trailing edge of the adjacent strip to form a continuous flexible tube which is applied over the underlying cable layer (assembly of cores, bedding, or separation sheath).

The interlocked metal tape armour shall, with the oversheath removed, allow bending without opening at any point or damaging the cable when bent around a mandrel having a diameter not more than 10 times the diameter over the armour.

14 Oversheath

14.1 General

All cables shall have an oversheath.

The oversheath is normally black, but a colour other than black may be provided by agreement between the manufacturer and the purchaser customer, subject to its suitability for the particular conditions under which the cable is to be used.

~~NOTE—A UV stability test is under consideration.~~

If there is concern that the oversheath will be deteriorated by UV radiation, the oversheath shall be protected against UV radiation, which will be mutually agreed with the customer. Black polyethylene oversheaths containing the required amount of a suitable and well-dispersed grade of carbon black (see Table 22) can provide protection against UV radiation depending on geographical regions and meteorological conditions.

NOTE 1 For some applications the oversheath can be covered by a functional layer (e.g. semi-conductive).

NOTE 2 Halogen free fire retardant oversheaths are not intended for installations outdoors and are not normally considered as UV protected.

14.2 Material

The oversheath shall consist of ~~a thermoplastic compound (PVC or polyethylene) or an elastomeric compound (polychloroprene, chlorosulfonated polyethylene or similar polymers)~~ an extruded compound selected from the types listed in Table 4.

Halogen free sheathing material ST₈ or ST₁₂ shall be used on cables which exhibit properties of reduced flame spread, low levels of smoke emission and halogen free gas emission when exposed to fire. The oversheath (ST₈ or ST₁₂) of halogen free cables shall meet the requirements given in Table 20 and Table 25.

These two oversheath material grades have different mechanical requirements. They depend on installation conditions and cable designs, and on which of these two are suitable. Further guidance on selection can be given in regional or national standards.

The ~~oversheathing~~ material shall be suitable for the operating temperature in accordance with Table 4.

NOTE Chemical additives ~~may~~ can be ~~necessary~~ requested for use in the oversheath for special purposes, for example termite protection, ~~but they should not include materials harmful to mankind and/or environment.~~

NOTE ~~Examples of materials¹⁾ considered to be undesirable include:~~

- ~~• Aldrin: 1,2,3,4,10,10-hexachloro-1,4,4a,5,8,8a-hexahydro-1,4,5,8-dimethanonaphthalene~~
- ~~• Dieldrin: 1,2,3,4,10,10-hexachloro-6,7-epoxy-1,4,4a,5,6,7,8,8a-octahydro-1,4,5,8-dimethanonaphthalene~~
- ~~• Lindane: Gamma isomer of 1,2,3,4,5,6-hexachloro-cyclohexane.~~

14.3 Thickness

Unless otherwise specified the nominal thickness t_s expressed in millimetres shall be calculated by the following formula:

$$t_s = 0,035 D + 1,0$$

where D is the fictitious diameter immediately under the oversheath, in millimetres (see Annex A).

The value resulting from the formula shall be rounded off to the nearest 0,1 mm (see Annex C).

The nominal thickness shall be not less than 1,4 mm for single-core cables and not less than 1,8 mm for multicore cables.

15 Test conditions

15.1 Ambient temperature

Unless otherwise specified in the details for the particular test, tests shall be made at an ambient temperature of $(20 \pm 15) ^\circ\text{C}$.

15.2 Frequency and waveform of power frequency test voltages

The frequency of the alternating test voltages shall be in the range 49 Hz to 61 Hz. The waveform shall be substantially sinusoidal. The values quoted are r.m.s. values.

15.3 Waveform of impulse test voltages

In accordance with IEC 60230, the impulse wave shall have a virtual front time between 1 μs and 5 μs and a nominal time to half the peak value between 40 μs and 60 μs . In other respects, it shall be in accordance with IEC 60060-1.

15.4 Determination of the cable conductor temperature

It is recommended that one of the test methods described in Annex G is used to determine the actual temperature.

¹⁾ ~~Source: *Dangerous properties of industrial materials*, N.I. Sax, fifth edition, Van Nostrand Reinhold, ISBN 0-442-27373-8.~~

16 Routine tests

16.1 General

Routine tests are normally carried out on each manufactured length of cable (see 3.2.1). The number of lengths to be tested may however be reduced or an alternative test method adopted, according to agreed quality control procedures.

The routine tests required by this standard are as follows:

- a) measurement of the electrical resistance of conductors (see 16.2);
- b) partial discharge test (see 16.3) on cables having cores with conductor screens and insulation screens in accordance with 7.2 and 7.3;
- c) voltage test (see 16.4).
- d) electrical test on oversheath, if required (see 16.5).

16.2 Electrical resistance of conductors

Resistance measurements shall be made on all conductors of each cable length submitted to the routine tests, including the concentric conductor, if any.

The complete cable length, or a sample from it, shall be placed in the test room, which shall be maintained at a reasonably constant temperature, for at least 12 h before the test. In case of doubt as to whether the conductor temperature is the same as the room temperature, the resistance shall be measured after the cable has been in the test room for 24 h. Alternatively, the resistance can be measured on a sample of conductor conditioned for at least 1 h in a temperature-controlled liquid bath.

The measured value of resistance shall be corrected to a temperature of 20 °C and 1 km length in accordance with the formulae and factors given in IEC 60228.

The d.c. resistance of each conductor at 20 °C shall not exceed the appropriate maximum value specified in IEC 60228. For concentric conductors, the resistance shall comply with national regulations and/or standards.

16.3 Partial discharge test

The partial discharge test shall be carried out in accordance with IEC 60885-3, except that the sensitivity as defined in IEC 60885-3 shall be 10 pC or better.

For three-core cables, the test shall be carried out on all insulated cores, the voltage being applied between each conductor and the screen.

The test voltage shall be raised gradually to and held at $2 U_0$ for 10 s and then slowly reduced to $1,73 U_0$.

There shall be no detectable discharge exceeding the declared sensitivity from the test object at $1,73 U_0$.

NOTE Any partial discharge from the test object may be harmful.

16.4 Voltage test

16.4.1 General

The voltage test shall be made at ambient temperature, using alternating voltage at power frequency.

16.4.2 Test procedure for single-core cables

For single-core cables, the test voltage shall be applied for 5 min between the conductor and the metal screen.

16.4.3 Test procedure for three-core cables

For three-core cables with individually screened cores, the test voltage shall be applied for 5 min between each conductor and the metal layer.

For three-core cables without individually screened cores, the test voltage shall be applied for 5 min in succession between each insulated conductor and all the other conductors and collective metal layers.

Three-core cables may be tested in a single operation by using a three-phase transformer.

16.4.4 Test voltage

The power frequency test voltage shall be $3,5 U_0$. Values of the single-phase test voltage for the standard rated voltages are given in Table 11.

Table 11 – Routine test voltages

Rated voltage U_0	kV	3,6	6	8,7	12	18
Test voltage	kV	12,5	21	30,5	42	63

If, for three-core cables, the voltage test is carried out with a three-phase transformer, the test voltage between the phases shall be 1,73 times the values given in this table.

In all cases, the test voltage shall be increased gradually to the specified value.

16.4.5 Requirement

No breakdown of the insulation shall occur.

16.5 Electrical test on oversheath of the cable

If agreed between customer and supplier the cable shall be subjected to the electrical test specified in 3.2 of IEC 60229:2007.

Cables having an extruded semi-conductive layer on the oversheath shall be excluded and the d.c. voltage test specified in 3.1 of IEC 60229:2007 may be applied.

17 Sample tests

17.1 General

The sample tests required by this standard are as follows:

- conductor examination (see 17.4);
- check of dimensions (see 17.5 to 17.8);
- voltage test for cables of rated voltage above 3,6/6 (7,2) kV (see 17.9);
- hot set test for EPR, HEPR and XLPE insulations and elastomeric sheaths (see 17.10);
- bending test on interlock armour cable followed by examination (see 17.11).

17.2 Frequency of sample tests

17.2.1 Conductor examination and check of dimensions

Conductor examination, measurement of the thickness of insulation and sheath and measurement of the overall diameter shall be made on one length from each manufacturing series of the same type and nominal cross-section of cable, but shall be limited to not more than 10 % of the number of lengths in any contract.

17.2.2 Electrical and physical tests

Electrical and physical tests shall be carried out on samples taken from manufactured cables according to agreed quality control procedures. In the absence of such an agreement, for contracts where the total length exceeds 2 km for three-core cables, or 4 km for single-core cables, tests shall be made on the basis of Table 12.

Table 12 – Number of samples for sample tests

Cable length				Number of samples
Multicore cables		Single-core cables		
Above km	Up to and including km	Above km	Up to and including km	
2	10	4	20	1
10	20	20	40	2
20	30	40	60	3
etc.		etc.		etc.

17.3 Repetition of tests

If any sample fails in any of the tests in Clause 17, two further samples shall be taken from the same batch and submitted to the same test or tests in which the original sample failed. If both additional samples pass the tests, all the cables in the batch from which they were taken shall be regarded as complying with the requirements of this standard. If either of the additional samples fails, the batch from which they were taken shall be regarded as failing to comply.

17.4 Conductor examination

Compliance with the requirements for conductor construction of IEC 60228 shall be checked by inspection and by measurement, when practicable.

17.5 Measurement of thickness of insulation and of non-metal sheaths (including extruded separation sheaths, but excluding inner extruded coverings)

17.5.1 General

The test method shall be in accordance with IEC 60811-201 and IEC 60811-202.

Each cable length selected for the test shall be represented by a piece of cable taken from one end after having discarded, if necessary, any portion which may have suffered damage.

17.5.2 Requirements for the insulation

For each piece of core, the smallest value measured shall not fall below 90 % of the nominal value by more than 0,1 mm, i.e.:

$$t_{\min} \geq 0,9 t_n - 0,1$$

and additionally:

$$(t_{\max} - t_{\min}) / t_{\max} \leq 0,15$$

where

$t_{\max}$ is the maximum thickness, in millimetres;

$t_{\min}$ is the minimum thickness, in millimetres;

t_n is the nominal thickness, in millimetres.

NOTE $t_{\max}$ and $t_{\min}$ are measured at the same cross-section.

17.5.3 Requirements for the non-metal sheaths

If an extruded semi-conductive outer layer is used and it is fully bonded to the non-metal sheath, a thickness up to 0,3 mm of the semi-conductive layer can be accepted as a part of the sheath thickness. The sheath including the semi-conductive outer layer shall fulfil the same mechanical requirements as required for the sheath compound type specified, no matter how the dumbbell has been prepared.

The minimum thickness of the non-metal sheath shall not fall below 80 % of the nominal value by more than 0,2 mm, i.e.

$$t_{\min} \geq 0,8t_n - 0,2$$

17.6 Measurement of thickness of lead sheath

17.6.1 General

The minimum thickness of the lead sheath shall be determined by one of the following methods, at the discretion of the manufacturer, and shall not fall below 95 % of the nominal thickness by more than 0,1 mm i.e.:

$$t_{\min} \geq 0,95 t_n - 0,1$$

NOTE Methods of measuring thickness of other types of metal sheath are under consideration.

17.6.2 Strip method

The measurement shall be made with a micrometer with plane faces of 4 mm to 8 mm diameter and an accuracy of $\pm 0,01$ mm.

The measurement shall be made on a test piece of sheath about 50 mm in length removed from the completed cable. The piece shall be slit longitudinally and carefully flattened. After cleaning the test piece, a sufficient number of measurements shall be made along the circumference of the sheath and not less than 10 mm away from the edge of the flattened piece to ensure that the minimum thickness is measured.

17.6.3 Ring method

The measurements shall be made with a micrometer having either one flat nose and one ball nose, or one flat nose and a flat rectangular nose 0,8 mm wide and 2,4 mm long. The ball nose or the flat rectangular nose shall be applied to the inside of the ring. The accuracy of the micrometer shall be $\pm 0,01$ mm.

The measurements shall be made on a ring of the sheath carefully cut from the sample. The thickness shall be determined at a sufficient number of points around the circumference of the ring to ensure that the minimum thickness is measured.

17.7 Measurement of armour wires, ~~and~~ tapes and armour strips

17.7.1 Measurement on wires

The diameter of round wires and the thickness of flat wires shall be measured by means of a micrometer having two flat noses to an accuracy of $\pm 0,01$ mm. For round wires, two measurements shall be made at right angles to each other at the same position and the average of the two values taken as the diameter.

17.7.2 Measurement on tapes and armour strips

The measurement shall be made with a micrometer having two flat noses of approximately 5 mm in diameter ~~to an accuracy of $\pm 0,01$ mm~~ for measuring tapes, or having two ball noses of maximum 2 mm in diameter for measuring armour strips. The accuracy of the micrometer shall be $\pm 0,01$ mm.

For tapes up to 40 mm in width the thickness shall be measured at the centre of the width. For wider tapes the measurements shall be made 20 mm from each edge of the tape and the average of the results taken as the thickness.

For armour strips the thickness shall be measured in a position that allows a measurement without disturbance by the shape of the formed strip.

17.7.3 Requirements

The dimensions of armour wires, ~~and~~ tapes and armour strips shall not fall below the nominal values given in 13.5 by more than:

- 5 % for round wires;
- 8 % for flat wires;
- 10 % for tapes;
- 5 % for armour strips.

17.8 Measurement of external diameter

If the measurement of the external diameter of the cable is required as a sample test, it shall be carried out in accordance with IEC 60811-203.

17.9 Voltage test for 4 h

This test is applicable only to cables of rated voltage above 3,6/6 (7,2) kV.

17.9.1 Sampling

The sample shall be a piece of completed cable at least 5 m in length between the test terminations.

17.9.2 Procedure

A power frequency voltage shall be applied for 4 h at ambient temperature between each conductor and the metal layer(s).

17.9.3 Test voltages

The test voltage shall be $4 U_0$. Values of the test voltage for the standard rated voltages are given in Table 13.

Table 13 – Sample test voltages

Rated voltage U_0	kV	6	8,7	12	18
Test voltage	kV	24	35	48	72

The test voltage shall be increased gradually to the specified value and maintained for 4 h.

17.9.4 Requirements

No breakdown of the insulation shall occur.

17.10 Hot set test for EPR, HEPR and XLPE insulations and elastomeric sheaths

17.10.1 Procedure

The sampling and test procedure shall be carried out in accordance with IEC 60811-507, employing the conditions given in Tables 19 and 23.

17.10.2 Requirements

The test results shall comply with the requirements given in Table 19, for EPR, HEPR and XLPE insulations and in Table 23 for SE₁ sheaths.

17.11 Bending test on interlock armour cable followed by examination

The interlocked metal tape armour cable, with the oversheath removed, shall be bent at a 180° turn around a mandrel having a diameter not more than 10 times the diameter over the armour. The examination shall not reveal any opening at any point of the interlocking armour nor mechanical damages caused by the armour on the underlying cable layer (assembly of cores, bedding, or separation sheath).

18 Type tests, electrical

18.1 General

When type tests have been successfully performed on a type of cable covered by this standard with a specific conductor cross-sectional area and rated voltage, type approval shall be accepted as valid for cables of the same type with other conductor cross-sectional areas and/or rated voltages, provided the following three conditions are all satisfied:

- a) the same materials, i.e. insulation and semi-conducting screens, and manufacturing process are used;
- b) the conductor cross-sectional area is not larger than that of the tested cable, with the exception that all cross-sectional areas up to and including 630 mm² are approved when the cross-sectional area of the previously tested cable is in the range of 95 mm² to 630 mm² inclusive;
- c) the rated voltage is not higher than that of the tested cable.

Approval shall be independent of the conductor material.

18.2 Cables having conductor screens and insulation screens

18.2.1 General

A sample of completed cable 10 m to 15 m in length shall be subjected to the tests listed in 18.2.2.

With the exception of the provisions of 18.2.3 all the tests listed in 18.2.2 shall be applied successively to the same sample.

In three-core cables, each test or measurement shall be carried out on all cores.

Measurement of resistivity of semi-conducting screens described in 18.2.10 shall be made on a separate sample.

18.2.2 Sequence of tests

The normal sequence of tests shall be as follows:

- a) bending test, followed by a partial discharge test (see 18.2.4 and 18.2.5);
- b) $\tan \delta$ measurement (see 18.2.3 and 18.2.6);
- c) heating cycle test, followed by a partial discharge test (see 18.2.7);
- d) impulse test, followed by a voltage test (see 18.2.8);
- e) voltage test for 4 h (see 18.2.9).

18.2.3 Special provisions

Measurement of $\tan \delta$ may be carried out on a different sample from the sample used for the normal sequence of tests listed in 18.2.2.

Measurement of $\tan \delta$ is not required on cables with rated voltage below 6/10 (12) kV.

A new sample may be taken for test e), provided this test sample is submitted previously to tests a) and c) listed in 18.2.2.

18.2.4 Bending test

The sample shall be bent around a test cylinder (for example, the hub of a drum) at ambient temperature for at least one complete turn. It shall then be unwound and the process repeated, except that the bending of the sample shall be in the reverse direction without axial rotation.

This cycle of operation shall be carried out three times.

The diameter of the test cylinder shall not be greater than

- for cables with a lead sheath or with an overlapped metal foil longitudinally applied:
 - $25 (d + D) + 5 \%$ for single-core cables;
 - $20 (d + D) + 5 \%$ for three-core cables;
- for other cables:
 - $20 (d + D) + 5 \%$ for single-core cables;
 - $15 (d + D) + 5 \%$ for three-core cables.

where

D is the actual external diameter of the cable sample, in millimetres, measured according to 17.8;

d is the actual diameter of the conductor, in millimetres.

If the conductor is not circular:

$$d = 1,13\sqrt{S}$$

where S is the nominal cross-section, in square millimetres.

After bending sequences are completed, a visual examination of the cable oversheath shall not show cracks, or plastic deformation of oversheath in such a way that the thickness of the oversheath at the stretched point goes below the minimum value $t_{\min}$ allowed.

On completion of this test, the sample shall be subjected to a partial discharge test and shall comply with the requirements given in 18.2.5.

18.2.5 Partial discharge test

The partial discharge test shall be carried out in accordance with IEC 60885-3, the sensitivity being 5 pC or better.

The test voltage shall be raised gradually to and held at $2 U_0$ for 10 s and then slowly reduced to $1,73 U_0$.

There shall be no detectable discharge exceeding the declared sensitivity from the test object at $1,73 U_0$.

NOTE Any partial discharge from the test object may be harmful.

18.2.6 Tan δ measurement for cables of rated voltage 6/10 (12) kV and above

The sample of completed cable shall be heated by one of the following methods: the sample shall be placed either in a tank of liquid or in an oven, or a heating current shall be passed through either the metal screen or the conductor or both.

The sample shall be heated until the conductor reaches a temperature which shall be 5 K to 10 K above the maximum conductor temperature in normal operation.

In each method, the temperature of the conductor shall be determined either by measuring the conductor resistance or by a suitable temperature measuring device in the bath or oven or on the surface of the screen or on an identically heated reference cable.

The tan δ shall be measured with an alternating voltage of at least 2 kV at the temperature specified above.

The measured values shall not be higher than those given in Table 15.

18.2.7 Heating cycle test

The sample, which has been subjected to the previous tests, shall be laid out on the floor of the test room and heated by passing a current through the conductor, until the conductor reaches a steady temperature 5 K to 10 K above the maximum conductor temperature in normal operation.

For three-core cables, the heating current shall be passed through all conductors.

The heating cycle shall be of at least 8 h duration. The conductor temperature shall be maintained within the stated temperature limits for at least 2 h of each heating period. This shall be followed by at least 3 h of natural cooling in air to a conductor temperature within 10 K of ambient temperature.

This cycle shall be carried out 20 times.

After the last cycle, the sample shall be subjected to a partial discharge test and shall comply with the requirements given in 18.2.5.

18.2.8 Impulse test followed by a voltage test

This test shall be performed on the sample at a conductor temperature 5 K to 10 K above the maximum conductor temperature in normal operation.

The impulse voltage shall be applied according to the procedure given in IEC 60230 and shall have a peak value as given in Table 14.

Table 14 – Impulse voltages

Rated voltage U_0/U (U_m)	kV	3,6/6 (7,2)	6/10 (12)	8,7/15 (17,5)	12/20 (24)	18/30 (36)
Test voltage (peak)	kV	60	75	95	125	170

Each core of the cable shall withstand without failure 10 positive and 10 negative voltage impulses.

After the impulse test, each core of the cable sample shall be subjected, at ambient temperature, to a power frequency voltage test for 15 min. The test voltage shall be as specified in Table 11. No breakdown of the insulation shall occur.

18.2.9 Voltage test for 4 h

This test shall be made at ambient temperature. A power frequency voltage shall be applied for 4 h to the sample between conductor(s) and screen(s).

The test voltage shall be $4 U_0$. The voltage shall be increased gradually to the specified value. No breakdown of the insulation shall occur.

18.2.10 Resistivity of semi-conducting screens

18.2.10.1 General

The resistivity of the extruded semi-conducting screens applied over the conductor and over the insulation shall be determined by measurements on test pieces taken from the core of a sample of cable as made and a sample of cable, which has been subjected to the ageing treatment to test the compatibility of component materials specified in 19.7.

18.2.10.2 Procedure

The test procedure shall be in accordance with Annex D.

The measurements shall be made at a temperature within ± 2 K of the maximum conductor temperature in normal operation.

18.2.10.3 Requirements

The resistivity, both before and after ageing, shall not exceed the following:

- conductor screen: $1\,000\ \Omega \times \text{m}$,
- insulation screen: $500\ \Omega \times \text{m}$.

18.3 Cables of rated voltage 3,6/6 (7,2) kV having unscreened insulation**18.3.1 General**

Each core of a sample of completed cable 10 m to 15 m in length shall be subjected to the following tests, applied successively:

- a) insulation resistance measurement at ambient temperature (see 18.3.2);
- b) insulation resistance measurement at maximum conductor temperature in normal operation (see 18.3.3);
- c) voltage test for 4 h (see 18.3.4).

The cables shall also be subjected to an impulse test on a separate sample of completed cable, 10 m to 15 m in length (see 18.3.5).

18.3.2 Insulation resistance measurement at ambient temperature**18.3.2.1 Procedure**

This test shall be made on the sample length before any other electrical test.

All outer coverings shall be removed and the cores shall be immersed in water at ambient temperature for at least 1 h before the test.

The d.c. test voltage shall be 80 V to 500 V and shall be applied for a sufficient time to reach reasonably steady measurement, but for not less than 1 min and not more than 5 min.

The measurement shall be made between each conductor and the water.

If requested, measurement may be confirmed at a temperature of $(20 \pm 1) ^\circ\text{C}$.

18.3.2.2 Calculations

The volume resistivity shall be calculated from the measured insulation resistance by the following formula:

$$\rho = \frac{2 \times \pi \times l \times R}{\ln \frac{D}{d}}$$

where

- ρ is the volume resistivity, in ohms $\times$ centimetres;
- R is the measured insulation resistance, in ohms;
- l is the length of the cable, in centimetres;
- D is the outer diameter of the insulation, in millimetres;
- d is the inner diameter of the insulation, in millimetres.

The "insulation resistance constant K_i " expressed in megohms $\times$ kilometres may also be calculated, using the formula:

$$K_i = \frac{l \times R \times 10^{-11}}{\lg \frac{D}{d}} = 10^{-11} \times 0,367 \times \rho$$

NOTE For the cores of shaped conductors, the ratio D/d is the ratio of the perimeter over the insulation to the perimeter over the conductor.

18.3.2.3 Requirements

The values calculated from the measurements shall be not less than those specified in Table 15.

18.3.3 Insulation resistance measurement at maximum conductor temperature

18.3.3.1 Procedure

The cores of the cable sample shall be immersed in water at a temperature within ± 2 K of the maximum conductor temperature in normal operation for at least 1 h before the test.

The d.c. test voltage shall be 80 V to 500 V and shall be applied for a sufficient time to reach reasonably steady measurement, but for not less than 1 min and not more than 5 min.

The measurement shall be made between each conductor and the water.

18.3.3.2 Calculations

The volume resistivity and/or the insulation resistance constant shall be calculated from the insulation resistance by the formulae given in 18.3.2.2.

18.3.3.3 Requirements

The values calculated from the measurements shall be not less than those specified in Table 15.

18.3.4 Voltage test for 4 h

18.3.4.1 Procedure

The cores of the cable sample shall be immersed in water at ambient temperature for at least 1 h.

A power frequency voltage equal to $4 U_0$ shall then be gradually applied and maintained continuously for 4 h between each conductor and the water.

18.3.4.2 Requirements

No breakdown of the insulation shall occur.

18.3.5 Impulse test

18.3.5.1 Procedure

This test shall be performed on the sample at a conductor temperature 5 K to 10 K above the maximum conductor temperature in normal operation.

The impulse voltage shall be applied according to the procedure given in IEC 60230 and shall have a peak value of 60 kV.

Each series of impulses shall be applied in turn between each phase conductor and all the other conductors connected together and to earth.

18.3.5.2 Requirements

Each core of the cable shall withstand without failure 10 positive and 10 negative voltage impulses.

19 Type tests, non-electrical

19.1 General

The non-electrical type tests required by this standard are given in Table 16.

19.2 Measurement of thickness of insulation

19.2.1 Sampling

One sample shall be taken from each insulated cable core.

19.2.2 Procedure

The measurements shall be made as described in IEC 60811-201.

19.2.3 Requirements

See 17.5.2.

19.3 Measurement of thickness of non-metal sheaths (including extruded separation sheaths, but excluding inner coverings)

19.3.1 Sampling

One sample of cable shall be taken.

19.3.2 Procedure

The measurements shall be made as described in IEC 60811-202.

19.3.3 Requirements

See 17.5.3.

19.4 Measurement of thickness of lead sheath

19.4.1 Sampling

One sample of cable shall be taken.

19.4.2 Procedure

The measurements shall be made as described in 17.6.2 or 17.6.3.

19.4.3 Requirements

See 17.6.1.

19.5 Tests for determining the mechanical properties of insulation before and after ageing

19.5.1 Sampling

Sampling and the preparation of the test pieces shall be carried out as described in IEC 60811-501.

19.5.2 Ageing treatments

The ageing treatments shall be carried out as described in IEC 60811-401 under the conditions specified in Table 17.

19.5.3 Conditioning and mechanical tests

Conditioning and the measurement of mechanical properties shall be carried out as described in IEC 60811-501.

19.5.4 Requirements

The test results for unaged and aged test pieces shall comply with the requirements given in Table 17.

19.6 Tests for determining the mechanical properties of non-metal sheaths before and after ageing

19.6.1 Sampling

Sampling and the preparation of the test pieces shall be carried out as described in IEC 60811-501.

19.6.2 Ageing treatments

The ageing treatments shall be carried out as described in IEC 60811-401, under the conditions specified in Table 20.

19.6.3 Conditioning and mechanical tests

Conditioning and the measurement of mechanical properties shall be carried out as described in IEC 60811-501.

19.6.4 Requirements

The test results for unaged and aged test pieces shall comply with the requirements given in Table 20.

19.7 Additional ageing test on pieces of completed cables

19.7.1 General

This test is intended to check that the insulation and non-metal sheaths are not liable to deteriorate in operation due to contact with other components in the cable.

The test is applicable to cables of all types.

19.7.2 Sampling

Samples shall be taken from the completed cable as described in IEC 60811-401.

19.7.3 Ageing treatment

The ageing treatment of the pieces of cable shall be carried out in an air oven, as described in IEC 60811-401, under the following conditions:

- temperature: (10 ± 2) K above the maximum conductor temperature of the cable in normal operation (see Table 17);
- duration: 7×24 h.

19.7.4 Mechanical tests

Test pieces of insulation and oversheath from the aged pieces of cable shall be prepared and subjected to mechanical tests as described in IEC 60811-401.

19.7.5 Requirements

The variations between the median values of tensile strength and elongation-at-break after ageing and the corresponding values obtained without ageing (see 19.5 and 19.6), if applicable, shall not exceed the values applying to the test after ageing in an air oven specified in Table 17 for insulations and Table 20 for non-metal sheaths.

19.8 Loss of mass test on PVC sheaths of type ST₂

19.8.1 Procedure

The sampling and test procedure shall be in accordance with IEC 60811-409.

19.8.2 Requirements

The test results shall comply with the requirements given in Table 21.

19.9 Pressure test at high temperature on insulations and non-metal sheaths

19.9.1 Procedure

The pressure test at high temperature shall be carried out in accordance with IEC 60811-508, employing the test conditions given in the test method and in Table 18, Table 21, Table 22 and Table 25.

19.9.2 Requirements

The test results shall comply with the requirements given IEC 60811-508.

19.10 Test on PVC insulation, ~~and~~ PVC sheaths and halogen free sheaths at low temperatures

19.10.1 Procedure

The sampling and test procedures shall be in accordance with IEC 60811-504, IEC 60811-505 and IEC 60811-506, employing the test temperature specified in Table 18, Table 21 and Table 25.

19.10.2 Requirements

The results of the test shall comply with the requirements given in IEC 60811-504, IEC 60811-505 and IEC 60811-506.

19.11 Test for resistance of PVC insulation and sheaths to cracking (heat shock test)

19.11.1 Procedure

The sampling and test procedure shall be in accordance with IEC 60811-509, the test temperature and duration being in accordance with Tables 18 and 21.

19.11.2 Requirements

The results of the tests shall comply with the requirements given in IEC 60811-509.

19.12 Ozone resistance test for EPR and HEPR insulations

19.12.1 Procedure

The sampling and test procedure shall be carried out in accordance with IEC 60811-403. The ozone concentration and test duration shall be in accordance with Table 19.

19.12.2 Requirements

The results of the test shall comply with the requirements given in IEC 60811-403.

19.13 Hot set test for EPR, HEPR and XLPE insulations and elastomeric sheaths

The sampling and test procedure shall be carried out in accordance with 17.10 and shall comply with its requirements.

19.14 Oil immersion test for elastomeric sheaths

19.14.1 Procedure

The sampling and test procedure shall be carried out in accordance with IEC 60811-404 employing the conditions given in Table 23.

19.14.2 Requirements

The results of the test shall comply with the requirements given in Table 23.

19.15 Water absorption test on insulation

19.15.1 Procedure

The sampling and test procedure shall be carried out in accordance with IEC 60811-402 employing the conditions specified in Tables 18 or 19 respectively.

19.15.2 Requirements

The results of the test shall comply with the requirements specified in Tables 18 or 19.

~~19.16 Flame spread test on single cables~~

~~This test is only applicable to cables having sheaths of ST₁, ST₂ or SE₁ compound and shall be carried out on such cables only when specially required.~~

~~The test method and requirements shall be those specified in IEC 60332-1-2.~~

19.16 Test under fire conditions

19.16.1 General

The test in 19.16.2 shall be carried out on ST₁, ST₂ or SE₁ oversheathed cables, as specified in the relevant subclause.

The tests in 19.16.3 to 19.16.8 shall be carried out on ST₈ or ST₁₂ oversheathed cables, as specified in each relevant subclause.

19.16.2 Flame spread test for single cables

This test shall be carried out on ST₁, ST₂ or SE₁ oversheathed cables only when such a fire performance is specially required or declared.

The test method and requirements shall be those specified in IEC 60332-1-2.

19.16.3 Flame spread test for bunched cables

This test shall be carried out on ST₈ or ST₁₂ oversheathed halogen free cables.

The test method and requirements shall be those specified in IEC 60332-3-24.

NOTE Higher performance to meet the requirements of IEC 60332-3-22 or IEC 60332-3-23 can be agreed between the manufacturer and customer.

19.16.4 Measurement of smoke density of cables burning under defined conditions

This test shall be carried out on ST₈ or ST₁₂ oversheathed halogen free cables.

The test method and requirements shall be those specified in IEC 61034-2. The results shall comply with the requirements given in Table 25.

19.16.5 Determination of acidity (by pH measurement) and conductivity of gases evolved during combustion of the non-metallic materials in the cable

This test shall be carried out on the non-metallic components of ST₈ or ST₁₂ oversheathed halogen free cables.

The test specified in IEC 60754-2 shall be carried out on the non-metallic components of the cable. It is not necessary to test non-metallic components if their mass is less than or equal to 1 % of the total non-metallic mass.

The weighted values of pH and conductivity of the non-metallic components of the cable shall be calculated according to IEC 60754-2 and shall comply with the requirements given in Table 25.

19.16.6 Fire performance tests on halogen free oversheath material ST₈

19.16.6.1 Acid gas emission test

19.16.6.1.1 General

This test shall be carried out on the non-metallic components of ST₈ oversheathed halogen free cables.

19.16.6.1.2 Procedure

The test method shall be that specified in IEC 60754-1.

19.16.6.1.3 Requirements

The results of the test shall comply with the requirements of Table 25.

19.16.6.2 Fluorine content test

19.16.6.2.1 General

This test shall be carried out on the non-metallic components of ST₈ oversheathed halogen free cables.

19.16.6.2.2 Procedure

The test method shall be that specified in IEC 60684-2.

19.16.6.2.3 Requirements

The results of the test shall comply with the requirements of Table 25.

19.16.7 Fire performance tests on halogen free oversheath material ST₁₂

19.16.7.1 Determination of acidity (by pH measurement) and conductivity of gases evolved during combustion of oversheath

The test specified in IEC 60754-2 shall be carried out on the oversheath of the cable.

The results shall comply with the requirements given in Table 25.

19.16.7.2 Measurement of halogen content of gases evolved during combustion of the oversheath

The value for the oversheath, H_i , of the individual halogen content for each of the four halogens F, Cl, Br, and I, shall be determined by carrying out the test in accordance with IEC 60754-3.

The values for each of four individual halogens, H_i , and the sum of the values for the oversheath for the four halogens, i.e. ΣH_i , shall comply with the requirements given in Table 25.

19.16.8 Measurement of halogen content of gases evolved during combustion of the non-metallic materials in the cable

This test shall be carried out on the non-metallic components of ST₁₂ oversheathed halogen free cables.

The weighted value for the cable, H'_i , for the four halogens F, Cl, Br, and I, shall be determined by carrying out the test in accordance with IEC 60754-3 either:

- individually on each non-metallic component of the cable, and calculating the weighted value for the cable, for each halogen, as described in Annex I,
- or on a sample representative of the cable construction prepared as described in Annex I, in which case the result for each halogen shall be taken as the weighted value for the cable.

It is not necessary to test non-metallic components if their mass is less than or equal to 1 % of the total non-metallic mass.

The weighted value for the cable, H'_i , for each of the four individual halogens and the sum of the weighted values for the non-metallic components of the cable for the four halogens, i.e. $\Sigma H'_i$, shall comply with the requirements given in Table 25.

19.17 Measurement of carbon black content of black PE oversheaths

19.17.1 Procedure

The sampling and test procedure shall be carried out in accordance with IEC 60811-605.

19.17.2 Requirements

The results of the test shall comply with the requirements of Table 22.

19.18 Shrinkage test for XLPE insulation

19.18.1 Procedure

The sampling and test procedure shall be carried out in accordance with IEC 60811-502 under the conditions specified in Table 19.

19.18.2 Requirements

The results of the test shall comply with the requirements of Table 19.

19.19 Thermal stability test for PVC insulation

19.19.1 Procedure

The sampling and test procedure shall be carried out in accordance with IEC 60811-405 under the conditions specified in Table 18.

19.19.2 Requirements

The results of the test shall comply with the requirements of Table 18.

19.20 Determination of hardness of HEPR insulation

19.20.1 Procedure

The sampling and test procedure shall be carried out in accordance with Annex E.

19.20.2 Requirements

The results of the test shall comply with the requirements of Table 19.

19.21 Determination of the elastic modulus of HEPR insulation

19.21.1 Procedure

Sampling, preparation of the test pieces and the test procedure shall be carried out in accordance with IEC 60811-501.

The loads required for 150 % elongation shall be measured. The corresponding stresses shall be calculated by dividing the loads measured by the cross-sectional areas of the unstretched test pieces. The ratios of the stresses to strains shall be determined to obtain the elastic moduli at 150 % elongation.

The elastic modulus shall be the median value.

19.21.2 Requirements

The results of the test shall comply with the requirements of Table 19.

19.22 Shrinkage test for PE and halogen free oversheaths

19.22.1 Procedure

The sampling and test procedure shall be carried out in accordance with IEC 60811-503 under the conditions specified in Table 22 and Table 25.

19.22.2 Requirements

The results of the test shall comply with the requirements of Table 22 and Table 25.

19.23 Strippability test for insulation screen

19.23.1 General

This test shall be carried out when the manufacturer claims that the extruded semiconducting insulation screen is strippable.

19.23.2 Procedure

The test shall be performed three times on both unaged and aged samples, using either three separate pieces of cable or one piece of cable at three positions around the circumference, spaced at approximately 120°.

Core lengths of at least 250 mm shall be taken from the cable to be tested, before and after being aged according to 19.7.3.

Two cuts shall be made in the extruded semiconducting insulation screen of each sample, longitudinally from end to end and radially down to the insulation, the cuts being (10 ± 1) mm apart and parallel to each other.

After removing approximately 50 mm length of the 10 mm strip by pulling it in a direction parallel to the core (i.e. a stripping angle of approximately 180°), the core shall be mounted vertically in a tensile machine with one end of the core held in one grip and the 10 mm strip in the other.

The force to separate the 10 mm strip from the insulation, removing a length of at least 100 mm, shall be measured at a stripping angle of approximately 180° using a pulling speed of (250 ± 50) mm/min.

The test shall be carried out at a temperature of (20 ± 5) °C.

For unaged and aged samples, the stripping force values shall be continuously recorded.

19.23.3 Requirements

The force required to remove the extruded semiconducting screen from the insulation shall be not less than 4 N and not more than 45 N, before and after ageing.

The insulation surface shall not be damaged and no trace of the semiconducting screen shall remain on the insulation.

19.24 Water penetration test

The water penetration test shall be applied to those designs of cable where the manufacturer claims that barriers to longitudinal water penetration have been included. The test is designed to meet the requirements for buried cables and is not intended to apply to cables which are constructed for use as submarine cables.

The test is applicable to the following cable designs:

- a) a barrier is included which prevents longitudinal water penetration in the region of the metal layers;
- b) a barrier is included which prevents longitudinal water penetration along the conductor.

The apparatus, sampling and test procedure shall be in accordance with Annex F and Annex H.

19.25 Additional tests on halogen free oversheath of type ST₈

19.25.1 General

These tests are intended to check that the halogen free oversheaths are not liable to damage during installation and operation.

19.25.2 Water absorption test for halogen free oversheath of type ST₈

19.25.2.1 Procedure

The sampling and test procedure shall be carried out in accordance with IEC 60811-402 employing the conditions and method specified in Table 25 for ST₈.

19.25.2.2 Requirements

The results of the test shall comply with the requirements of Table 25 for ST₈.

19.25.3 Abrasion test on halogen free oversheath of type ST₈

The test method and requirements are under consideration.

19.26 Bending test on interlock armour

The test and examination shall be carried out according to 17.11.

20 Electrical tests after installation

20.1 General

Tests after installation are carried out when the installation of the cable and its accessories has been completed.

A d.c. oversheath test according to 20.2 is recommended and, if required, a test on the insulation according to 20.3. For installations where only the oversheath test according to 20.2 is carried out, quality assurance procedures during installation of accessories may, by agreement between the purchaser and the contractor, replace the insulation test.

20.2 DC voltage test of the oversheath

The voltage level and duration specified in Clause 5 of IEC 60229:2007 shall be applied between each metal sheath or metal screen and the ground.

For the test to be effective, it is necessary that the ground makes good contact with all of the outer surface of the oversheath. A conductive layer on the oversheath can assist in this respect.

20.3 ~~Insulation test~~ AC voltage test of the insulation

~~20.3.1 AC testing~~

By agreement between the ~~purchaser~~ customer and the contractor, an a.c. voltage test in accordance with IEC 60060-3 and in accordance with item a), b) or c) as below may be used:

- a) test for 15 min with the phase-to-phase voltage U , at a frequency between 20 Hz to 300 Hz shall be applied between the conductor and the metal screen/sheath;
- b) test for 24 h with the normal rated voltage U_0 of the system;

- c) test for 15 min with the RMS rated voltage value of $3 U_0$ at a frequency of 0,1 Hz applied between the conductor and the metal screen/sheath.

NOTE 1 During the a.c. test, $\tan \delta$ and/or partial discharge ~~may~~ can be monitored.

NOTE 2 For installations which have been in use, lower voltages and/or shorter durations ~~may~~ can be used. Values ~~should~~ can be negotiated, taking into account the age, environment, history of breakdowns and the purpose of carrying out the test.

NOTE 3 A differentiation in test voltage levels for sinusoidal and cosine-rectangular VLF voltages is under consideration.

~~20.3.2 DC testing~~

~~As an alternative to the a.c. test, a d.c. test voltage equal to $4 U_0$ may be applied for 15 min.~~

~~A d.c. test may endanger the insulation system under test. Where possible an a.c. test as described above should be used.~~

~~NOTE For installations which have been in use, lower voltages and/or shorter durations may be used. Values should be negotiated, taking into account the age, environment, history of breakdowns and the purpose of carrying out the test.~~

Table 15 – Electrical type test requirements for insulating compounds

Designation of compounds (see 4.2)		PVC/B	EPR/ HEPR	XLPE
Maximum conductor temperature in normal operation (see 4.2)	°C	70	90	90
<i>Volume resistivity ρ *</i>				
– at 20 °C (see 18.3.2)	$\Omega \times \text{cm}$	10^{14}	–	–
– at maximum conductor temperature in normal operation (see 18.3.3)	$\Omega \times \text{cm}$	10^{11}	10^{12}	–
<i>Insulation resistance constant K_i *</i>				
– at 20 °C (see 18.3.2)	$\text{M}\Omega \times \text{km}$	367	–	–
– at maximum conductor temperature in normal operation (see 18.3.3)	$\text{M}\Omega \times \text{km}$	0,37	3,67	–
Tan δ (see 18.2.6)				
– tan δ at maximum conductor temperature in normal operation plus 5 K up to 10 K, maximum	$\times 10^{-4}$	–	400	40
* For unscreened cables according to items a) and b) of Clause 7, rated voltage 3,6/6 (7,2) kV for PVC, EPR and HEPR insulation.				

Table 16 – Non-electrical type tests
(see Table 17 to Table 23 and Table 25)

[illegible]

NOTE x indicates that the type test is ~~to be~~ applied.

* For black oversheaths only.

** To be applied to those designs of cable where the manufacturer claims that the insulation screen is strippable.

*** To be applied to those designs of cable where the manufacturer claims that barriers to longitudinal water penetration have been included.

**Table 17 – Test requirements for mechanical characteristics of insulating compounds
(before and after ageing)**

Designation of compounds (see 4.2)		PVC/B	EPR	HEPR	XLPE
Maximum conductor temperature in normal operation (see 4.2)	°C	70	90	90	90
<i>Without ageing</i> (IEC 60811-501)					
Tensile strength, minimum	N/mm ²	12,5	4,2	8,5	12,5
Elongation-at-break, minimum	%	125	200	200	200
<i>After ageing in air oven</i> (IEC 60811-401)					
After ageing without conductor					
Treatment:					
– temperature	°C	100	135	135	135
– tolerance	K	±2	±3	±3	±3
– duration	h	168	168	168	168
Tensile strength:					
a) value after ageing, minimum	N/mm ²	12,5	–	–	–
b) variation*, maximum	%	±25	±30	±30	±25
Elongation-at-break:					
a) value after ageing, minimum	%	125	–	–	–
b) variation*, maximum	%	±25	±30	±30	±25
* Variation: difference between the median value obtained after ageing and the median value obtained without ageing expressed as a percentage of the latter.					

**Table 18 – Test requirements for particular characteristics
for PVC insulating compound**

Designation of compound (see 4.2 and 4.3)		PVC/B
Use of the PVC compound		Insulation
<i>Pressure test at high temperature</i> (IEC 60811-508) Temperature (tolerance ± 2 K)	$^{\circ}\text{C}$	80
<i>Behaviour at low temperature</i> * (IEC 60811-504, IEC 60811-505 and IEC 60811-506) Test to be carried out without previous ageing: – cold bending test for diameter $< 12,5$ mm – temperature (tolerance ± 2 K) Cold elongation test on dumb-bells: – temperature (tolerance ± 2 K)	$^{\circ}\text{C}$ $^{\circ}\text{C}$	–5 –5
<i>Heat shock test</i> (IEC 60811-509) Temperature (tolerance ± 3 K) Duration	$^{\circ}\text{C}$ h	150 1
<i>Thermal stability</i> (IEC 60811-405) Temperature (tolerance $\pm 0,5$ K) Minimum time	$^{\circ}\text{C}$ min	200 100
<i>Water absorption</i> (IEC 60811-402) Electrical method: Temperature (tolerance ± 2 K) Duration	$^{\circ}\text{C}$ h	70 240
* Due to climatic conditions, national standards may require the use of a lower temperature.		

Table 19 – Test requirements for particular characteristics of various crosslinked insulating compounds

Designation of compounds (see 4.2)		EPR	HEPR	XLPE
<i>Ozone resistance</i> (IEC 60811-403)				
Ozone concentration (by volume)	%	0,025 to 0,030	0,025 to 0,030	–
Test duration without cracks	h	24	24	–
<i>Hot set test</i> (IEC 60811-507)				
Treatment:				
– air temperature (tolerance ± 3 K)	°C	250	250	200
– time under load	min	15	15	15
– mechanical stress	N/cm ²	20	20	20
Maximum elongation under load	%	175	175	175
Maximum permanent elongation after cooling	%	15	15	15
<i>Water absorption</i> (IEC 60811-402)				
Gravimetric method:				
Temperature (tolerance ± 2 K)	°C	85	85	85
Duration	h	336	336	336
Maximum increase of mass	mg/cm ²	5	5	1 *
<i>Shrinkage test</i> (IEC 60811-502)				
Distance <i>L</i> between marks	mm	–	–	200
Temperature (tolerance ± 3 K)	°C	–	–	130
Duration	h	–	–	1
Maximum shrinkage	%	–	–	4
<i>Determination of hardness</i> (see Annex E)				
IRHD **, minimum		–	80	–
<i>Determination of elastic modulus</i> (see 19.21)				
Modulus at 150 % elongation, minimum	N/mm ²	–	4,5	–
* An increase greater than 1 mg/cm ² is being considered for densities of XLPE greater than 1 g/cm ³ .				
** IRHD: international rubber hardness degree.				

**Table 20 – Test requirements for mechanical characteristics of sheathing compounds
(before and after ageing)**

Designation of compounds (see 4.3)		ST ₁	ST ₂	ST ₃	ST ₇	ST ₈	ST ₁₂	SE ₁
Maximum conductor temperature in normal operation (see 4.3)	°C	80	90	80	90	90	90	85
<i>Without ageing</i> (IEC 60811-501)								
Tensile strength, minimum	N/mm ²	12,5	12,5	10,0	12,5	9,0	12,5	10,0
Elongation-at-break, minimum	%	150	150	300	300	125	300	300
<i>After ageing in air oven</i> (IEC 60811-401)								
Treatment:								
– temperature (tolerance ±2 K)	°C	100	100	100	110	100	110	100
– duration	h	168	168	240	240	168	240	168
Tensile strength:								
a) value after ageing, minimum	N/mm ²	12,5	12,5	–	–	9,0	10	–
b) variation *, maximum	%	±25	±25	–	–	±40	±30	±30
Elongation-at-break:								
a) value after ageing, minimum	%	150	150	300	300	100	300	250
b) variation *, maximum	%	±25	±25	–	–	±40	–	±40
* Variation: difference between the median value obtained after ageing and the median value obtained without ageing expressed as a percentage of the latter.								

Table 21 – Test requirements for particular characteristics for PVC sheathing compounds

Designation of compound (see 4.2 and 4.3)		ST ₁	ST ₂
Use of the PVC compound		Sheath	
<i>Loss of mass in air oven</i> (IEC 60811-409)			
Treatment:			
– temperature (tolerance ±2 K)	°C	–	100
– duration	h	–	168
Maximum loss of mass	mg/cm ²	–	1,5
<i>Pressure test at high temperature</i> (IEC 60811-508)			
Temperature (tolerance ±2 K)	°C	80	90
<i>Behaviour at low temperature</i> * (IEC 60811-504, IEC 60811-505 and IEC 60811-506)			
Test to be carried out without previous ageing:			
– cold bending test for diameter <12,5 mm			
– temperature (tolerance ±2 K)	°C	–15	–15
Cold elongation test on dumb-bells:			
– temperature (tolerance ±2 K)	°C	–15	–15
Cold impact test:			
– temperature (tolerance ±2 K)	°C	–15	–15
<i>Heat shock test</i> (IEC 60811-509)			
Temperature (tolerance ±3 K)	°C	150	150
Duration	h	1	1
* Due to climatic conditions, national standards may require the use of a lower temperature.			

Table 22 – Test requirements for particular characteristics of PE (thermoplastic polyethylene) sheathing compounds

Designation of compounds (see 4.3)		ST ₃	ST ₇
Density * (IEC 60811-606)			
Carbon black content (for black oversheaths only) (IEC 60811-605)			
Nominal value	%	2,5	2,5
Tolerance	%	±0,5	±0,5
Shrinkage test (IEC 60811-503)			
Temperature (tolerance ±2 K)	°C	80	80
Heating, duration	h	5	5
Heating cycles		5	5
Maximum shrinkage	%	3	3
Pressure test at high temperature (IEC 60811-508)			
Temperature (tolerance ±2 K)	°C	–	110

* The measurement of density is only required for the purpose of other tests.

Table 23 – Test requirements for particular characteristics of elastomeric sheathing compound

Designation of compound (see 4.3)		SE ₁
Oil immersion test followed by a determination of the mechanical properties (IEC 60811-404 and IEC 60811-501)		
Treatment:		
– oil temperature (tolerance ±2 K)	°C	100
– duration	h	24
Maximum variation * of:		
a) tensile strength	%	±40
b) elongation-at-break	%	±40
Hot set test (IEC 60811-507)		
Treatment:		
– temperature (tolerance ±3 K)	°C	200
– time under load	min	15
– mechanical stress	N/cm ²	20
Maximum elongation under load	%	175
Maximum permanent elongation after cooling	%	15

* Variation: difference between the median value obtained after treatment and the median value without treatment, expressed as a percentage of the latter.

**Table 25 – Test requirements for particular characteristics
of halogen free sheathing compounds**

Designation of compound (see 4.3)	Unit	ST ₈	ST ₁₂
<i>Behaviour at low temperature *</i> Tests to be carried out without previous ageing: a) Cold elongation test on dumb-bells (IEC 60811-505) Test temperature (tolerance ±2 K) Requirement b) Cold impact test (IEC 60811-506) Test temperature (tolerance ±2 K) Requirement	 °C % °C –	 –15 ≥ 20 –15 no cracks	 –15 ≥ 20 –15 no cracks
<i>Pressure test at high temperature</i> (IEC 60811-508) Test temperature (tolerance ±2 K) Maximum indentation	°C %	80 50	110 50
<i>Shrinkage test</i> (IEC 60811-503) Test temperature (tolerance ±2 K) Duration Number of heating cycles Maximum shrinkage allowed	°C h % %	– – – –	80 5 5 3,0
<i>Water absorption test</i> (IEC 60811-402) Gravimetric method: Treatment: – temperature (tolerance ±2 K) – duration Maximum increase of mass	 °C h mg/cm ²	 70 24 10	 – – –
<i>Flame spread test on bunched cables (complete cable)</i> (IEC 60332-3-24) Upper limit of char above bottom edge of burner	m	≤ 2,5	≤ 2,5
<i>Smoke density test on cables (complete cables)</i> (IEC 61034-2) – light transmittance T min	%	60	60
<i>Acid gas emission test</i> (IEC 60754-1) – Bromine and chlorine content (expressed as HCl), maximum	%	0,5	–
<i>Fluorine content test</i> (IEC 60684-2) – Fluorine content, maximum	%	0,1	–
<i>pH value and conductivity tests, for the oversheath or as weighted values for the cable</i> (IEC 60754-2) – pH – conductivity	– µS/mm	≥ 4,3 ≤ 10	≥ 4,3 ≤ 10
<i>Measurement of halogen content of gases evolved during combustion of the oversheath</i> (19.16.7.2) (IEC 60754-3) – Value for each of the 4 individual halogens (F, Cl, Br, I) H_i – Sum of values for the 4 individual halogens	mg/g	–	≤ 2

Designation of compound (see 4.3)	Unit	ST ₈	ST ₁₂
(F, Cl, Br, I) ΣH_i	mg/g	–	≤ 5
<i>Measurement of halogen content of gases evolved during combustion of the non-metallic materials in the cable (19.16.8)</i>			
(IEC 60754-3)			
– Value for each of the 4 individual halogens (F, Cl, Br, I) H'_i	mg/g	–	≤ 2
– Sum of values for the 4 individual halogens (F, Cl, Br, I) $\Sigma H'_i$	mg/g	–	≤ 5
* Because of climatic conditions, national standards can require the use of a lower or higher test temperature.			

Annex A

(normative)

Fictitious calculation method for determination of dimensions of protective coverings

A.1 General

The thickness of cable coverings, such as sheaths and armour, has usually been related to nominal cable diameters by means of "step-tables".

This sometimes causes problems. The calculated nominal diameters are not necessarily the same as the actual values achieved in production. In borderline cases, queries can arise if the thickness of a covering does not correspond to the actual diameter because the calculated diameter is slightly different. Variations in shaped conductor dimensions between manufacturers and different methods of calculation cause differences in nominal diameters and may therefore lead to variations in the thicknesses of coverings used on the same basic design of cable.

To avoid these difficulties, the fictitious calculation method shall be used. The idea is to ignore the shape and degree of compaction of conductors and to calculate fictitious diameters from formulae based on the cross-sectional area of conductors, nominal insulation thickness and number of cores. Thicknesses of sheath and other coverings are then related to the fictitious diameters by formulae or by tables. The method of calculating fictitious diameters is precisely specified and there is no ambiguity about the thicknesses of coverings to be used, which are independent of slight differences in manufacturing practices. This standardizes cable designs, thicknesses being pre-calculated and specified for each conductor cross-section.

The fictitious calculation is used only to determine dimensions of sheaths and cable coverings. It is not a replacement for the calculation of actual diameters required for practical purposes, which should be calculated separately.

The following fictitious method of calculating thicknesses of various coverings in a cable has been adopted to ensure that any differences which can arise in independent calculations, for example due to the assumption of conductor dimensions and the unavoidable differences between nominal and actually achieved diameters, are eliminated.

All thickness values and diameters shall be rounded according to the rules in Annex C to the first decimal figure.

Holding strips, for example counter helix over armour, if not thicker than 0,3 mm, are neglected in this calculation method.

A.2 Method

A.2.1 Conductors

The fictitious diameter (d_L) of a conductor, irrespective of shape and compactness, is given for each nominal cross-section in Table A.1.

Table A.1 – Fictitious diameter of conductor

Nominal cross-section of conductor mm ²	d_L mm	Nominal cross-section of conductor mm ²	d_L mm
10	3,6	240	17,5
16	4,5	300	19,5
25	5,6	400	22,6
35	6,7	500	25,2
50	8,0	630	28,3
70	9,4	800	31,9
95	11,0	1 000	35,7
120	12,4	1 200	39,1
150	13,8	1 400	42,2
185	15,3	1 600	45,1

A.2.2 Cores

The fictitious diameter D_c of any core is given by:

a) for cables having cores without semi-conducting layers:

$$D_c = d_L + 2 t_i$$

b) for cables having cores with semi-conducting layers:

$$D_c = d_L + 2 t_i + 3,0$$

where t_i is the nominal thickness of insulation, in millimetres (see Tables 5 to 7).

If a metal screen or a concentric conductor is applied, a further addition shall be made in accordance with A.2.5.

A.2.3 Diameter over laid-up cores

The fictitious diameter over laid-up cores (D_f) is given by:

$$D_f = k D_c$$

where the assembly coefficient k is 2,16 for a three-core cable.

A.2.4 Inner coverings

The fictitious diameter over the inner covering (D_B) is given by:

$$D_B = D_f + 2 t_B$$

where

$t_B = 0,4$ mm for fictitious diameters over laid-up cores (D_f) up to and including 40 mm;

$t_B = 0,6$ mm for D_f exceeding 40 mm.

These fictitious values for t_B apply to

a) three-core cables:

- whether an inner covering is applied or not;
- whether the inner covering is extruded or lapped;

unless a separation sheath complying with 13.3.3 is used in place of or in addition to the inner covering, when A.2.7 applies instead (in which case $D_u = D_f$);

b) single-core cables:

- when an inner covering is applied whether it is extruded or lapped.

A.2.5 Concentric conductors and metal screens

The increase in diameter due to the concentric conductor or metal screen is given in Table A.2.

Table A.2 – Increase of diameter for concentric conductors and metal screens

Nominal cross-section of concentric conductor or metal screen mm ²	Increase in diameter mm	Nominal cross-section of concentric conductor or metal screen mm ²	Increase in diameter mm
1,5	0,5	50	1,7
2,5	0,5	70	2,0
4	0,5	95	2,4
6	0,6	120	2,7
10	0,8	150	3,0
16	1,1	185	4,0
25	1,2	240	5,0
35	1,4	300	6,0

If the cross-section of the concentric conductor or metal screen lies between two of the values given in the table above, then the increase in diameter is that given for the larger of the two cross-sections.

If a metal screen is applied, the cross-sectional area of the screen to be used in the table above shall be calculated in the following manner:

a) tape screen

$$\text{cross-sectional area} = n_t \times t_t \times w_t$$

where

n_t is the number of tapes;

t_t is the nominal thickness of an individual tape, in millimetres;

w_t is the nominal width of an individual tape, in millimetres.

Where the total thickness of the screen is less than 0,15 mm then the increase in diameter shall be zero:

- for a lapped tape screen made of either two tapes or one tape with overlap, the total thickness is twice the thickness of one tape;
- for a longitudinally applied tape screen:
 - if the overlap is below 30 %, the total thickness is the thickness of the tape;

- if the overlap is greater than or equal to 30 %, the total thickness is twice the thickness of the tape.

b) wire screen (with a counter helix, if any)

$$\text{cross-sectional area} = \frac{n_w \times d_w^2 \times \pi}{4} + n_h \times t_h \times w_h$$

where

n_w is the number of wires;

d_w is the diameter of an individual wire, in millimetres;

n_h is the number of a counter helix;

t_h is the thickness of a counter helix, in millimetres, if greater than 0,3 mm;

w_h is the width of a counter helix, in millimetres.

A.2.6 Lead sheath

The fictitious diameter over the lead sheath (D_{pb}) is given by:

$$D_{pb} = D_g + 2 t_{pb}$$

where

D_g is the fictitious diameter under the lead sheath, in millimetres;

t_{pb} is the thickness calculated in accordance with 12.1, in millimetres.

A.2.7 Separation sheath

The fictitious diameter over the separation sheath (D_s) is given by:

$$D_s = D_u + 2 t_s$$

where

D_u is the fictitious diameter under the separation sheath, in millimetres;

t_s is the thickness calculated in accordance with 13.3.3, in millimetres.

A.2.8 Lapped bedding

The fictitious diameter over the lapped bedding (D_{lb}) is given by:

$$D_{lb} = D_{ulb} + 2 t_{lb}$$

where

D_{ulb} is the fictitious diameter under the lapped bedding, in millimetres;

t_{lb} is the thickness of lapped bedding, i.e. 1,5 mm according to 13.3.4.

A.2.9 Additional bedding for tape-armoured cables (provided over the inner covering)**Table A.3 – Increase of diameter for additional bedding**

Fictitious diameter under the addition bedding		Increase in diameter for additional bedding mm
Above mm	Up to and including mm	
–	29	1,0
29	–	1,6

A.2.10 Armour

The fictitious diameter over the armour (D_x) is given for:

a) flat or round wire armour by:

$$D_x = D_A + 2 t_A + 2 t_w$$

where

D_A is the diameter under the armour, in millimetres;

t_A is the thickness or diameter of the armour wire, in millimetres;

t_w is the thickness of the counter helix, if any, in millimetres, if greater than 0,3 mm.

b) for double-tape armour by:

$$D_x = D_A + 4 t_A$$

where

D_A is the diameter under the armour, in millimetres;

t_A is the thickness of the armour tape, in millimetres.

c) for interlock metal tape armour by increase in diameter according to Table A.4:

Table A.4 – Increase of diameter over interlocked armour

Fictitious diameter under the armour		Increase in diameter over interlocked armour mm
Above mm	Up to and including mm	
–	20	4,5
20	40	6,5
40	–	8,5

Annex B (informative)

Tabulated continuous current ratings for cables having extruded insulation and a rated voltage from 3,6/6 kV up to 18/30 kV

B.1 General

This annex deals solely with the steady-state continuous current ratings of single-core and three-core cables having extruded insulation. The tabulated current ratings provided in this annex have been calculated for cables having a rated voltage of 6/10 kV and constructions as detailed in Clause B.2.

These ratings can be applied to cables of similar constructions in the voltage range of 3,6/6 kV to 18/30 kV.

Some parameters such as screen cross-sectional area and oversheath thickness have an influence on the rating of large cables. In addition, the method of screen bonding has to be taken into account in the rating of single-core cables.

The tabulated current ratings have been calculated using the methods set out in the IEC 60287 series.

For cyclic current ratings, see the IEC 60853 series.

For short-circuit temperature limits, see the IEC 60986 series.

B.2 Cable constructions

The cable constructions and dimensions for which current ratings have been tabulated are based on those given in this standard. The constructions and dimensions used are not related to specific national designs but reflect different model cables. Armoured three-core cables are assumed to have flat wire armour and single-core cables are assumed to be unarmoured. All the cables have copper tape core screens except the single-core XLPE insulated cable, which has a copper wire screen. The nominal cross-sectional areas of the screens for the model cables is given in Table B.1.

Table B.1 – Nominal screen cross-sectional areas

Nominal area of conductor, mm ²	16	25	35	50	70	95	120	150	185	240	300	400
Nominal cross-sectional area of screen, per core, mm ²												
EPR insulated cable	3	3	4	4	4	5	5	5	6	6	7	8
XLPE insulated cable	16	16	16	16	16	16	16	25	25	25	25	35

The oversheath is taken to be polyethylene for the single core cables and PVC for the three-core cables.

B.3 Temperatures

The maximum conductor temperature for which the tabulated cable ratings have been calculated is 90 °C.

The reference ambient temperatures assumed are as follows:

- for cables in air: 30 °C
- for buried cables, either directly in the soil or in ducts in the ground: 20 °C

Correction factors for other ambient temperatures are given in Tables B.10 and B.11.

The current ratings for cables in air do not take account of the increase, if any, due to solar or other infra-red radiation. Where the cables are subject to such radiation, the current rating should be derived by the methods specified in the IEC 60287 series.

B.4 Soil thermal resistivity

The tabulated current ratings for cables in ducts or direct in the ground relate to a soil thermal resistivity of 1,5 K·m/W. Information on the likely soil thermal resistivity in various countries is given in IEC 60287-3-1. Correction factors for other values of thermal resistivity are given in Tables B.14 to B.17.

It is assumed that the soil properties are uniform, no allowance has been made for the possibility of moisture migration which can lead to a region of high thermal resistivity around the cable. If partial drying-out of the soil is foreseen, the permissible current rating should be derived by the methods specified in the IEC 60287 series.

B.5 Methods of installation

B.5.1 General

Current ratings are tabulated for cables installed in the following conditions.

B.5.2 Single-core cables in air

The cables are assumed to be spaced at least 0,5 times the cable diameter from any vertical surface and installed on brackets or ladder racks as follows:

- a) three cables in trefoil formation touching throughout their length;
- b) three cables in horizontal flat formation touching throughout their length;
- c) three cables in horizontal flat formation with a clearance of one cable diameter.




Figure B.1a




Figure B.1b




Figure B.1c

IEC 426/05

Key

D_e external diameter of the cable.

Figure B.1 – Single-core cables in air

B.5.3 Single-core cables buried direct

Current ratings are given for cables buried direct in the ground at a depth of 0,8 m under the following conditions:

- a) three cables in trefoil formation touching throughout their length;

- b) three cables in horizontal flat formation with a clearance of one cable diameter, D_e .




Figure B.2a




Figure B.2b

IEC 427/05

Figure B.2 – Single-core cables buried direct

The cable depth is measured to the cable axis or centre of the trefoil group.

B.5.4 Single-core cables in earthenware ducts

Current ratings are given for cables in earthenware ducts buried at a depth of 0,8 m with one cable per duct as follows:

- three cables in trefoil ducts touching throughout their length;
- three cables in horizontal flat formation, ducts touching throughout their length.




Figure B.3a




Figure B.3b

IEC 428/05

Figure B.3 – Single-core cables in earthenware ducts

The ducts are assumed to be earthenware having an inside diameter of 1,5 times the outside diameter of the cable and a wall thickness equal to 6 % of the duct inside diameter. The ratings are based on the assumption that the ducts are air filled. If the ducts have been filled with a material such as Bentonite, then it is usual to adopt the current ratings for cables buried direct.

The tabulated ratings may be applied to cables in ducts having an inside diameter of between 1,2 and 2 times the outside diameter of the cables. For this range of diameters the variation in the rating is less than 2 % of the tabulated value.

B.5.5 Three-core cables

Current ratings are given for three-core cables installed under the following conditions:

- single cable in air spaced at least 0,3 times the cable diameter from any vertical surface;
- single cable buried direct in the ground at a depth of 0,8 m;
- single cable in a buried earthenware duct having dimensions calculated in the same manner as for the single-core cables in ducts. The depth of burial of the duct is 0,8 m.




Figure B.4a





Figure B.4b

IEC 429/05
Figure B.4c**Figure B.4 – Three-core cables**

B.6 Screen bonding

All the tabulated ratings for single-core cables assume that the cable screens are solidly bonded, i.e. bonded at both ends of the cables.

B.7 Cable loading

The tabulated ratings relate to circuits carrying a balanced three-phase load at a rated frequency of 50 Hz.

B.8 Rating factors for grouped circuits





The tabulated current ratings apply to a set of three single-core cables or one three-core cable forming a three-phase circuit. When a number of circuits are installed in close proximity the rating should be reduced by the appropriate factor from Tables B.18 to B.23.

These rating factors should also be applied to groups of parallel cables forming the same circuit. In such cases, attention should also be given to the arrangement of the cables to ensure that the load current is shared equally between the parallel cables.






B.9 Correction factors

The correction factors given in Tables B.10 to B.23 for temperature, installation conditions and grouping are averages over a range of conductor sizes and cable types. For particular cases, the correction factor may be calculated using the methods in IEC 60287-2-1.

**Table B.2 – Current ratings for single-core cables with XLPE insulation –
Rated voltage 3,6/6 kV to 18/30 kV * –
Copper conductor**








Nominal area of conductor	Buried direct in the ground		In single-way ducts		In air		
	Trefoil	Flat spaced	Trefoil ducts	Flat touching ducts	Trefoil	Flat touching	Flat spaced
							
mm ²	A	A	A	A	A	A	A
16	109	113	103	104	125	128	150
25	140	144	132	133	163	167	196
35	166	172	157	159	198	203	238
50	196	203	186	188	238	243	286
70	239	246	227	229	296	303	356
95	285	293	271	274	361	369	434
120	323	332	308	311	417	426	500
150	361	366	343	347	473	481	559
185	406	410	387	391	543	550	637
240	469	470	447	453	641	647	745
300	526	524	504	510	735	739	846
400	590	572	564	571	845	837	938
Maximum conductor temperature				90 °C			
Ambient air temperature				30 °C			
Ground temperature				20 °C			
Depth of laying				0,8 m			
Thermal resistivity of soil				1,5 K·m/W			
Thermal resistivity of earthenware ducts				1,2 K·m/W			
Screens bonded at both ends.							
* Current rating calculated for cables having a rated voltage of 6/10 kV.							

**Rated voltage 3,6/6 kV to 18/30 kV * –
Aluminium conductor**

Nominal area of conductor	Buried direct in the ground		In single-way ducts		In air		
	Trefoil	Flat spaced	Trefoil ducts	Flat touching ducts	Trefoil	Flat touching	Flat spaced
							
mm ²	A	A	A	A	A	A	A
16	84	88	80	81	97	99	116
25	108	112	102	103	127	130	153
35	129	134	122	123	154	157	185
50	152	157	144	146	184	189	222
70	186	192	176	178	230	236	278
95	221	229	210	213	280	287	338
120	252	260	240	242	324	332	391
150	281	288	267	271	368	376	440
185	317	324	303	307	424	432	504
240	367	373	351	356	502	511	593
300	414	419	397	402	577	586	677
400	470	466	451	457	673	676	769
Maximum conductor temperature				90 °C			
Ambient air temperature				30 °C			
Ground temperature				20 °C			
Depth of laying				0,8 m			
Thermal resistivity of soil				1,5 K·m/W			
Thermal resistivity of earthenware ducts				1,2 K·m/W			
Screens bonded at both ends.							

* Current rating calculated for cables having a rated voltage of 6/10 kV.

**Table B.4 – Current ratings for single-core cables with EPR insulation –
Rated voltage 3,6/6 kV to 18/30 kV * –
Copper conductor**

Nominal area of conductor	Buried direct in the ground		In single-way ducts		In air		
	Trefoil	Flat spaced	Trefoil ducts	Flat touching ducts	Trefoil	Flat touching	Flat spaced
					 $\geq 0,5 \times D_e$	 $\geq 0,5 \times D_e$	 $\geq 0,5 \times D_e$
mm ²	A	A	A	A	A	A	A
16	106	109	99	100	116	119	138
25	136	140	128	129	153	156	181
35	162	167	153	154	186	190	221
50	192	198	181	183	224	229	266
70	234	242	222	224	280	287	334
95	280	289	266	269	343	352	409
120	319	329	303	306	398	407	474
150	357	369	341	344	454	465	540
185	403	417	386	390	522	534	621
240	467	484	449	454	619	634	736
300	526	545	509	515	712	728	843
400	597	618	580	588	825	843	977
Maximum conductor temperature				90 °C			
Ambient air temperature				30 °C			
Ground temperature				20 °C			
Depth of laying				0,8 m			
Thermal resistivity of soil				1,5 K·m/W			
Thermal resistivity of earthenware ducts				1,2 K·m/W			
Screens bonded at both ends.							
* Current rating calculated for cables having a rated voltage of 6/10 kV.							

**Rated voltage 3,6/6 kV to 18/30 kV * –
Aluminium conductor**

Nominal area of conductor	Buried direct in the ground		In single-way ducts		In air		
	Trefoil	Flat spaced	Trefoil ducts	Flat touching ducts	Trefoil	Flat touching	Flat spaced
mm ²	A	A	A	A	A	A	A
16	82	84	77	78	90	92	107
25	105	109	99	100	119	121	141
35	126	130	118	120	144	147	171
50	149	153	140	142	174	178	207
70	182	188	172	174	218	223	259
95	217	224	206	208	266	273	317
120	247	256	235	238	309	317	368
150	277	287	264	267	352	361	419
185	314	325	300	303	406	417	484
240	364	377	350	354	483	495	575
300	411	426	397	401	556	570	659
400	471	487	456	462	651	667	770
Maximum conductor temperature				90 °C			
Ambient air temperature				30 °C			
Ground temperature				20 °C			
Depth of laying				0,8 m			
Thermal resistivity of soil				1,5 K·m/W			
Thermal resistivity of earthenware ducts				1,2 K·m/W			
Screens bonded at both ends.							

* Current rating calculated for cables having a rated voltage of 6/10 kV.

**Table B.6 – Current rating for three-core XLPE insulated cables –
Rated voltage 3,6/6 kV to 18/30 kV * –
Copper conductor, armoured and unarmoured**

[illegible]







**Table B.7 – Current rating for three-core XLPE insulated cables –
Rated voltage 3,6/6 kV to 18/30 kV * –
Aluminium conductor, armoured and unarmoured**

[illegible]

**Table B.8 – Current rating for three-core EPR insulated cables –
Rated voltage 3,6/6 kV to 18/30 kV * –
Copper conductor, armoured and unarmoured**

[illegible]

**Table B.9 – Current rating for three-core EPR insulated cables –
Rated voltage 3,6/6 kV to 18/30 kV * –
Aluminium conductor, armoured and unarmoured**

Nominal area of conductor	Unarmoured			Armoured		
	Buried direct in ground	In a buried duct	In air	Buried direct in ground	In a buried duct	In air
						
mm ²	A	A	A	A	A	A
16	76	65	80	76	66	81
25	97	84	105	97	85	105
35	116	101	127	116	101	127
50	137	119	151	137	120	153
70	167	147	189	168	147	190
95	200	176	229	200	176	230
120	227	201	263	227	201	264
150	255	226	299	254	226	300
185	289	257	343	288	257	343
240	335	300	406	332	299	402
300	378	340	462	374	338	459
400	432	392	538	426	387	530
Maximum conductor temperature			90 °C			
Ambient air temperature			30 °C			
Ground temperature			20 °C			
Depth of laying			0,8 m			
Thermal resistivity of soil			1,5 K·m/W			
Thermal resistivity of earthenware ducts			1,2 K·m/W			
* Current rating calculated for cables having a rated voltage of 6/10 kV.						

**Table B.10 – Correction factors for ambient
air temperatures other than 30 °C**

Maximum conductor temperature °C	Ambient air temperature °C							
	20	25	35	40	45	50	55	60
90	1,08	1,04	0,96	0,91	0,87	0,82	0,76	0,71

Table B.11 – Correction factors for ambient ground temperatures other than 20 °C

Maximum conductor temperature °C	Ambient ground temperature °C							
	10	15	25	30	35	40	45	50
90	1,07	1,04	0,96	0,93	0,89	0,85	0,80	0,76

Table B.12 – Correction factors for depths of laying other than 0,8 m for direct buried cables

Depth of laying m	Single-core cables		Three-core cables
	Nominal conductor size mm ²		
	≤185 mm ²	>185 mm ²	
0,5	1,04	1,06	1,04
0,6	1,02	1,04	1,03
1	0,98	0,97	0,98
1,25	0,96	0,95	0,96
1,5	0,95	0,93	0,95
1,75	0,94	0,91	0,94
2	0,93	0,90	0,93
2,5	0,91	0,88	0,91
3	0,90	0,86	0,90

Table B.13 – Correction factors for depths of laying other than 0,8 m for cables in ducts

Depth of laying m	Single-core cables		Three-core cable
	Nominal conductor size mm ²		
	≤185 mm ²	>185 mm ²	
0,5	1,04	1,05	1,03
0,6	1,02	1,03	1,02
1	0,98	0,97	0,99
1,25	0,96	0,95	0,97
1,5	0,95	0,93	0,96
1,75	0,94	0,92	0,95
2	0,93	0,91	0,94
2,5	0,91	0,89	0,93
3	0,90	0,88	0,92

**Table B.14 – Correction factors for soil thermal resistivities
other than 1,5 K·m/W for direct buried single-core cables**

Nominal area of conductor mm ²	Values of soil thermal resistivity K·m/W						
	0,7	0,8	0,9	1	2	2,5	3
16	1,29	1,24	1,19	1,15	0,89	0,82	0,75
25	1,30	1,25	1,20	1,16	0,89	0,81	0,75
35	1,30	1,25	1,21	1,16	0,89	0,81	0,75
50	1,32	1,26	1,21	1,16	0,89	0,81	0,74
70	1,33	1,27	1,22	1,17	0,89	0,81	0,74
95	1,34	1,28	1,22	1,18	0,89	0,80	0,74
120	1,34	1,28	1,22	1,18	0,88	0,80	0,74
150	1,35	1,28	1,23	1,18	0,88	0,80	0,74
185	1,35	1,29	1,23	1,18	0,88	0,80	0,74
240	1,36	1,29	1,23	1,18	0,88	0,80	0,73
300	1,36	1,30	1,24	1,19	0,88	0,80	0,73
400	1,37	1,30	1,24	1,19	0,88	0,79	0,73

**Table B.15 – Correction factors for soil thermal resistivities
other than 1,5 K·m/W single-core cables in buried ducts**

Nominal area of conductor mm ²	Values of soil thermal resistivity K·m/W						
	0,7	0,8	0,9	1	2	2,5	3
16	1,20	1,17	1,14	1,11	0,92	0,85	0,79
25	1,21	1,17	1,14	1,12	0,91	0,85	0,79
35	1,21	1,18	1,15	1,12	0,91	0,84	0,79
50	1,21	1,18	1,15	1,12	0,91	0,84	0,78
70	1,22	1,19	1,15	1,12	0,91	0,84	0,78
95	1,23	1,19	1,16	1,13	0,91	0,84	0,78
120	1,23	1,20	1,16	1,13	0,91	0,84	0,78
150	1,24	1,20	1,16	1,13	0,91	0,83	0,78
185	1,24	1,20	1,17	1,13	0,91	0,83	0,78
240	1,25	1,21	1,17	1,14	0,90	0,83	0,77
300	1,25	1,21	1,17	1,14	0,90	0,83	0,77
400	1,25	1,21	1,17	1,14	0,90	0,83	0,77

**Table B.16 – Correction factors for soil thermal resistivities
other than 1,5 K·m/W for direct buried three-core cables**

Nominal area of conductor mm ²	Values of soil thermal resistivity K·m/W						
	0,7	0,8	0,9	1	2	2,5	3
16	1,23	1,19	1,16	1,13	0,91	0,84	0,78
25	1,24	1,20	1,16	1,13	0,91	0,84	0,78
35	1,25	1,21	1,17	1,13	0,91	0,83	0,78
50	1,25	1,21	1,17	1,14	0,91	0,83	0,77
70	1,26	1,21	1,18	1,14	0,90	0,83	0,77
95	1,26	1,22	1,18	1,14	0,90	0,83	0,77
120	1,26	1,22	1,18	1,14	0,90	0,83	0,77
150	1,27	1,22	1,18	1,15	0,90	0,83	0,77
185	1,27	1,23	1,18	1,15	0,90	0,83	0,77
240	1,28	1,23	1,19	1,15	0,90	0,83	0,77
300	1,28	1,23	1,19	1,15	0,90	0,82	0,77
400	1,28	1,23	1,19	1,15	0,90	0,82	0,76

**Table B.17 – Correction factors for soil thermal resistivities
other than 1,5 K·m/W for three-core cables in ducts**

Nominal area of conductor mm ²	Values of soil thermal resistivity K·m/W						
	0,7	0,8	0,9	1	2	2,5	3
16	1,12	1,11	1,09	1,08	0,94	0,89	0,84
25	1,14	1,12	1,10	1,08	0,94	0,89	0,84
35	1,14	1,12	1,10	1,08	0,94	0,88	0,84
50	1,14	1,12	1,10	1,08	0,94	0,88	0,84
70	1,15	1,13	1,11	1,09	0,94	0,88	0,83
95	1,15	1,13	1,11	1,09	0,94	0,88	0,83
120	1,15	1,13	1,11	1,09	0,93	0,88	0,83
150	1,16	1,13	1,11	1,09	0,93	0,88	0,83
185	1,16	1,14	1,11	1,09	0,93	0,87	0,83
240	1,16	1,14	1,12	1,10	0,93	0,87	0,82
300	1,17	1,14	1,12	1,10	0,93	0,87	0,82
400	1,17	1,14	1,12	1,10	0,92	0,86	0,81

**Table B.18 – Correction factors for groups of three-core cables
in horizontal formation laid direct in the ground**

Number of cables in group	Spacing between cable centres mm				
	Touching	200	400	600	800
2	0,80	0,86	0,90	0,92	0,94
3	0,69	0,77	0,82	0,86	0,89
4	0,62	0,72	0,79	0,83	0,87
5	0,57	0,68	0,76	0,81	0,85
6	0,54	0,65	0,74	0,80	0,84
7	0,51	0,63	0,72	0,78	0,83
8	0,49	0,61	0,71	0,78	
9	0,47	0,60	0,70	0,77	–
10	0,46	0,59	0,69	–	–
11	0,45	0,57	0,69	–	–
12	0,43	0,56	0,68	–	–

**Table B.19 – Correction factors for groups of three-phase circuits
of single-core cables laid direct in the ground**

Number of cables in group	Spacing between group centres mm				
	Touching	200	400	600	800
2	0,73	0,83	0,88	0,90	0,92
3	0,60	0,73	0,79	0,83	0,86
4	0,54	0,68	0,75	0,80	0,84
5	0,49	0,63	0,72	0,78	0,82
6	0,46	0,61	0,70	0,76	0,81
7	0,43	0,58	0,68	0,75	0,80
8	0,41	0,57	0,67	0,74	–
9	0,39	0,55	0,66	0,73	–
10	0,37	0,54	0,65	–	–
11	0,36	0,53	0,64	–	–
12	0,35	0,52	0,64	–	–







**Table B.20 – Correction factors for groups of three-core cables
in single way ducts in horizontal formation**

Number of cables in group	Spacing between duct centres mm				
	Touching	200	400	600	800
2	0,85	0,88	0,92	0,94	0,95
3	0,75	0,80	0,85	0,88	0,91
4	0,69	0,75	0,82	0,86	0,89
5	0,65	0,72	0,79	0,84	0,87
6	0,62	0,69	0,77	0,83	0,87
7	0,59	0,67	0,76	0,82	0,86
8	0,57	0,65	0,75	0,81	–
9	0,55	0,64	0,74	0,80	–
10	0,54	0,63	0,73	–	–
11	0,52	0,62	0,73	–	–
12	0,51	0,61	0,72	–	–

**Table B.21 – Correction factors for groups of three-phase circuits
of single-core cables in single-way ducts**

Number of cables in group	Spacing between duct group centres mm				
	Touching	200	400	600	800
2	0,78	0,85	0,89	0,91	0,93
3	0,66	0,75	0,81	0,85	0,88
4	0,59	0,70	0,77	0,82	0,86
5	0,55	0,66	0,74	0,80	0,84
6	0,51	0,64	0,72	0,78	0,83
7	0,48	0,61	0,71	0,77	0,82
8	0,46	0,60	0,70	0,76	–
9	0,44	0,58	0,69	0,76	–
10	0,43	0,57	0,68	–	–
11	0,42	0,56	0,67	–	–
12	0,40	0,55	0,67	–	–

**Table B.22 – Reduction factors for groups of more than one multi-core cable in air –
To be applied to the current-carrying capacity for one multi-core cable in free air**

Method of installation		Number of trays	Number of cables					
			1	2	3	4	6	9
Cables on perforated trays	Touching 	1	1,00	0,88	0,82	0,79	0,76	0,73
		2	1,00	0,87	0,80	0,77	0,73	0,68
		3	1,00	0,86	0,79	0,76	0,71	0,66
	Spaced 	1	1,00	1,00	0,98	0,95	0,91	–
		2	1,00	0,99	0,96	0,92	0,87	–
		3	1,00	0,98	0,95	0,91	0,85	–
Cables on vertical perforated trays	 Touching	1	1,00	0,88	0,82	0,78	0,73	0,72
		2	1,00	0,88	0,81	0,76	0,71	0,70
	 Spaced	1	1,00	0,91	0,89	0,88	0,87	–
		2	1,00	0,91	0,88	0,87	0,85	–
Cables on ladder supports, cleats, etc.	Touching 	1	1,00	0,87	0,82	0,80	0,79	0,78
		2	1,00	0,86	0,80	0,78	0,76	0,73
		3	1,00	0,85	0,79	0,76	0,73	0,70
	Spaced 	1	1,00	1,00	1,00	1,00	1,00	–
		2	1,00	0,99	0,98	0,97	0,96	–
		3	1,00	0,98	0,97	0,96	0,93	–






NOTE 1 Values given are averages for the cable types and range of conductor sizes considered. The spread of values is generally less than 5 %.

NOTE 2 Factors apply to single layer groups of cables as shown above and do not apply when cables are installed in more than one layer touching each other. Values for such installations may be significantly lower and must be determined by an appropriate method.

NOTE 3 Values are given for vertical spacings between trays of 300 mm and at least 20 mm between trays and wall. For closer spacing, the factors should be reduced.

NOTE 4 Values are given for horizontal spacing between trays of 225 mm with trays mounted back to back. For closer spacing, the factors should be reduced.

Table B.23 – Reduction factors for groups of more than one circuit of single-core cables
(Note 2) – To be applied to the current-carrying capacity for one circuit of single-core cables in free air

Method of installation		Number of trays	Number of three-phase circuits (Note 5)			Use as a multiplier to rating for
			1	2	3	
Perforated trays (Note 3)	Touching 	1	0,98	0,91	0,87	Three cables in horizontal formation
		2	0,96	0,87	0,81	
		3	0,95	0,85	0,78	
Ladder supports, cleats etc. (Note 3)	Touching 	1	1,00	0,97	0,96	Three cables in horizontal formation
		2	0,98	0,93	0,89	
		3	0,97	0,90	0,86	
Perforated trays (Note 3)		1	1,00	0,98	0,96	Three cables in trefoil formation
		2	0,97	0,93	0,89	
		3	0,96	0,92	0,86	
Vertical perforated trays (Note 4)		1	1,00	0,91	0,89	
		2	1,00	0,90	0,86	
Ladder supports, cleats, etc. (Note 3)	Spaced 	1	1,00	1,00	1,00	
		2	0,97	0,95	0,93	
		3	0,96	0,94	0,90	

NOTE 1 Values given are averages for the cable types and range of conductor sizes considered. The spread of values is generally less than 5 %.

NOTE 2 Factors are given for single layers of cables (or trefoil groups) as shown in the table and do not apply when cables are installed in more than one layer touching each other. Values for such installations may be significantly lower and should be determined by an appropriate method.

NOTE 3 Values are given for vertical spacings between trays of 300 mm. For closer spacing, the factors should be reduced.

NOTE 4 Values are given for horizontal spacing between trays of 225 mm with trays mounted back to back. For closer spacing, the factors should be reduced.

NOTE 5 For circuits having more than one cable in parallel per phase, each three phase set of conductors should be considered as a circuit for the purpose of this table.

Annex C
(normative)

Rounding of numbers

C.1 Rounding of numbers for the purpose of the fictitious calculation method

The following rules apply when rounding numbers in calculating fictitious diameters and determining dimensions of component layers in accordance with Annex A.

When the calculated value at any stage has more than one decimal place, the value shall be rounded to one decimal place, i.e. to the nearest 0,1 mm. The fictitious diameter at each stage shall be rounded to 0,1 mm and, when used to determine the thickness or dimension of an overlying layer, it shall be rounded before being used in the appropriate formula or table. The thickness calculated from the rounded value of the fictitious diameter shall, in turn, be rounded to 0,1 mm as required in Annex A.

To illustrate these rules, the following practical examples are given:

- a) when the figure in the second decimal place before rounding is 0, 1, 2, 3 or 4, then the figure retained in the first decimal place remains unchanged (rounding down);

Examples:

2,12	≈ 2,1
2,449	≈ 2,4
25,0478	≈ 25,0

- b) when the figure in the second decimal place before rounding is 9, 8, 7, 6 or 5, then the figure in the first decimal place is increased by one (rounding up).

Examples:

2,17	≈ 2,2
2,453	≈ 2,5
30,050	≈ 30,1

C.2 Rounding of numbers for other purposes

For purposes other than those considered under Clause C.1, it may be required that values are rounded to more than one decimal place. This may occur, for instance, in calculating the average value of several measurement results, or the minimum value by applying a percentage tolerance to a given nominal value. In these cases, rounding shall be carried out to the number of decimal places specified in the relevant clauses.

The method of rounding shall then be as follows:

- a) if the last figure to be retained is followed, before rounding, by 0, 1, 2, 3 or 4, it shall remain unchanged (rounding down);
- b) if the last figure to be retained is followed, before rounding, by 9, 8, 7, 6 or 5, it shall be increased by one (rounding up).

Examples:

2,449	≈ 2,45	rounded to two decimal places
2,449	≈ 2,4	rounded to one decimal place
25,0478	≈ 25,048	rounded to three decimal places
25,0478	≈ 25,05	rounded to two decimal places
25,0478	≈ 25,0	rounded to one decimal place

Annex D (normative)

Method of measuring resistivity of semi-conducting screens

Each test piece shall be prepared from a 150 mm sample of completed cable.

The conductor screen test piece shall be prepared by cutting a sample of core in half longitudinally and removing the conductor and separator if any (see Figure D.1a). The insulation screen test piece shall be prepared by removing all the coverings from the sample of core (see Figure D.1b).

The procedure for determining the volume resistivity of the screens shall be as follows:

Four silver-painted electrodes A, B, C, and D (see Figures D.1a and D.1b) shall be applied to the semi-conducting surfaces. The two potential electrodes, B and C, shall be 50 mm apart and the two current electrodes, A and D, shall be each placed at least 25 mm beyond the potential electrodes.

Connections shall be made to the electrodes by means of suitable clips. In making connections to the conductor screen electrodes it shall be ensured that the clips are insulated from the insulation screen on the outer surface of the test sample.

The assembly shall be placed in an oven preheated to the specified temperature and, after an interval of at least 30 min, the resistance between the electrodes shall be measured by means of a circuit, the power of which shall not exceed 100 mW.

After the electrical measurements, the diameters over the conductor screen and insulation screen and the thicknesses of the conductor screen and insulation screen shall be measured at ambient temperature, each being the average of six measurements made on the sample shown in Figure D.1b.

The volume resistivity ρ in ohm · metres shall be calculated as follows:

a) conductor screen

$$\rho_c = \frac{R_c \times \pi \times (D_c - T_c) \times T_c}{2L_c}$$

where

ρ_c is the volume resistivity, in ohm · metres;

R_c is the measured resistance, in ohms;

L_c is the distance between potential electrodes, in metres;

D_c is the outer diameter over the conductor screen, in metres;

T_c is the average thickness of conductor screen, in metres.

b) insulation screen

$$\rho_i = \frac{R_i \times \pi \times (D_i - T_i) \times T_i}{L_i}$$

where

ρ_i is the volume resistivity, in ohm · metres;

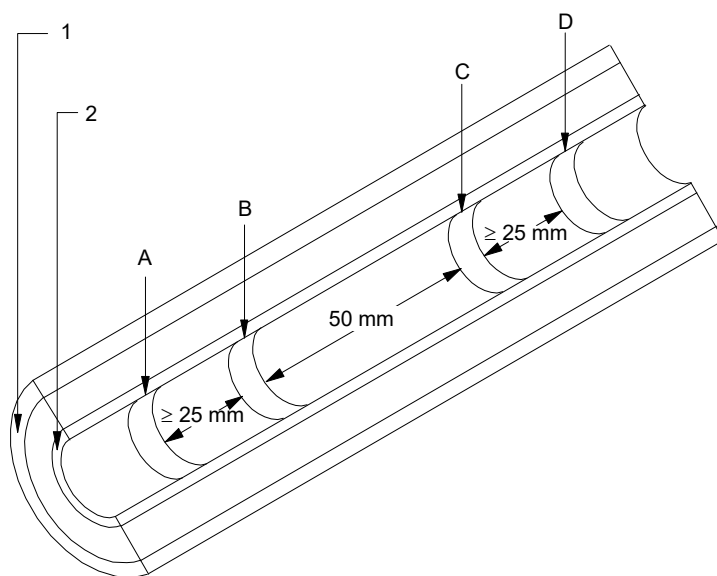
R_i is the measured resistance, in ohms;

L_i is the distance between potential electrodes, in metres;

D_i is the outer diameter over the insulation screen, in metres;

T_i is the average thickness of insulation screen, in metres.

Dimensions in millimetres



IEC 2417/11

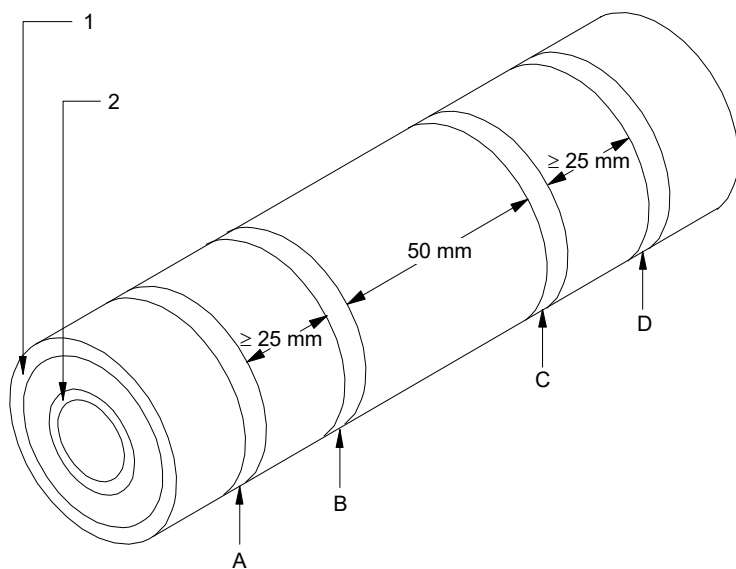
Key

- 1 insulation screen
- 2 conductor screen

- B, C potential electrodes
- A, D current electrodes

Figure D.1a – Measurement of the volume resistivity of the conductor screen

Dimensions in millimetres



IEC 2418/11

Key

- 1 insulation screen
- 2 conductor screen

- B, C potential electrodes
- A, D current electrodes

Figure D.1b – Measurement of the volume resistivity of the insulation screen

Figure D.1 – Preparation of samples for measurement of resistivity of conductor and insulation screens

Annex E

(normative)

Determination of hardness of HEPR insulations

E.1 Test piece

The test piece shall be a sample of completed cable with all the coverings, external to the HEPR insulation to be measured, carefully removed. Alternatively, a sample of insulated core may be used.

E.2 Test procedure

E.2.1 General

Tests shall be made in accordance with ISO 48 with exceptions as indicated below.

E.2.2 Surfaces of large radius of curvature

The test instrument, in accordance with ISO 48, shall be constructed so as to rest firmly on the HEPR insulation and permit the presser foot and indenter to make vertical contact with this surface. This is done in one of the following ways:

- a) the instrument is fitted with feet moveable in universal joints so that they adjust themselves to the curved surface;
- b) the base of the instrument is fitted with two parallel rods A and A' at a distance apart depending on the curvature of the surface (see Figure E.1).

These methods may be used on surfaces with radius of curvature down to 20 mm.

When the thickness of HEPR insulation tested is less than 4 mm, an instrument as described in the method in ISO 48 for thin and small test pieces shall be used.

E.2.3 Surfaces of small radius of curvature

On surfaces with too small a radius of curvature for the procedures described in E.2.2, the test piece shall be supported on the same rigid base as the test instrument, in such a way as to minimize bodily movement of the HEPR insulation when the indenting force increment is applied to the indenter and so that the indenter is vertically above the axis of the test piece. Suitable procedures are as follows:

- a) by resting the test piece in a groove or trough in a metal jig (see Figure E.2a);
- b) by resting the ends of the conductor of the test piece in V-blocks (see Figure E.2b).

The smallest radius of curvature of the surface to be measured by these methods shall be at least 4 mm.

For smaller radii, an instrument as described in the method in ISO 48 for thin and small test pieces shall be used.

E.2.4 Conditioning and test temperature

The minimum time between manufacture, i.e. vulcanization and testing, shall be 16 h.

The test shall be carried out at a temperature of $(20 \pm 2) ^\circ\text{C}$ and the test pieces shall be maintained at this temperature for at least 3 h immediately before testing.

E.2.5 Number of measurements

One measurement shall be made at each of three or five different points distributed around the test piece. The median of the results shall be taken as the hardness of the test piece, reported to the nearest whole number in international rubber hardness degrees (IRHD).

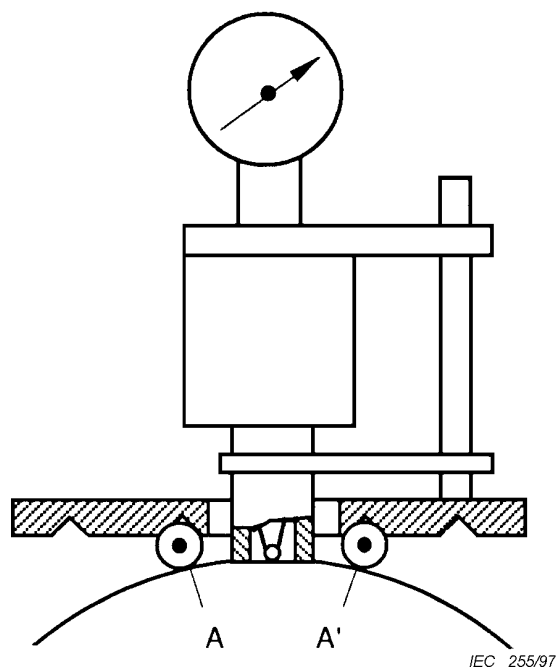


Figure E.1 – Test on surfaces of large radius of curvature

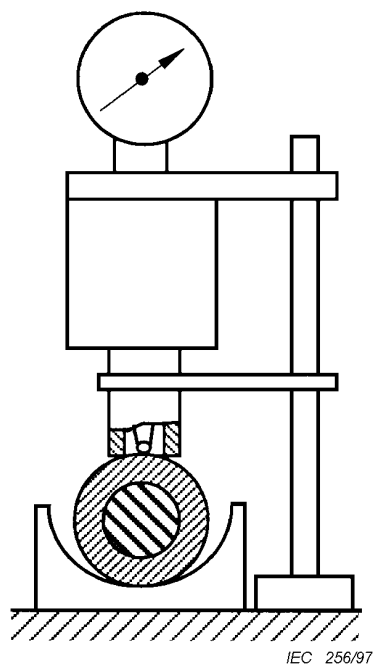


Figure E.2a – Test piece groove

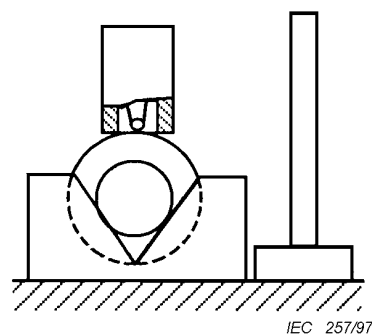


Figure E.2b – Test piece in V-blocks

Figure E.2 – Test on surfaces of small radius of curvature

Annex F (normative)

Water penetration test

F.1 Test piece

A sample of completed cable at least 6 m in length which has not been subjected to any of the tests described in Clause 18 shall be subjected to a bending test described in 18.2.4 without the additional partial discharge test.

A 3 m length of cable shall be cut from the length which has been subjected to the bending test and placed horizontally. A ring approximately 50 mm wide shall be removed from the centre of the length. This ring shall comprise all the layers external to the insulation screen. Where the conductor is also claimed to contain a barrier, the ring shall comprise all layers external to the conductor.

If the cable contains intermittent barriers to longitudinal water penetration then the sample shall contain at least two of these barriers, the ring being removed from between the barriers. In this case, the average distance between the barriers in such cables should be stated and the length of the cable sample shall be determined accordingly.

The surfaces shall be cut so that the interfaces intended to be longitudinally watertight shall be readily exposed to the water. The interfaces not intended to be longitudinally watertight shall be sealed with a suitable material or the outer coverings removed.

Examples of these latter interfaces include:

- when only the conductor of the cable has a barrier;
- the interface between the oversheath and the metal sheath.

Arrange a suitable device (see Figure F.1) to allow a tube having a diameter of at least 10 mm to be placed vertically over the exposed ring and sealed to the surface of the oversheath. The seals where the cable exits the apparatus shall not exert mechanical stress on the cable.

NOTE The response of certain barriers to longitudinal penetration can be dependent on the composition of the water (e.g. pH, ion concentration). Normal tap water should be used for the test, unless otherwise specified.

F.2 Test

The tube is filled within 5 min with water at an ambient temperature of $(20 \pm 10) ^\circ\text{C}$ so that the height of the water in the tube is 1 m above the cable centre (see Figure F.1). The sample shall be allowed to stand for 24 h.

The sample shall then be subjected to 10 heating cycles by passing current through the conductor, until the conductor reaches a steady temperature 5 K to 10 K above the maximum conductor temperature in normal operation and which shall not reach $100 ^\circ\text{C}$.

The duration of the heating cycle shall be at least 8 h. The conductor temperature shall be maintained within the stated temperature limits for at least 2 h of each heating period. This shall be followed by at least 3 h of natural cooling.

The water head shall be maintained at 1 m.

NOTE No voltage being applied throughout the test, it is advisable to connect a dummy cable in series with the cable to be tested, the temperature being measured directly on the conductor of this cable.

F.3 Requirements

During the period of testing no water shall emerge from the ends of the test piece.

Dimensions in millimetres

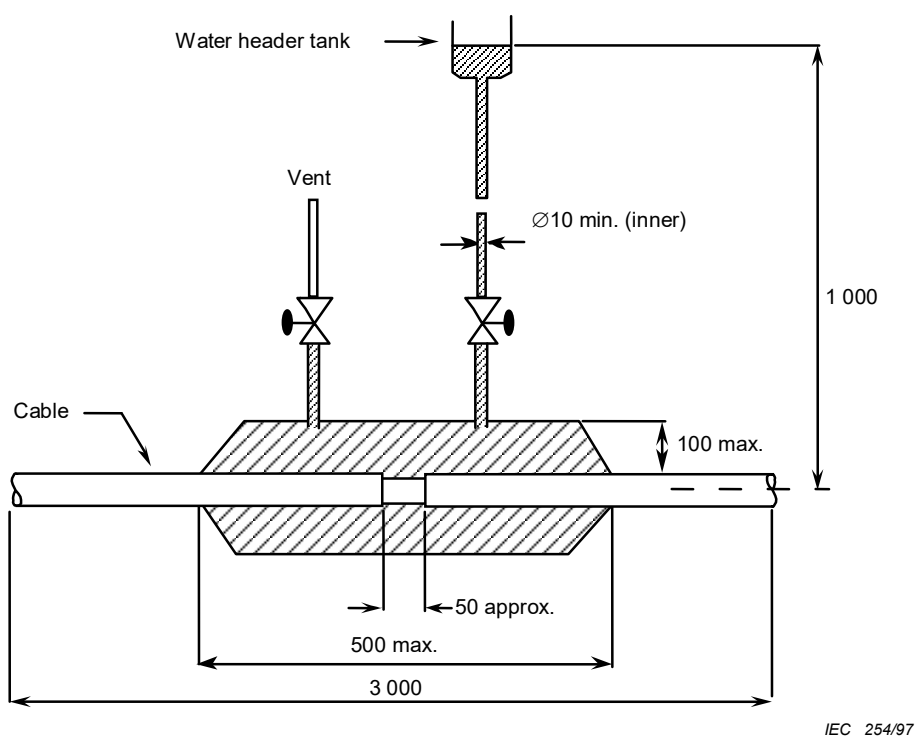


Figure F.1 – Schematic diagram of apparatus for water penetration test

Annex G

(informative)

Determination of the cable conductor temperature

G.1 Purpose

For some tests, it is necessary to raise the cable conductor to a given temperature, typically 5 K to 10 K above the maximum temperature in normal operation, while the cable is energized, either at power frequency or under impulse conditions. It is therefore not possible to have access to the conductor to enable direct measurement of temperature.

In addition, the conductor temperature should be maintained within a restricted range (5 K) whereas the ambient temperature may vary over a wider range.

Although preliminary calibration on the cable under test or calculations may be satisfactory in the first place, the variation of ambient conditions throughout the duration of the test may lead to deviations of the temperature of the conductor outside range.

Therefore, methods should be used in which the conductor temperature can be monitored and controlled throughout the duration of the test.

Guidance is given hereafter on commonly used methods.

G.2 Calibration of the temperature of the main test loop

G.2.1 General

The purpose of the calibration is to determine the conductor temperature by direct measurement for a given current within the temperature range required for the test.

The cable used for calibration (hereafter called reference cable) should be taken from same length as the cable used for the main test loop.

G.2.2 Installation of cable and temperature sensors

The calibration should be performed on a minimum cable length of 5 m, taken from the same cable as tested. The length should be such that the longitudinal heat transfer to the cable ends does not affect the temperature in the centre 2 m of cable by more than 2 K.

At the middle of the reference cable, two temperature sensors should be attached: one on the conductor (TC_{1c}), and one on the external surface or directly under the external surface (TC_{1s}).

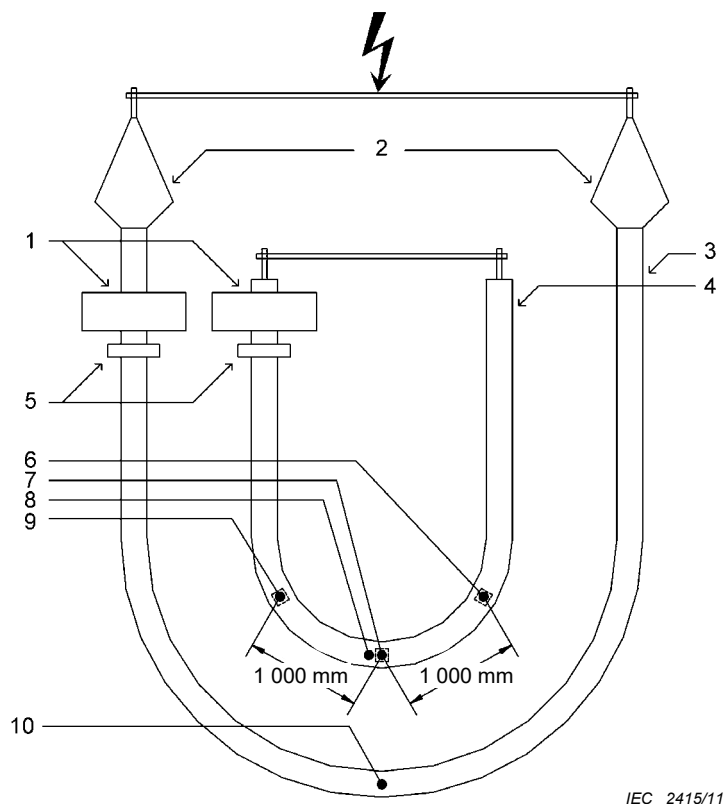
Two other temperature sensors, TC_{2c} and TC_{3c} , should be installed on the conductor of the reference cable (see Figure G.1), each one about 1 m away from the middle.

The temperature sensors should be attached to the conductor by mechanical means since they may move due to vibrations of the cable during heating. Care should be taken to maintain good thermal contact during the tests and to prevent leakage of heat to the ambient. It is recommended to mount the thermocouple(s) as shown in Figure G.2 between two strands of a stranded conductor or between the (solid) conductor and the conductor screen. To enable access to the conductor in the middle of the reference cable, a small hatch should be made by careful removal of the layers above the conductor. After installing the temperature sensor(s),

the layers that have been removed may be put back. This may restore the thermal behaviour of the reference cable.

NOTE To prove a negligible heat transfer towards the cable ends, the difference between the readings of TC_{1C} , TC_{2C} and TC_{3C} should be less than 2 K.

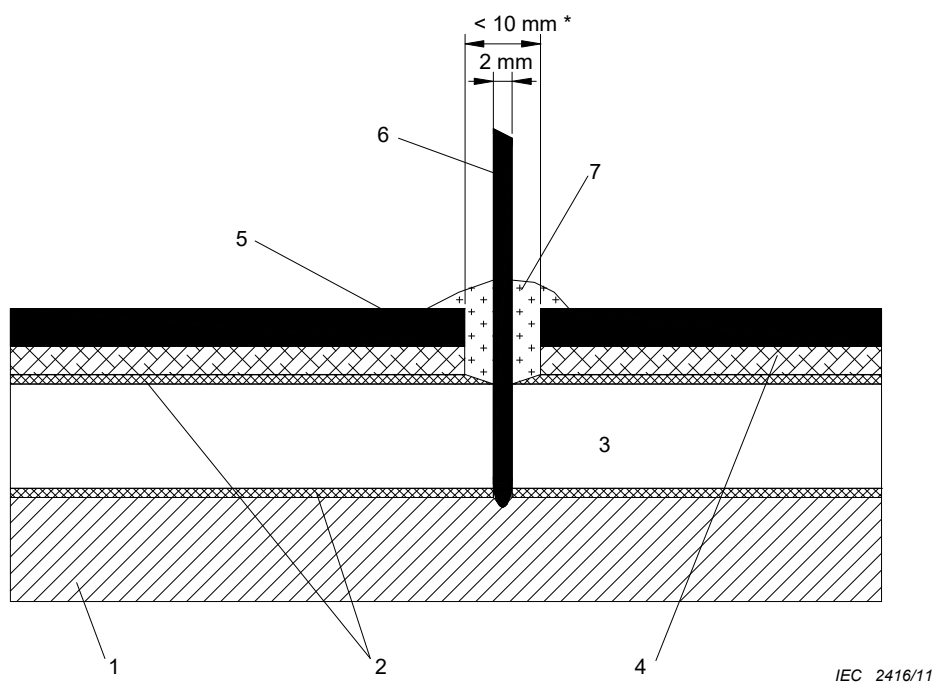
If the main test loop includes several individual cable lengths installed close to each other, these lengths will be subjected to thermal proximity effect. The calibration should therefore be carried out, taking into account the actual test arrangement, measurements being performed on the hottest cable length (usually the middle length).



Key

- | | | | |
|---|--------------------------------|----|-----------------------|
| 1 | current inducing transformers | 6 | TC_{3C} (conductor) |
| 2 | terminations | 7 | TC_{1C} (conductor) |
| 3 | cable under test | 8 | TC_{1S} (sheath) |
| 4 | reference cable (≥ 5 m) | 9 | TC_{2C} (conductor) |
| 5 | current measuring transformers | 10 | TC_S (sheath) |

Figure G.1 – Typical test set-up for the reference loop and the main test loop

**Key**

1	conductor	5	cable oversheath
2	semi-conducting screens	6	temperature sensor
3	insulation	7	flexible thermal insulating compound
4	metal sheath	*	as small as possible

Figure G.2 – Example of an arrangement of the temperature sensors on the conductor of the reference loop

G.2.3 Calibration method

The calibration should be carried out in a draught-free situation at a temperature of $(20 \pm 15) ^\circ\text{C}$.

Temperature recorders should be used to measure the conductor, oversheath and ambient temperatures simultaneously.

The cable should be heated until the conductor temperatures, indicated by temperature sensors $\text{TC}_{1\text{C}}$ of Figure G.1, have stabilized and reached the following temperatures: between 5 K and 10 K above the maximum conductor temperature of the cable in normal operation, as given in Table 1.

When stabilization has been reached, the following should be noted:

- conductor temperature: average value at positions 1, 2 and 3;
- oversheath temperature at position $\text{TC}_{1\text{S}}$;
- ambient temperature;
- heating current.

G.3 Heating for the test

G.3.1 Method 1 – Test using a reference cable

In this method, a reference cable identical to the cable used for the test is heated with the same current value as the main test loop.

The installation of cable and temperature sensors for both loops should be as given in Clause G.2.

The test arrangement should be such that

- the reference cable carries the same current as the main test loop at any time;
- it is installed in such a way that mutual heating effects are taken into account throughout the test.

The heating current of both loops should be adjusted such that the conductor temperature is kept within the specified limits.

A temperature sensor (TC_S) should be mounted on or under the external surface of the main test loop at the hottest spot, usually in the middle of it, in the same way as temperature sensor TC_{1s} is mounted on the hottest spot of the reference cable.

NOTE 1 The temperature measured with the temperature sensors on or under the oversheath of the main test loop (TC_S) and on the reference loop (TC_{1s}) are used to check whether the oversheath of both loops has the same temperature.

The temperature measured with temperature sensor TC_{1C} on the conductor of the reference loop may be considered as to be representative for the conductor temperature of the energized test loop.

NOTE 2 The temperature of the conductor of the main test loop may be slightly higher than that of the reference loop because of dielectric losses. If necessary, a correction should be made.

All temperature sensors should be connected to a recorder to enable temperature monitoring. The heating current of each loop should also be recorded to prove that the two currents are of the same value throughout the duration of the test. The difference between the heating currents should be kept within ± 1 %.

The reference cable may be connected in series with the test cable if the temperature is measured via an optical fibre link or equivalent.

G.3.2 Method 2 – Test using conductor temperature calculations and measurement of the surface temperature

G.3.2.1 Calibration of the test cable conductor temperature

The purpose of the calibration is to determine the conductor temperature by direct measurement for a given current, within the temperature range required for the test.

The cable used for calibration should be identical to that to be used for the test, and the way of heating should be identical.

The installation of cable and temperature sensors for the calibration should be as given in Clause G.2.

The calibration should be carried out in accordance with G.2.3 for the reference cable.

G.3.2.2 Test based on measurement of the external temperature

During calibration and during the test of the main loop, the cable conductor temperature of the main test loop should be calculated in accordance with IEC 60853-2, based on the measured external temperature of the oversheath (TC_S). The measurement should be done with a temperature sensor at the hottest spot, attached to or under the external surface, in the same way as for the reference cable.

NOTE As an alternative, IEC 60287-2 (all parts 2) may be used if demonstrated that asymptotic transient temperature is reached within the specified time

The heating current should be adjusted to obtain the required value of the calculated conductor temperature, based on the measured external temperature of the oversheath.

Annex H (normative)

Test for water penetration in the conductor

H.1 General

This test is applied only for stranded conductors having a nominal cross-sectional area larger than 630 mm².

H.2 Test piece

A 1,5 m sample of cable which has been subjected to the bending test of 18.2.4 shall be placed horizontally.

All layers external to the insulation screen shall be removed from the sample and the full cross-section of the conductor shall be exposed at both ends of the test piece.

Arrange a suitable chamber to enclose one end of the test piece. The chamber shall be fitted with an air vent and a separate vertical tube, both of at least 10 mm internal diameter, with a header tank to allow the application of a 1 m head of water (see Figure H.1). The chamber shall be sealed to the surface of the insulation screen. The seal where the cable exits the chamber shall not deform the insulation during the test.

NOTE The response of certain barriers to longitudinal penetration can be dependent on the composition of the water (e.g. pH, ion concentration). Normal tap water is used for the test unless otherwise specified.

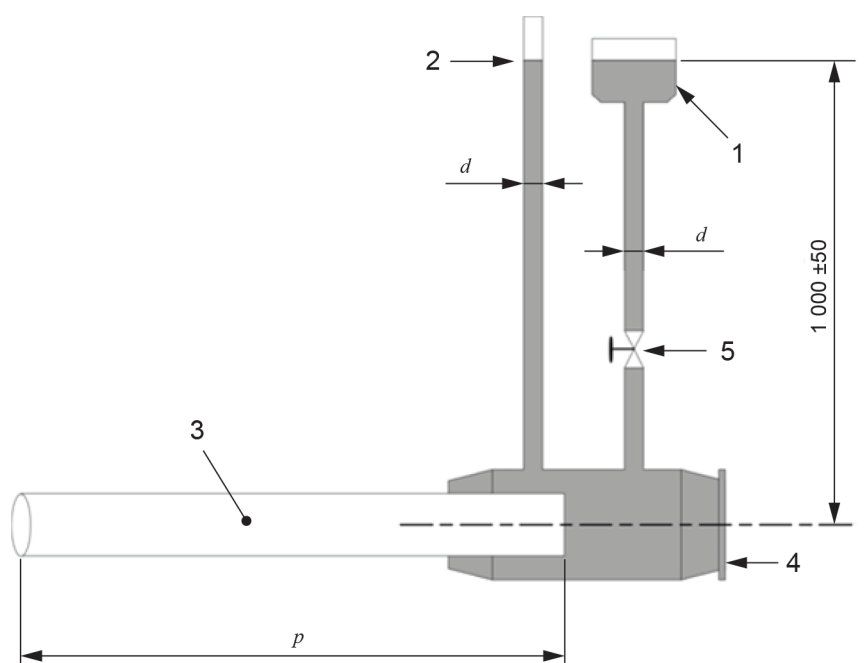
H.3 Test

The tube shall be filled within 5 min with tap water at a temperature of $(20 \pm 10) ^\circ\text{C}$ so that the height of the water in the tube is 1 m above the cable centre (see Figure H.1). The sample shall be allowed to stand for 11 days at ambient temperature.

H.4 Requirements

During the period of testing, no water shall emerge from the end of the test piece.

Dimensions in millimetres



IEC

Key

- 1 water header tank
- 2 air vent
- 3 test piece
- 4 chamber
- 5 full bore valve (optional)
- d internal $\varnothing \geq 10$ mm
- p length $\leq (1\,500 \pm 50)$ mm

Figure H.1 – Schematic diagram of apparatus for water penetration test in the conductor

Annex I (normative)

Methods of determining the weighted value of halogen content of the non-metallic materials in the cable

I.1 Calculating the weighted value of the cable when the halogen content of individual materials is tested

Measure the weight, w_i , of each non-metallic material, i , per unit length of cable.

The weighted value of halogen content of non-metallic materials in the cable, H'_i , for each halogen, is calculated as follows:

$$H'_i = \frac{\sum(H_i \times w_i)}{\sum w_i}$$

where

H'_i is the halogen content of the individual material of weight w_i .

The sum of the weighted values of the halogen content of non-metallic materials in the cable of the four individual halogens (F, Cl, Br, I), i.e. $\sum H'_i$ shall be calculated.

I.2 Preparation of the test sample for measurement of halogen content on a sample representative of the non-metallic materials in the cable

A sample of approximate length 15 mm to 25 mm of the complete cable shall be cut into small pieces after all metal elements have been removed. The sample shall be of sufficient length to give the required weight of the test specimen. The cable components shall be cut into small pieces no larger than 3 mm.

The pieces should be well mixed and the test sample shall be taken from the mixture.

Bibliography

IEC 60287 (all parts), *Electric cables – Calculation of the current rating*

IEC 60502-1, *Power cables with extruded insulation and their accessories for rated voltages from 1 kV ($U_m = 1,2$ kV) up to 30 kV ($U_m = 36$ kV) – Part 1: Cables for rated voltages of 1 kV ($U_m = 1,2$ kV) and 3 kV ($U_m = 3,6$ kV)*

IEC 60332-3-22, *Tests on electric and optical fibre cables under fire conditions – Part 3-22: Test for vertical flame spread of vertically-mounted bunched wires or cables – Category A*

IEC 60332-3-23, *Tests on electric and optical fibre cables under fire conditions – Part 3-23: Test for vertical flame spread of vertically-mounted bunched wires or cables – Category B*

CONTENTS

FOREWORD.....	11
1 Scope	13
2 Normative references	13
3 Terms and definitions	15
3.1 Definitions of dimensional values (thicknesses, cross-sections, etc.)	15
3.2 Definitions concerning the tests	16
4 Voltage designations and materials	16
4.1 Rated voltages	16
4.2 Insulating compounds	17
4.3 Sheathing compounds	18
5 Conductors	19
6 Insulation.....	19
6.1 Material	19
6.2 Insulation thickness	19
7 Screening	20
7.1 General.....	20
7.2 Conductor screen.....	20
7.3 Insulation screen	20
8 Assembly of three-core cables, inner coverings and fillers	21
8.1 General.....	21
8.2 Inner coverings and fillers	21
8.2.1 Construction	21
8.2.2 Material	21
8.2.3 Thickness of extruded inner covering	21
8.2.4 Thickness of lapped inner covering	21
8.3 Cables having a collective metal layer (see Clause 9).....	22
8.4 Cables having a metal layer over each individual core (see Clause 10).....	22
9 Metal layers for single-core and three-core cables	22
10 Metal screen.....	22
10.1 Construction	22
10.2 Requirements	23
10.3 Metal screens not associated with semi-conducting layers	23
11 Concentric conductor	23
11.1 Construction	23
11.2 Requirements	23
11.3 Application	23
12 Metal sheath.....	23
12.1 Lead sheath	23
12.2 Other metal sheaths.....	23
13 Metal armour	24
13.1 Types of metal armour	24
13.2 Materials	24
13.3 Application of armour	24
13.3.1 Single-core cables	24
13.3.2 Three-core cables	24

13.3.3	Separation sheath	24
13.3.4	Lapped bedding under armour for lead sheathed cables	25
13.4	Dimensions of the armour wires, armour tapes and armour strips	25
13.5	Correlation between cable diameters and armour dimensions	25
13.6	Round or flat wire armour.....	26
13.7	Double tape armour	26
13.8	Interlock metal tape armour	27
14	Oversheath.....	27
14.1	General.....	27
14.2	Material	27
14.3	Thickness	28
15	Test conditions	28
15.1	Ambient temperature.....	28
15.2	Frequency and waveform of power frequency test voltages.....	28
15.3	Waveform of impulse test voltages.....	28
15.4	Determination of the cable conductor temperature	28
16	Routine tests	28
16.1	General.....	28
16.2	Electrical resistance of conductors	29
16.3	Partial discharge test	29
16.4	Voltage test	29
16.4.1	General	29
16.4.2	Test procedure for single-core cables	29
16.4.3	Test procedure for three-core cables	29
16.4.4	Test voltage.....	30
16.4.5	Requirement.....	30
16.5	Electrical test on oversheath of the cable	30
17	Sample tests	30
17.1	General.....	30
17.2	Frequency of sample tests	30
17.2.1	Conductor examination and check of dimensions	30
17.2.2	Electrical and physical tests.....	30
17.3	Repetition of tests.....	31
17.4	Conductor examination	31
17.5	Measurement of thickness of insulation and of non-metal sheaths (including extruded separation sheaths, but excluding inner extruded coverings).....	31
17.5.1	General	31
17.5.2	Requirements for the insulation	31
17.5.3	Requirements for the non-metal sheaths.....	32
17.6	Measurement of thickness of lead sheath	32
17.6.1	General	32
17.6.2	Strip method	32
17.6.3	Ring method	32
17.7	Measurement of armour wires, tapes and armour strips	32
17.7.1	Measurement on wires.....	32
17.7.2	Measurement on tapes and armour strips	33
17.7.3	Requirements	33

17.8	Measurement of external diameter	33
17.9	Voltage test for 4 h	33
17.9.1	Sampling	33
17.9.2	Procedure	33
17.9.3	Test voltages	33
17.9.4	Requirements	33
17.10	Hot set test for EPR, HEPR and XLPE insulations and elastomeric sheaths	34
17.10.1	Procedure	34
17.10.2	Requirements	34
17.11	Bending test on interlock armour cable followed by examination	34
18	Type tests, electrical	34
18.1	General	34
18.2	Cables having conductor screens and insulation screens	34
18.2.1	General	34
18.2.2	Sequence of tests	34
18.2.3	Special provisions	35
18.2.4	Bending test	35
18.2.5	Partial discharge test	36
18.2.6	Tan δ measurement for cables of rated voltage 6/10 (12) kV and above	36
18.2.7	Heating cycle test	36
18.2.8	Impulse test followed by a voltage test	36
18.2.9	Voltage test for 4 h	37
18.2.10	Resistivity of semi-conducting screens	37
18.3	Cables of rated voltage 3,6/6 (7,2) kV having unscreened insulation	37
18.3.1	General	37
18.3.2	Insulation resistance measurement at ambient temperature	38
18.3.3	Insulation resistance measurement at maximum conductor temperature	38
18.3.4	Voltage test for 4 h	39
18.3.5	Impulse test	39
19	Type tests, non-electrical	39
19.1	General	39
19.2	Measurement of thickness of insulation	39
19.2.1	Sampling	39
19.2.2	Procedure	39
19.2.3	Requirements	40
19.3	Measurement of thickness of non-metal sheaths (including extruded separation sheaths, but excluding inner coverings)	40
19.3.1	Sampling	40
19.3.2	Procedure	40
19.3.3	Requirements	40
19.4	Measurement of thickness of lead sheath	40
19.4.1	Sampling	40
19.4.2	Procedure	40
19.4.3	Requirements	40
19.5	Tests for determining the mechanical properties of insulation before and after ageing	40

19.5.1	Sampling	40
19.5.2	Ageing treatments	40
19.5.3	Conditioning and mechanical tests.....	40
19.5.4	Requirements	40
19.6	Tests for determining the mechanical properties of non-metal sheaths before and after ageing.....	41
19.6.1	Sampling	41
19.6.2	Ageing treatments	41
19.6.3	Conditioning and mechanical tests.....	41
19.6.4	Requirements	41
19.7	Additional ageing test on pieces of completed cables.....	41
19.7.1	General	41
19.7.2	Sampling	41
19.7.3	Ageing treatment	41
19.7.4	Mechanical tests.....	41
19.7.5	Requirements	41
19.8	Loss of mass test on PVC sheaths of type ST ₂	42
19.8.1	Procedure.....	42
19.8.2	Requirements	42
19.9	Pressure test at high temperature on insulations and non-metal sheaths	42
19.9.1	Procedure.....	42
19.9.2	Requirements	42
19.10	Test on PVC insulation, PVC sheaths and halogen free sheaths at low temperatures	42
19.10.1	Procedure.....	42
19.10.2	Requirements	42
19.11	Test for resistance of PVC insulation and sheaths to cracking (heat shock test).....	42
19.11.1	Procedure.....	42
19.11.2	Requirements	42
19.12	Ozone resistance test for EPR and HEPR insulations	42
19.12.1	Procedure.....	42
19.12.2	Requirements	42
19.13	Hot set test for EPR, HEPR and XLPE insulations and elastomeric sheaths.....	43
19.14	Oil immersion test for elastomeric sheaths	43
19.14.1	Procedure.....	43
19.14.2	Requirements	43
19.15	Water absorption test on insulation	43
19.15.1	Procedure.....	43
19.15.2	Requirements	43
19.16	Test under fire conditions.....	43
19.16.1	General	43
19.16.2	Flame spread test for single cables	43
19.16.3	Flame spread test for bunched cables	43
19.16.4	Measurement of smoke density of cables burning under defined conditions	43
19.16.5	Determination of acidity (by pH measurement) and conductivity of gases evolved during combustion of the non- metallic materials in the cable.....	44

19.16.6	Fire performance tests on halogen free oversheath material ST ₈	44
19.16.7	Fire performance tests on halogen free oversheath material ST ₁₂	44
19.16.8	Measurement of halogen content of gases evolved during combustion of the non-metallic materials in the cable	45
19.17	Measurement of carbon black content of black PE oversheaths	45
19.17.1	Procedure	45
19.17.2	Requirements	45
19.18	Shrinkage test for XLPE insulation	45
19.18.1	Procedure	45
19.18.2	Requirements	45
19.19	Thermal stability test for PVC insulation	46
19.19.1	Procedure	46
19.19.2	Requirements	46
19.20	Determination of hardness of HEPR insulation	46
19.20.1	Procedure	46
19.20.2	Requirements	46
19.21	Determination of the elastic modulus of HEPR insulation	46
19.21.1	Procedure	46
19.21.2	Requirements	46
19.22	Shrinkage test for PE and halogen free oversheaths	46
19.22.1	Procedure	46
19.22.2	Requirements	46
19.23	Strippability test for insulation screen	46
19.23.1	General	46
19.23.2	Procedure	47
19.23.3	Requirements	47
19.24	Water penetration test	47
19.25	Additional tests on halogen free oversheath of type ST ₈	47
19.25.1	General	47
19.25.2	Water absorption test for halogen free oversheath of type ST ₈	48
19.25.3	Abrasion test on halogen free oversheath of type ST ₈	48
19.26	Bending test on interlock armour	48
20	Electrical tests after installation	48
20.1	General	48
20.2	DC voltage test of the oversheath	48
20.3	AC voltage test of the insulation	48
Annex A (normative) Fictitious calculation method for determination of dimensions of protective coverings		57
A.1	General	57
A.2	Method	57
A.2.1	Conductors	57
A.2.2	Cores	58
A.2.3	Diameter over laid-up cores	58
A.2.4	Inner coverings	58
A.2.5	Concentric conductors and metal screens	59
A.2.6	Lead sheath	60
A.2.7	Separation sheath	60

A.2.8	Lapped bedding	60
A.2.9	Additional bedding for tape-armoured cables (provided over the inner covering).....	61
A.2.10	Armour	61
Annex B (informative)	Tabulated continuous current ratings for cables having extruded insulation and a rated voltage from 3,6/6 kV up to 18/30 kV	62
B.1	General.....	62
B.2	Cable constructions	62
B.3	Temperatures	62
B.4	Soil thermal resistivity	63
B.5	Methods of installation	63
B.5.1	General	63
B.5.2	Single-core cables in air	63
B.5.3	Single-core cables buried direct.....	63
B.5.4	Single-core cables in earthenware ducts.....	64
B.5.5	Three-core cables.....	64
B.6	Screen bonding.....	65
B.7	Cable loading.....	65
B.8	Rating factors for grouped circuits	65
B.9	Correction factors	65
Annex C (normative)	Rounding of numbers	81
C.1	Rounding of numbers for the purpose of the fictitious calculation method.....	81
C.2	Rounding of numbers for other purposes	81
Annex D (normative)	Method of measuring resistivity of semi-conducting screens	82
Annex E (normative)	Determination of hardness of HEPR insulations	85
E.1	Test piece	85
E.2	Test procedure.....	85
E.2.1	General	85
E.2.2	Surfaces of large radius of curvature	85
E.2.3	Surfaces of small radius of curvature	85
E.2.4	Conditioning and test temperature	85
E.2.5	Number of measurements.....	86
Annex F (normative)	Water penetration test.....	87
F.1	Test piece	87
F.2	Test	87
F.3	Requirements	88
Annex G (informative)	Determination of the cable conductor temperature	89
G.1	Purpose	89
G.2	Calibration of the temperature of the main test loop	89
G.2.1	General	89
G.2.2	Installation of cable and temperature sensors	89
G.2.3	Calibration method	91
G.3	Heating for the test	92
G.3.1	Method 1 – Test using a reference cable	92
G.3.2	Method 2 – Test using conductor temperature calculations and measurement of the surface temperature	92
Annex H (normative)	Test for water penetration in the conductor	94
H.1	General.....	94

H.2	Test piece	94
H.3	Test	94
H.4	Requirements	94
Annex I (normative) Methods of determining the weighted value of halogen content of the non-metallic materials in the cable		96
I.1	Calculating the weighted value of the cable when the halogen content of individual materials is tested	96
I.2	Preparation of the test sample for measurement of halogen content on a sample representative of the non-metallic materials in the cable	96
Bibliography		97
Figure B.1 – Single-core cables in air		63
Figure B.2 – Single-core cables buried direct		64
Figure B.3 – Single-core cables in earthenware ducts		64
Figure B.4 – Three-core cables		65
Figure D.1 – Preparation of samples for measurement of resistivity of conductor and insulation screens		84
Figure E.1 – Test on surfaces of large radius of curvature		86
Figure E.2 – Test on surfaces of small radius of curvature		86
Figure F.1 – Schematic diagram of apparatus for water penetration test		88
Figure G.1 – Typical test set-up for the reference loop and the main test loop		90
Figure G.2 – Example of an arrangement of the temperature sensors on the conductor of the reference loop		91
Figure H.1 – Schematic diagram of apparatus for water penetration test in the conductor		95
Table 1 – Recommended rated voltages U_0		17
Table 2 – Insulating compounds		17
Table 3 – Maximum conductor temperatures for different types of insulating compound		18
Table 4 – Maximum conductor temperatures for different types of sheathing compound		18
Table 5 – Nominal thickness of PVC/B insulation		19
Table 6 – Nominal thickness of cross-linked polyethylene (XLPE) insulation		19
Table 7 – Nominal thickness of ethylene propylene rubber (EPR) and hard ethylene propylene rubber (HEPR) insulation		20
Table 8 – Thickness of extruded inner covering		21
Table 9 – Nominal diameter of round armour wires		26
Table 10 – Nominal thickness of armour tapes		26
Table 24 – Nominal thickness of armour strips		26
Table 11 – Routine test voltages		30
Table 12 – Number of samples for sample tests		31
Table 13 – Sample test voltages		33
Table 14 – Impulse voltages		37
Table 15 – Electrical type test requirements for insulating compounds		49
Table 16 – Non-electrical type tests (see Table 17 to Table 23 and Table 25)		49
Table 17 – Test requirements for mechanical characteristics of insulating compounds (before and after ageing)		50

Table 18 – Test requirements for particular characteristics for PVC insulating compound.....	51
Table 19 – Test requirements for particular characteristics of various crosslinked insulating compounds	52
Table 20 – Test requirements for mechanical characteristics of sheathing compounds (before and after ageing)	53
Table 21 – Test requirements for particular characteristics for PVC sheathing compounds	53
Table 22 – Test requirements for particular characteristics of PE (thermoplastic polyethylene) sheathing compounds	54
Table 23 – Test requirements for particular characteristics of elastomeric sheathing compound.....	54
Table 25 – Test requirements for particular characteristics of halogen free sheathing compounds	55
Table A.1 – Fictitious diameter of conductor	58
Table A.2 – Increase of diameter for concentric conductors and metal screens.....	59
Table A.3 – Increase of diameter for additional bedding.....	61
Table A.4 – Increase of diameter over interlocked armour.....	61
Table B.1 – Nominal screen cross-sectional areas	62
Table B.2 – Current ratings for single-core cables with XLPE insulation – Rated voltage 3,6/6 kV to 18/30 kV * – Copper conductor	66
Table B.3 – Current ratings for single-core cables with XLPE insulation – Rated voltage 3,6/6 kV to 18/30 kV * – Aluminium conductor.....	67
Table B.4 – Current ratings for single-core cables with EPR insulation – Rated voltage 3,6/6 kV to 18/30 kV * – Copper conductor	68
Table B.5 – Current ratings for single-core cables with EPR insulation – Rated voltage 3,6/6 kV to 18/30 kV * – Aluminium conductor.....	69
Table B.6 – Current rating for three-core XLPE insulated cables – Rated voltage 3,6/6 kV to 18/30 kV * – Copper conductor, armoured and unarmoured	70
Table B.7 – Current rating for three-core XLPE insulated cables – Rated voltage 3,6/6 kV to 18/30 kV * – Aluminium conductor, armoured and unarmoured.....	71
Table B.8 – Current rating for three-core EPR insulated cables – Rated voltage 3,6/6 kV to 18/30 kV * – Copper conductor, armoured and unarmoured	72
Table B.9 – Current rating for three-core EPR insulated cables – Rated voltage 3,6/6 kV to 18/30 kV * – Aluminium conductor, armoured and unarmoured.....	73
Table B.10 – Correction factors for ambient air temperatures other than 30 °C	73
Table B.11 – Correction factors for ambient ground temperatures other than 20 °C	74
Table B.12 – Correction factors for depths of laying other than 0,8 m for direct buried cables.....	74
Table B.13 – Correction factors for depths of laying other than 0,8 m for cables in ducts	74
Table B.14 – Correction factors for soil thermal resistivities other than 1,5 K·m/W for direct buried single-core cables	75
Table B.15 – Correction factors for soil thermal resistivities other than 1,5 K·m/W single-core cables in buried ducts	75
Table B.16 – Correction factors for soil thermal resistivities other than 1,5 K·m/W for direct buried three-core cables.....	76
Table B.17 – Correction factors for soil thermal resistivities other than 1,5 K·m/W for three-core cables in ducts.....	76

Table B.18 – Correction factors for groups of three-core cables in horizontal formation laid direct in the ground	77
Table B.19 – Correction factors for groups of three-phase circuits of single-core cables laid direct in the ground	77
Table B.20 – Correction factors for groups of three-core cables in single way ducts in horizontal formation	78
Table B.21 – Correction factors for groups of three-phase circuits of single-core cables in single-way ducts	78
Table B.22 – Reduction factors for groups of more than one multi-core cable in air – To be applied to the current-carrying capacity for one multi-core cable in free air	79
Table B.23 – Reduction factors for groups of more than one circuit of single-core cables (Note 2) – To be applied to the current-carrying capacity for one circuit of single-core cables in free air	80

INTERNATIONAL ELECTROTECHNICAL COMMISSION

POWER CABLES WITH EXTRUDED INSULATION AND THEIR ACCESSORIES FOR RATED VOLTAGES FROM 1 kV ($U_m = 1,2$ kV) UP TO 30 kV ($U_m = 36$ kV) –

Part 2: Cables for rated voltages from 6 kV ($U_m = 7,2$ kV) up to 30 kV ($U_m = 36$ kV)

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) IEC draws attention to the possibility that the implementation of this document may involve the use of (a) patent(s). IEC takes no position concerning the evidence, validity or applicability of any claimed patent rights in respect thereof. As of the date of publication of this document, IEC had not received notice of (a) patent(s), which may be required to implement this document. However, implementers are cautioned that this may not represent the latest information, which may be obtained from the patent database available at <https://patents.iec.ch>. IEC shall not be held responsible for identifying any or all such patent rights.

This consolidated version of the official IEC Standard and its amendment has been prepared for user convenience.

IEC 60502-2 edition 3.1 contains the third edition (2014-02) [documents 20/1469A/FDIS and 20/1472/RVD] and its amendment 1 (2024-05) [documents 20/2166/FDIS and 20/2181/RVD].

This Final version does not show where the technical content is modified by amendment 1. A separate Redline version with all changes highlighted is available in this publication.

International Standard IEC 60502-2 has been prepared by IEC technical committee 20: Electric cables.

This third edition cancels and replaces the second edition, published in 2005, and constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- a) a simplified calculation procedure for the thickness of the lead sheath and the oversheath;
- b) a new subclause for the determination of the cable conductor temperature;
- c) a modified procedure for the routine voltage test;
- d) a new subclause for a routine electrical test on oversheath;
- e) modified requirements for the non-metal sheaths including semi-conductive layer;
- f) modified tolerances for the bending test cylinder;
- g) the inclusion of a 0,1Hz test after installation.

In addition, the modified structure of the IEC 60811 series has been adopted for this third edition.

The following editorial changes have been made within the English version:

- 'metallic' has been replaced by 'metal';
- 'thermosetting' has been replaced by 'crosslinked'.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all parts in the IEC 60502 series, published under the general title *Power cables with extruded insulation and their accessories for rated voltages from 1kV ($U_m = 1,2$ kV) up to 30 kV ($U_m = 36$ kV)*, can be found on the IEC website.

The committee has decided that the contents of this document and its amendment will remain unchanged until the stability date indicated on the IEC website under webstore.iec.ch in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn, or
- revised.

**POWER CABLES WITH EXTRUDED INSULATION
AND THEIR ACCESSORIES FOR RATED VOLTAGES
FROM 1 kV ($U_m = 1,2$ kV) UP TO 30 kV ($U_m = 36$ kV) –**

**Part 2: Cables for rated voltages from 6 kV
($U_m = 7,2$ kV) up to 30 kV ($U_m = 36$ kV)**

1 Scope

This part of IEC 60502 specifies the construction, dimensions and test requirements of power cables with extruded solid insulation from 6 kV up to 30 kV for fixed installations such as distribution networks or industrial installations.

When determining applications, it is recommended that the possible risk of radial water ingress is considered. Cable designs with barriers claimed to prevent longitudinal water penetration and an associated test are included in this part of IEC 60502.

Cables for special installation and service conditions are not included, for example cables for overhead networks, the mining industry, nuclear power plants (in and around the containment area) nor for submarine use or shipboard application.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60038, *IEC standard voltages*

IEC 60060-1, *High-voltage test techniques – Part 1: General definitions and test requirements*

IEC 60060-3, *High-voltage test techniques – Part 3: Definitions and requirements for on-site testing*

IEC 60183, *Guide to the selection of high-voltage cables*

IEC 60228, *Conductors of insulated cables*

IEC 60229:2007, *Tests on cable oversheaths which have a special protective function and are applied by extrusion*

IEC 60230, *Impulse tests on cables and their accessories*

IEC 60287-3-1, *Electric cables – Calculation of the current rating – Part 3: Sections on operating conditions – Section 1: Reference operating conditions and selection of cable type*

IEC 60332-1-2, *Tests on electric and optical fibre cables under fire conditions – Part 1-2: Test for vertical flame propagation for a single insulated wire or cable – Procedure for 1 kW pre-mixed flame*

IEC 60332-3-24, *Tests on electric and optical fibre cables under fire conditions – Part 3-24: Test for vertical flame spread of vertically-mounted bunched wires or cables – Category C*

IEC 60684-2, *Flexible insulating sleeving – Part 2: Methods of test*

IEC 60754-1, *Test on gases evolved during combustion of materials from cables – Part 1: Determination of the halogen acid gas content*

IEC 60754-2, *Test on gases evolved during combustion of materials from cables – Part 2: Determination of acidity (by pH measurement) and conductivity*

IEC 60754-3, *Test on gases evolved during combustion of materials from cables – Part 3: Measurement of low level of halogen content by ion chromatography*

IEC 60811 (all parts), *Electric and optical fibre cables – Test methods for non-metallic materials*

IEC 60811-201, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 201: General tests – Measurement of insulation thickness*

IEC 60811-202, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 202: General tests – Measurement of thickness of non-metallic sheath*

IEC 60811-203, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 203: General tests – Measurement of overall dimensions*

IEC 60811-401, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 401: Miscellaneous tests – Thermal ageing methods – Ageing in an air oven*

IEC 60811-402, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 402: Miscellaneous tests – Water absorption tests*

IEC 60811-403, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 403: Miscellaneous tests – Ozone resistance test on cross-linked compounds*

IEC 60811-404, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 404: Miscellaneous tests – Mineral oil immersion tests for sheaths*

IEC 60811-405, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 405: Miscellaneous tests – Thermal stability test for PVC insulations and PVC sheaths*

IEC 60811-409, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 409: Miscellaneous tests – Loss of mass test for thermoplastic insulations and sheaths*

IEC 60811-501, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 501: Mechanical tests – Tests for determining the mechanical properties of insulating and sheathing compounds*

IEC 60811-502, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 502: Mechanical tests – Shrinkage test for insulations*

IEC 60811-503, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 503: Mechanical tests – Shrinkage test for sheaths*

IEC 60811-504, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 504: Mechanical tests – Bending tests at low temperature for insulation and sheaths*

IEC 60811-505, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 505: Mechanical tests – Elongation at low temperature for insulations and sheaths*

IEC 60811-506, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 506: Mechanical tests – Impact test at low temperature for insulations and sheaths*

IEC 60811-507, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 507: Mechanical tests – Hot set test for cross-linked materials*

IEC 60811-508, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 508: Mechanical tests – Pressure test at high temperature for insulation and sheaths*

IEC 60811-509, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 509: Mechanical tests – Test for resistance of insulations and sheaths to cracking (heat shock test)*

IEC 60811-605, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 605: Physical tests – Measurement of carbon black and/or mineral filler in polyethylene compounds*

IEC 60811-606, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 606: Physical tests – Methods for determining the density*

IEC 60853 (all parts), *Calculation of the cyclic and emergency current rating of cables*

IEC 60853-2, *Calculation of the cyclic and emergency current rating of cables – Part 2: Cyclic rating of cables greater than 18/30 (36) kV and emergency ratings for cables of all voltages*

IEC 60885-3, *Electrical test methods for electric cables – Part 3: Test methods for partial discharge measurements on lengths of extruded power cables*

IEC 60986, *Short-circuit temperature limits of electric cables with rated voltages from 6 kV ($U_m = 7,2$ kV) up to 30 kV ($U_m = 36$ kV)*

IEC 61034-2, *Measurement of smoke density of cables burning under defined conditions – Part 2: Test procedure and requirements*

ISO 48, *Rubber, vulcanized or thermoplastic – Determination of hardness (hardness between 10 IRHD and 100 IRHD)*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

3.1 Definitions of dimensional values (thicknesses, cross-sections, etc.)

3.1.1

nominal value

value by which a quantity is designated and which is often used in tables

Note 1 to entry: Usually, in this standard, nominal values give rise to values to be checked by measurements taking into account specified tolerances.

3.1.2**approximate value**

value which is neither guaranteed nor checked; it is used, for example, for the calculation of other dimensional values

3.1.3**median value**

when several test results have been obtained and ordered in an increasing (or decreasing) succession, the median value is the middle value if the number of available values is odd, and the mean of the two middle values if the number is even

3.1.4**fictitious value**

value calculated according to the "fictitious method" described in Annex A

3.2 Definitions concerning the tests**3.2.1****routine tests**

tests made by the manufacturer on each manufactured length of cable to check that each length meets the specified requirements

3.2.2**sample tests**

tests made by the manufacturer on samples of completed cable or components taken from a completed cable, at a specified frequency, so as to verify that the finished product meets the specified requirements

3.2.3**type tests**

tests made before supplying, on a general commercial basis, a type of cable covered by this standard, in order to demonstrate satisfactory performance characteristics to meet the intended application

Note 1 to entry: These tests are of such a nature that, after they have been made, they need not be repeated, unless changes are made in the cable materials or design or manufacturing process which might change the performance characteristics.

3.2.4**electrical tests after installation**

tests made to demonstrate the integrity of the cable and its accessories as installed

4 Voltage designations and materials**4.1 Rated voltages**

The rated voltages $U_0/U(U_m)$ of the cables considered in this standard are as follows:

$$U_0/U(U_m) = 3,6/6 (7,2) - 6/10 (12) - 8,7/15 (17,5) - 12/20 (24) - 18/30 (36) \text{ kV.}$$

NOTE The voltages given above are the correct designations although in some countries other designations are used, e.g. 3,5/6 – 5,8/10 – 11,5/20 – 17,3/30 kV.

In the voltage designation of cables $U_0/U(U_m)$:

U_0 is the rated power frequency voltage between conductor and earth or metal screen for which the cable is designed;

U is the rated power frequency voltage between conductors for which the cable is designed;

U_m is the maximum value of the "highest system voltage" for which the equipment may be used (see IEC 60038).

The rated voltage of the cable for a given application shall be suitable for the operating conditions in the system in which the cable is used. To facilitate the selection of the cable, systems are divided into three categories:

- category A: this category comprises those systems in which any phase conductor that comes in contact with earth or an earth conductor is disconnected from the system within 1 min;
- category B: this category comprises those systems which, under fault conditions, are operated for a short time with one phase earthed. This period, according to IEC 60183, should not exceed 1 h. For cables covered by this standard, a longer period, not exceeding 8 h on any occasion, can be tolerated. The total duration of earth faults in any year should not exceed 125 h;
- category C: this category comprises all systems which do not fall into category A or B.

It should be realized that in a system where an earth fault is not automatically and promptly isolated, the extra stresses on the insulation of cables during the earth fault reduce the life of the cables to a certain degree. If the system is expected to be operated fairly often with a permanent earth fault, it may be advisable to classify the system in category C.

The values of U_0 recommended for cables to be used in three-phase systems are listed in Table 1.

Table 1 – Recommended rated voltages U_0

Highest system voltage (U_m) kV	Rated voltage (U_0) kV	
	Categories A and B	Category C
7,2	3,6	6,0
12,0	6,0	8,7
17,5	8,7	12,0
24,0	12,0	18,0
36,0	18,0	–

4.2 Insulating compounds

The types of insulating compound covered by this standard are listed in Table 2, together with their abbreviated designations.

Table 2 – Insulating compounds

Insulating compound	Abbreviated designation
a) <i>Thermoplastic</i> polyvinyl chloride intended for cables with rated voltages $U_0/U = 3,6/6$ kV	PVC/B*
b) <i>Crosslinked</i> : ethylene propylene rubber or similar (EPM or EPDM) high modulus or hard grade ethylene propylene rubber cross-linked polyethylene	EPR HEPR XLPE
* Insulating compound based on polyvinyl chloride intended for cables with rated voltages $U_0/U \leq 1,8/3$ kV is designated PVC/A in IEC 60502-1.	

The maximum conductor temperatures for different types of insulating compound covered by this standard are given in Table 3.

Table 3 – Maximum conductor temperatures for different types of insulating compound

Insulating compound		Maximum conductor temperature °C	
		Normal operation	Short-circuit (5 s maximum duration)
Polyvinyl chloride (PVC/B)	Conductor cross-section $\leq 300 \text{ mm}^2$	70	160
	Conductor cross-section $> 300 \text{ mm}^2$	70	140
Cross-linked polyethylene (XLPE)		90	250
Ethylene propylene rubber (EPR and HEPR)		90	250

The temperatures in Table 3 are based on the intrinsic properties of the insulating materials. It is important to take into account other factors when using these values for the calculation of current ratings.

For example, in normal operation, if a cable directly buried in the ground is operated under continuous load (100 % load factor) at the maximum conductor temperature shown in the table, the thermal resistivity of the soil surrounding the cable may, in the course of time, increase from its original value as a result of drying-out processes. As a consequence, the conductor temperature may greatly exceed the maximum value. If such operating conditions are foreseen, adequate provisions shall be made.

For guidance on continuous current ratings, reference should be made to Annex B, including the ratings under standard laying conditions, in Tables B.2 to B.9, and correction factors for deviation laying conditions, in Tables B.10 to B.23.

For guidance on the short-circuit temperatures, reference should be made to IEC 60986.

4.3 Sheathing compounds

The maximum conductor temperatures for the different types of sheathing compound covered by this standard are given in Table 4.

Table 4 – Maximum conductor temperatures for different types of sheathing compound

Sheathing compound	Abbreviated designation	Maximum conductor temperature in normal operation °C
a) <i>Thermoplastic</i> :		
polyvinyl chloride (PVC)	ST ₁	80
	ST ₂	90
polyethylene	ST ₃	80
	ST ₇	90
halogen free	ST ₈	90
	ST ₁₂	90
b) <i>Elastomeric</i> :		
polychloroprene, chlorosulfonated polyethylene or similar polymers	SE ₁	85

5 Conductors

The conductors shall be either of class 1 or class 2 of plain or metal-coated annealed copper or of plain aluminium or aluminium alloy in accordance with IEC 60228. For class 2 conductors measures may be taken to achieve longitudinal watertightness.

6 Insulation

6.1 Material

Insulation shall be extruded dielectric of one of the types listed in Table 2.

6.2 Insulation thickness

The nominal insulation thicknesses are specified in Tables 5 to 7.

The thickness of any separator or semi-conducting screen on the conductor or over the insulation shall not be included in the thickness of the insulation.

Table 5 – Nominal thickness of PVC/B insulation

Nominal cross-sectional area of conductor mm ²	Nominal thickness of insulation at rated voltage 3,6/6 (7,2) kV mm
10 to 1 600	3,4

NOTE 1 Any smaller conductor cross-section than those given in this table is not recommended. However, if a smaller cross-section is needed, either the diameter of the conductor may be increased by a conductor screen (see 7.2), or the insulation thickness may be increased in order to limit, at the values calculated with the smallest conductor size given in this table, the maximum electrical stresses applied to the insulation under test voltage.

NOTE 2 For conductor cross-sections larger than 1 000 mm², the insulation thickness may be increased to avoid any mechanical damage during installation and service.

Table 6 – Nominal thickness of cross-linked polyethylene (XLPE) insulation

Nominal cross-sectional area of conductor mm ²	Nominal thickness of insulation at rated voltage U_0/U (U_m)				
	3,6/6 (7,2) kV mm	6/10 (12) kV mm	8,7/15 (17,5) kV mm	12/20 (24) kV mm	18/30 (36) kV mm
10	2,5	–	–	–	–
16	2,5	3,4	–	–	–
25	2,5	3,4	4,5	–	–
35	2,5	3,4	4,5	5,5	–
50 to 185	2,5	3,4	4,5	5,5	8,0
240	2,6	3,4	4,5	5,5	8,0
300	2,8	3,4	4,5	5,5	8,0
400	3,0	3,4	4,5	5,5	8,0
500 to 1 600	3,2	3,4	4,5	5,5	8,0

NOTE 1 Any smaller conductor cross-section than those given in this table is not recommended. However, if a smaller cross-section is needed, either the diameter of the conductor may be increased by a conductor screen (see 7.2), or the insulation thickness may be increased in order to limit, at the values calculated with the smallest conductor size given in this table, the maximum electrical stresses applied to the insulation under test voltage.

NOTE 2 For conductor cross-sections larger than 1 000 mm², the insulation thickness may be increased to avoid any mechanical damage during installation and service.

**Table 7 – Nominal thickness of ethylene propylene rubber (EPR)
and hard ethylene propylene rubber (HEPR) insulation**

Nominal cross-sectional area of conductor mm ²	Nominal thickness of insulation at rated voltage U_0/U (U_m)					
	3,6/6 (7,2) kV		6/10 (12) kV	8,7/15 (17,5) kV	12/20 (24) kV	18/30 (36) kV
	Unscreened mm	Screened mm	mm	mm	mm	mm
10	3,0	2,5	–	–	–	–
16	3,0	2,5	3,4	–	–	–
25	3,0	2,5	3,4	4,5	–	–
35	3,0	2,5	3,4	4,5	5,5	–
50 to 185	3,0	2,5	3,4	4,5	5,5	8,0
240	3,0	2,6	3,4	4,5	5,5	8,0
300	3,0	2,8	3,4	4,5	5,5	8,0
400	3,0	3,0	3,4	4,5	5,5	8,0
500 to 1 600	3,2	3,2	3,4	4,5	5,5	8,0

NOTE 1 Any smaller conductor cross-section than those given in this table is not recommended. However, if a smaller cross-section is needed, either the diameter of the conductor may be increased by a conductor screen (see 7.2), or the insulation thickness may be increased in order to limit, at the values calculated with the smallest conductor size given in this table, the maximum electrical stresses applied to the insulation under test voltage.

NOTE 2 For conductor cross-sections larger than 1 000 mm², the insulation thickness may be increased to avoid any mechanical damage during installation and service.

7 Screening

7.1 General

All cables shall have a metal layer surrounding the cores, either individually or collectively.

Screening of individual cores in single or three-core cables, when required, shall consist of a conductor screen and an insulation screen. These shall be employed in all cables with the following exceptions:

- at rated voltage 3,6/6 (7,2) kV cables insulated with EPR and HEPR may be unscreened, provided the larger insulation thickness in Table 7 is used;
- at rated voltage 3,6/6 (7,2) kV cables insulated with PVC shall be unscreened.

7.2 Conductor screen

The conductor screen shall be non-metal and shall consist of an extruded semi-conducting compound, which may be applied on top of a semi-conducting tape. The extruded semi-conducting compound shall be firmly bonded to the insulation.

7.3 Insulation screen

The insulation screen shall consist of a non-metal, semi-conducting layer in combination with a metal layer.

The non-metal layer shall be extruded directly upon the insulation of each core and consist of either a bonded or strippable semi-conducting compound.

A layer of semi-conducting tape or compound may then be applied over the individual cores or the core assembly.

The metal layer shall be applied over either the individual cores or the core assembly collectively and shall comply with the requirements of Clause 10.

8 Assembly of three-core cables, inner coverings and fillers

8.1 General

The assembly of three-core cables depends on the rated voltage and whether a metal screen is applied to each core.

Subclauses 8.2 to 8.4 do not apply to assemblies of sheathed single-core cables.

8.2 Inner coverings and fillers

8.2.1 Construction

The inner coverings may be extruded or lapped.

For cables with circular cores, a lapped inner covering shall be permitted only if the interstices between the cores are substantially filled.

A suitable binder is permitted before application of an extruded inner covering.

8.2.2 Material

The materials used for inner coverings and fillers shall be suitable for the operating temperature of the cable and compatible with the insulating material.

8.2.3 Thickness of extruded inner covering

The approximate thickness of extruded inner coverings shall be derived from Table 8.

Table 8 – Thickness of extruded inner covering

Fictitious diameter over laid-up cores		Thickness of extruded inner covering (approximate values) mm
Above mm	Up to and including mm	
–	25	1,0
25	35	1,2
35	45	1,4
45	60	1,6
60	80	1,8
80	–	2,0

8.2.4 Thickness of lapped inner covering

The approximate thickness of lapped inner coverings shall be 0,4 mm for fictitious diameters over laid-up cores up to and including 40 mm and 0,6 mm for larger diameters.

8.3 Cables having a collective metal layer (see Clause 9)

Cables shall have an inner covering over the laid-up cores. The inner covering and fillers shall comply with 8.2 and shall be non-hygroscopic except if the cable is claimed to be longitudinally watertight.

For cables having a semi-conducting screen over each individual core and a collective metal layer, the inner covering shall be semi-conducting; the fillers may be semi-conducting.

8.4 Cables having a metal layer over each individual core (see Clause 10)

The metal layers of the individual cores shall be in contact with each other.

Cables with an additional collective metal layer (see Clause 9) of the same material as the underlying individual metal layers shall have an inner covering over the laid-up cores. The inner covering and fillers shall comply with 8.2 and shall be non-hygroscopic except if the cable is claimed to be longitudinally watertight. The inner covering and fillers may be semi-conducting.

When the underlying individual metal layers and the collective metal layer are of different materials, they shall be separated by an extruded sheath of one of the materials specified in 14.2. For lead sheathed cables, the separation from the underlying individual metal layers may be obtained by an inner covering according to 8.2.

For cables without a collective metal layer (see Clause 9), the inner covering may be omitted provided the outer shape of the cable remains practically circular.

9 Metal layers for single-core and three-core cables

The following types of metal layers are included in this standard:

- a) metal screen (see Clause 10);
- b) concentric conductor (see Clause 11);
- c) metal sheath (see Clause 12);
- d) metal armour (see Clause 13).

The metal layer(s) shall comprise one or more of the types listed above and shall be non-magnetic when applied to either single-core cables or individual cores of three-core cables.

Measures may be taken to achieve longitudinal watertightness in the region of the metal layers.

10 Metal screen

10.1 Construction

The metal screen shall consist of one or more tapes, or a braid, or a concentric layer of wires or a combination of wires and tape(s).

It may also be a sheath or, in the case of a collective screen, an armour which complies with 10.2.

When choosing the material of the screen, special consideration shall be given to the possibility of corrosion, not only for mechanical safety but also for electrical safety.

Gaps in the screen shall comply with the national regulations and/or standards.

10.2 Requirements

The dimensional, physical and electrical requirements of the metal screen shall be determined by national regulations and/or standards.

10.3 Metal screens not associated with semi-conducting layers

Where metal screens are employed at rated voltage of 3,6/6 (7,2) kV with PVC, EPR and HEPR insulations, these need not be associated with semi-conducting layers.

11 Concentric conductor

11.1 Construction

Gaps in the concentric conductor shall comply with national regulations and/or standards.

When choosing the material of the concentric conductor, special consideration shall be given to the possibility of corrosion, not only for mechanical safety but also for electrical safety.

11.2 Requirements

The dimensional and physical requirements of the concentric conductor and its electrical resistance shall be determined by national regulations and/or standards.

11.3 Application

When a concentric conductor is required, it shall be applied over the inner covering in the case of three-core cables; in the case of single-core cables, it shall be applied either directly over the insulation or over the semi-conducting insulation screen or over a suitable inner covering.

12 Metal sheath

12.1 Lead sheath

The sheath shall consist of lead or lead alloy and shall be applied as a reasonably tight-fitting seamless tube.

The nominal thickness shall be calculated by the following formula:

$$t_{pb} = 0,03 D_g + 0,7$$

where

t_{pb} is the nominal thickness of the lead sheath, in millimetres;

D_g is the fictitious diameter under the lead sheath, in millimetres (rounded to the first decimal place in accordance with Annex C).

In all cases, the smallest nominal thickness shall be 1,2 mm. Calculated values shall be rounded to the first decimal place (see Annex C).

12.2 Other metal sheaths

Under consideration.

13 Metal armour

13.1 Types of metal armour

The armour types covered by this standard are as follows:

- a) flat wire armour;
- b) round wire armour;
- c) double tape armour;
- d) interlock metal tape armour.

13.2 Materials

Round or flat wires shall be of galvanized steel, copper or tinned copper, aluminium or aluminium alloy.

Tapes shall be of steel, galvanized steel, aluminium or aluminium alloy. Steel tapes shall be hot or cold rolled of commercial quality.

NOTE Other metal materials can be used upon agreement between the manufacturer and customer.

In those cases where the steel armour wire layer is required to comply with a minimum conductance, it is permissible to include sufficient copper or tinned copper wires in the armour layer to ensure compliance.

When choosing the material of the armour, special consideration shall be given to the possibility of corrosion, not only for mechanical safety, but also for electrical safety, especially when the armour is used as a screen.

The armour of single-core cables for use on a.c. systems shall consist of non-magnetic material, unless a special construction is chosen.

13.3 Application of armour

13.3.1 Single-core cables

In the case of single-core cables, an inner covering, extruded or lapped, of the thickness specified in 8.2.3 or 8.2.4, shall be applied under the armour if there is no screen.

13.3.2 Three-core cables

When an armour is required in the case of three-core cables, it shall be applied on an inner covering complying with 8.2.

13.3.3 Separation sheath

When the underlying metal layer and the armour are of different materials, they shall be separated by an extruded sheath of one of the materials specified in 14.2.

When an armour is required for a lead-sheathed cable, it may be applied over a separation sheath or a lapped bedding according to 13.3.4.

If a separation sheath is used, it shall be applied under the armour instead of, or in addition to, the inner covering.

A separation sheath is not required when measures have been taken to achieve longitudinal watertightness in the region of the metal layers.

The nominal thickness of the separation sheath T_s expressed in millimetres shall be calculated by the following formula:

$$T_s = 0,02 D_u + 0,6$$

where D_u is the fictitious diameter under this sheath, in millimetres, calculated as described in Annex A.

The value resulting from the formula shall be rounded off to the nearest 0,1 mm (see Annex C).

For cables without a lead sheath, the nominal thickness shall be not less than 1,2 mm. For cables where the separation sheath is applied directly over the lead sheath, the nominal thickness shall be not less than 1,0 mm.

13.3.4 Lapped bedding under armour for lead sheathed cables

The lapped bedding applied to the compound coated lead sheath shall consist of either impregnated and compounded paper tapes or a combination of two layers of impregnated and compounded paper tapes followed by one or more layers of compounded fibrous material.

The impregnation of bedding materials may be made with bituminous or other preservative compounds. In case of wire armour, these compounds shall not be applied directly under the wires.

Synthetic tapes may be applied instead of impregnated paper tapes.

The total thickness of the lapped bedding between the lead sheath and the armour after application of the armour shall have an approximate value of 1,5 mm.

13.4 Dimensions of the armour wires, armour tapes and armour strips

The nominal dimensions of the armour wires, armour tapes and armour strips shall be one of the following values:

round wires:

0,8 – 1,25 – 1,6 – 2,0 – 2,5 – 3,15 mm diameter;

flat wires:

0,8 mm thickness;

tapes of steel:

0,2 – 0,5 – 0,8 mm thickness;

tapes of aluminium or aluminium alloy:

0,5 – 0,8 mm thickness;

strips of the interlocked armour:

0,65 – 0,90 – 1,05 mm thickness (before forming).

13.5 Correlation between cable diameters and armour dimensions

The nominal diameters of round armour wires, nominal thickness of armour tapes and the thickness of armour strips, shall not be less than the values given in Table 9, Table 10 and Table 24 respectively.

Table 9 – Nominal diameter of round armour wires

Fictitious diameter under the armour		Nominal diameter of armour wire mm
Above mm	Up to and including mm	
–	10	0,8
10	15	1,25
15	25	1,6
25	35	2,0
35	60	2,5
60	–	3,15

Table 10 – Nominal thickness of armour tapes

Fictitious diameter under the armour		Nominal thickness of tape	
Above mm	Up to and including mm	Steel or galvanized steel mm	Aluminium or aluminium alloy mm
–	30	0,2	0,5
30	70	0,5	0,5
70	–	0,8	0,8

Table 24 – Nominal thickness of armour strips

Fictitious diameter under interlock armour		Nominal thickness of strip (before forming) mm
Above mm	Up to and including mm	
–	20	0,65
20	40	0,90
40	–	1,05

For flat wire armour and fictitious diameters under armour greater than 15 mm, the nominal thickness of the flat steel wire shall be 0,8 mm. Cables with fictitious diameters under the armour up to and including 15 mm shall not be armoured with flat wires.

13.6 Round or flat wire armour

The wire armour shall be closed, i.e. with a minimum gap between adjacent wires. An open helix consisting of galvanized steel tape with a nominal thickness of at least 0,3 mm may be provided over flat steel wire armour and over round steel wire armour, if necessary. Tolerances on this steel tape shall comply with 17.7.3.

13.7 Double tape armour

When a tape armour and an inner covering as specified in 8.2 are used, the inner covering shall be reinforced by a taped bedding. The total thickness of the inner covering and the additional taped bedding shall be as given in 8.2 plus 0,5 mm if the armour tape thickness is 0,2 mm, and plus 0,8 mm if the armour tape thickness is more than 0,2 mm.

The total thickness of the inner covering and the additional taped bedding shall be not less than these values by more than 0,2 mm with a tolerance of +20 %.

If a separation sheath is required or if the inner covering is extruded and satisfies the requirements of 13.3.3, the additional taped bedding is not required.

The tape armour shall be applied helically in two layers so that the outer tape is approximately central over the gap of the inner tape. The gap between adjacent turns of each tape shall not exceed 50 % of the width of the tape.

13.8 Interlock metal tape armour

Interlocking armour is the process of continuously forming a metal strip(s) into helical coil(s) in which the leading edge of the formed strip engages with the trailing edge of the adjacent strip to form a continuous flexible tube which is applied over the underlying cable layer (assembly of cores, bedding, or separation sheath).

The interlocked metal tape armour shall, with the oversheath removed, allow bending without opening at any point or damaging the cable when bent around a mandrel having a diameter not more than 10 times the diameter over the armour.

14 Oversheath

14.1 General

All cables shall have an oversheath.

The oversheath is normally black but a colour other than black may be provided by agreement between the manufacturer and customer, subject to its suitability for the particular conditions under which the cable is to be used.

If there is concern that the oversheath will be deteriorated by UV radiation, the oversheath shall be protected against UV radiation, which will be mutually agreed with the customer. Black polyethylene oversheaths containing the required amount of a suitable and well-dispersed grade of carbon black (see Table 22) can provide protection against UV radiation depending on geographical regions and meteorological conditions.

NOTE 1 For some applications the oversheath can be covered by a functional layer (e.g. semi-conductive).

NOTE 2 Halogen free fire retardant oversheaths are not intended for installations outdoors and are not normally considered as UV protected.

14.2 Material

The oversheath shall consist of an extruded compound selected from the types listed in Table 4.

Halogen free sheathing material ST₈ or ST₁₂ shall be used on cables which exhibit properties of reduced flame spread, low levels of smoke emission and halogen free gas emission when exposed to fire. The oversheath (ST₈ or ST₁₂) of halogen free cables shall meet the requirements given in Table 20 and Table 25.

These two oversheath material grades have different mechanical requirements. They depend on installation conditions and cable designs, and on which of these two are suitable. Further guidance on selection can be given in regional or national standards.

The sheathing material shall be suitable for the operating temperature in accordance with Table 4.

NOTE Chemical additives can be requested for use in the oversheath for special purposes, for example termite protection.

14.3 Thickness

Unless otherwise specified the nominal thickness t_s expressed in millimetres shall be calculated by the following formula:

$$t_s = 0,035 D + 1,0$$

where D is the fictitious diameter immediately under the oversheath, in millimetres (see Annex A).

The value resulting from the formula shall be rounded off to the nearest 0,1 mm (see Annex C).

The nominal thickness shall be not less than 1,4 mm for single-core cables and not less than 1,8 mm for multicore cables.

15 Test conditions

15.1 Ambient temperature

Unless otherwise specified in the details for the particular test, tests shall be made at an ambient temperature of $(20 \pm 15) ^\circ\text{C}$.

15.2 Frequency and waveform of power frequency test voltages

The frequency of the alternating test voltages shall be in the range 49 Hz to 61 Hz. The waveform shall be substantially sinusoidal. The values quoted are r.m.s. values.

15.3 Waveform of impulse test voltages

In accordance with IEC 60230, the impulse wave shall have a virtual front time between 1 μs and 5 μs and a nominal time to half the peak value between 40 μs and 60 μs . In other respects, it shall be in accordance with IEC 60060-1.

15.4 Determination of the cable conductor temperature

It is recommended that one of the test methods described in Annex G is used to determine the actual temperature.

16 Routine tests

16.1 General

Routine tests are normally carried out on each manufactured length of cable (see 3.2.1). The number of lengths to be tested may however be reduced or an alternative test method adopted, according to agreed quality control procedures.

The routine tests required by this standard are as follows:

- a) measurement of the electrical resistance of conductors (see 16.2);
- b) partial discharge test (see 16.3) on cables having cores with conductor screens and insulation screens in accordance with 7.2 and 7.3;
- c) voltage test (see 16.4).

d) electrical test on oversheath, if required (see 16.5).

16.2 Electrical resistance of conductors

Resistance measurements shall be made on all conductors of each cable length submitted to the routine tests, including the concentric conductor, if any.

The complete cable length, or a sample from it, shall be placed in the test room, which shall be maintained at a reasonably constant temperature, for at least 12 h before the test. In case of doubt as to whether the conductor temperature is the same as the room temperature, the resistance shall be measured after the cable has been in the test room for 24 h. Alternatively, the resistance can be measured on a sample of conductor conditioned for at least 1 h in a temperature-controlled liquid bath.

The measured value of resistance shall be corrected to a temperature of 20 °C and 1 km length in accordance with the formulae and factors given in IEC 60228.

The d.c. resistance of each conductor at 20 °C shall not exceed the appropriate maximum value specified in IEC 60228. For concentric conductors, the resistance shall comply with national regulations and/or standards.

16.3 Partial discharge test

The partial discharge test shall be carried out in accordance with IEC 60885-3, except that the sensitivity as defined in IEC 60885-3 shall be 10 pC or better.

For three-core cables, the test shall be carried out on all insulated cores, the voltage being applied between each conductor and the screen.

The test voltage shall be raised gradually to and held at $2 U_0$ for 10 s and then slowly reduced to $1,73 U_0$.

There shall be no detectable discharge exceeding the declared sensitivity from the test object at $1,73 U_0$.

NOTE Any partial discharge from the test object may be harmful.

16.4 Voltage test

16.4.1 General

The voltage test shall be made at ambient temperature, using alternating voltage at power frequency.

16.4.2 Test procedure for single-core cables

For single-core cables, the test voltage shall be applied for 5 min between the conductor and the metal screen.

16.4.3 Test procedure for three-core cables

For three-core cables with individually screened cores, the test voltage shall be applied for 5 min between each conductor and the metal layer.

For three-core cables without individually screened cores, the test voltage shall be applied for 5 min in succession between each insulated conductor and all the other conductors and collective metal layers.

Three-core cables may be tested in a single operation by using a three-phase transformer.

16.4.4 Test voltage

The power frequency test voltage shall be $3,5 U_0$. Values of the single-phase test voltage for the standard rated voltages are given in Table 11.

Table 11 – Routine test voltages

Rated voltage U_0	kV	3,6	6	8,7	12	18
Test voltage	kV	12,5	21	30,5	42	63

If, for three-core cables, the voltage test is carried out with a three-phase transformer, the test voltage between the phases shall be 1,73 times the values given in this table.

In all cases, the test voltage shall be increased gradually to the specified value.

16.4.5 Requirement

No breakdown of the insulation shall occur.

16.5 Electrical test on oversheath of the cable

If agreed between customer and supplier the cable shall be subjected to the electrical test specified in 3.2 of IEC 60229:2007.

Cables having an extruded semi-conductive layer on the oversheath shall be excluded and the d.c. voltage test specified in 3.1 of IEC 60229:2007 may be applied.

17 Sample tests

17.1 General

The sample tests required by this standard are as follows:

- conductor examination (see 17.4);
- check of dimensions (see 17.5 to 17.8);
- voltage test for cables of rated voltage above 3,6/6 (7,2) kV (see 17.9);
- hot set test for EPR, HEPR and XLPE insulations and elastomeric sheaths (see 17.10);
- bending test on interlock armour cable followed by examination (see 17.11).

17.2 Frequency of sample tests

17.2.1 Conductor examination and check of dimensions

Conductor examination, measurement of the thickness of insulation and sheath and measurement of the overall diameter shall be made on one length from each manufacturing series of the same type and nominal cross-section of cable, but shall be limited to not more than 10 % of the number of lengths in any contract.

17.2.2 Electrical and physical tests

Electrical and physical tests shall be carried out on samples taken from manufactured cables according to agreed quality control procedures. In the absence of such an agreement, for contracts where the total length exceeds 2 km for three-core cables, or 4 km for single-core cables, tests shall be made on the basis of Table 12.

Table 12 – Number of samples for sample tests

Cable length				Number of samples
Multicore cables		Single-core cables		
Above km	Up to and including km	Above km	Up to and including km	
2	10	4	20	1
10	20	20	40	2
20	30	40	60	3
etc.		etc.		etc.

17.3 Repetition of tests

If any sample fails in any of the tests in Clause 17, two further samples shall be taken from the same batch and submitted to the same test or tests in which the original sample failed. If both additional samples pass the tests, all the cables in the batch from which they were taken shall be regarded as complying with the requirements of this standard. If either of the additional samples fails, the batch from which they were taken shall be regarded as failing to comply.

17.4 Conductor examination

Compliance with the requirements for conductor construction of IEC 60228 shall be checked by inspection and by measurement, when practicable.

17.5 Measurement of thickness of insulation and of non-metal sheaths (including extruded separation sheaths, but excluding inner extruded coverings)

17.5.1 General

The test method shall be in accordance with IEC 60811-201 and IEC 60811-202.

Each cable length selected for the test shall be represented by a piece of cable taken from one end after having discarded, if necessary, any portion which may have suffered damage.

17.5.2 Requirements for the insulation

For each piece of core, the smallest value measured shall not fall below 90 % of the nominal value by more than 0,1 mm, i.e.:

$$t_{\min} \geq 0,9 t_n - 0,1$$

and additionally:

$$(t_{\max} - t_{\min}) / t_{\max} \leq 0,15$$

where

$t_{\max}$ is the maximum thickness, in millimetres;

$t_{\min}$ is the minimum thickness, in millimetres;

t_n is the nominal thickness, in millimetres.

NOTE $t_{\max}$ and $t_{\min}$ are measured at the same cross-section.

17.5.3 Requirements for the non-metal sheaths

If an extruded semi-conductive outer layer is used and it is fully bonded to the non-metal sheath, a thickness up to 0,3 mm of the semi-conductive layer can be accepted as a part of the sheath thickness. The sheath including the semi-conductive outer layer shall fulfil the same mechanical requirements as required for the sheath compound type specified, no matter how the dumbbell has been prepared.

The minimum thickness of the non-metal sheath shall not fall below 80 % of the nominal value by more than 0,2 mm, i.e.

$$t_{\min} \geq 0,8 t_n - 0,2$$

17.6 Measurement of thickness of lead sheath

17.6.1 General

The minimum thickness of the lead sheath shall be determined by one of the following methods, at the discretion of the manufacturer, and shall not fall below 95 % of the nominal thickness by more than 0,1 mm i.e.:

$$t_{\min} \geq 0,95 t_n - 0,1$$

NOTE Methods of measuring thickness of other types of metal sheath are under consideration.

17.6.2 Strip method

The measurement shall be made with a micrometer with plane faces of 4 mm to 8 mm diameter and an accuracy of $\pm 0,01$ mm.

The measurement shall be made on a test piece of sheath about 50 mm in length removed from the completed cable. The piece shall be slit longitudinally and carefully flattened. After cleaning the test piece, a sufficient number of measurements shall be made along the circumference of the sheath and not less than 10 mm away from the edge of the flattened piece to ensure that the minimum thickness is measured.

17.6.3 Ring method

The measurements shall be made with a micrometer having either one flat nose and one ball nose, or one flat nose and a flat rectangular nose 0,8 mm wide and 2,4 mm long. The ball nose or the flat rectangular nose shall be applied to the inside of the ring. The accuracy of the micrometer shall be $\pm 0,01$ mm.

The measurements shall be made on a ring of the sheath carefully cut from the sample. The thickness shall be determined at a sufficient number of points around the circumference of the ring to ensure that the minimum thickness is measured.

17.7 Measurement of armour wires, tapes and armour strips

17.7.1 Measurement on wires

The diameter of round wires and the thickness of flat wires shall be measured by means of a micrometer having two flat noses to an accuracy of $\pm 0,01$ mm. For round wires, two measurements shall be made at right angles to each other at the same position and the average of the two values taken as the diameter.

17.7.2 Measurement on tapes and armour strips

The measurement shall be made with a micrometer having two flat noses of approximately 5 mm in diameter for measuring tapes, or having two ball noses of maximum 2 mm in diameter for measuring armour strips. The accuracy of the micrometer shall be $\pm 0,01$ mm.

For tapes up to 40 mm in width the thickness shall be measured at the centre of the width. For wider tapes the measurements shall be made 20 mm from each edge of the tape and the average of the results taken as the thickness.

For armour strips the thickness shall be measured in a position that allows a measurement without disturbance by the shape of the formed strip.

17.7.3 Requirements

The dimensions of armour wires, tapes and armour strips shall not fall below the nominal values given in 13.5 by more than:

- 5 % for round wires;
- 8 % for flat wires;
- 10 % for tapes;
- 5 % for armour strips.

17.8 Measurement of external diameter

If the measurement of the external diameter of the cable is required as a sample test, it shall be carried out in accordance with IEC 60811-203.

17.9 Voltage test for 4 h

This test is applicable only to cables of rated voltage above 3,6/6 (7,2) kV.

17.9.1 Sampling

The sample shall be a piece of completed cable at least 5 m in length between the test terminations.

17.9.2 Procedure

A power frequency voltage shall be applied for 4 h at ambient temperature between each conductor and the metal layer(s).

17.9.3 Test voltages

The test voltage shall be $4 U_0$. Values of the test voltage for the standard rated voltages are given in Table 13.

Table 13 – Sample test voltages

Rated voltage U_0	kV	6	8,7	12	18
Test voltage	kV	24	35	48	72

The test voltage shall be increased gradually to the specified value and maintained for 4 h.

17.9.4 Requirements

No breakdown of the insulation shall occur.

17.10 Hot set test for EPR, HEPR and XLPE insulations and elastomeric sheaths

17.10.1 Procedure

The sampling and test procedure shall be carried out in accordance with IEC 60811-507, employing the conditions given in Tables 19 and 23.

17.10.2 Requirements

The test results shall comply with the requirements given in Table 19, for EPR, HEPR and XLPE insulations and in Table 23 for SE₁ sheaths.

17.11 Bending test on interlock armour cable followed by examination

The interlocked metal tape armour cable, with the oversheath removed, shall be bent at a 180° turn around a mandrel having a diameter not more than 10 times the diameter over the armour. The examination shall not reveal any opening at any point of the interlocking armour nor mechanical damages caused by the armour on the underlying cable layer (assembly of cores, bedding, or separation sheath).

18 Type tests, electrical

18.1 General

When type tests have been successfully performed on a type of cable covered by this standard with a specific conductor cross-sectional area and rated voltage, type approval shall be accepted as valid for cables of the same type with other conductor cross-sectional areas and/or rated voltages, provided the following three conditions are all satisfied:

- a) the same materials, i.e. insulation and semi-conducting screens, and manufacturing process are used;
- b) the conductor cross-sectional area is not larger than that of the tested cable, with the exception that all cross-sectional areas up to and including 630 mm² are approved when the cross-sectional area of the previously tested cable is in the range of 95 mm² to 630 mm² inclusive;
- c) the rated voltage is not higher than that of the tested cable.

Approval shall be independent of the conductor material.

18.2 Cables having conductor screens and insulation screens

18.2.1 General

A sample of completed cable 10 m to 15 m in length shall be subjected to the tests listed in 18.2.2.

With the exception of the provisions of 18.2.3 all the tests listed in 18.2.2 shall be applied successively to the same sample.

In three-core cables, each test or measurement shall be carried out on all cores.

Measurement of resistivity of semi-conducting screens described in 18.2.10 shall be made on a separate sample.

18.2.2 Sequence of tests

The normal sequence of tests shall be as follows:

- a) bending test, followed by a partial discharge test (see 18.2.4 and 18.2.5);
- b) $\tan \delta$ measurement (see 18.2.3 and 18.2.6);
- c) heating cycle test, followed by a partial discharge test (see 18.2.7);
- d) impulse test, followed by a voltage test (see 18.2.8);
- e) voltage test for 4 h (see 18.2.9).

18.2.3 Special provisions

Measurement of $\tan \delta$ may be carried out on a different sample from the sample used for the normal sequence of tests listed in 18.2.2.

Measurement of $\tan \delta$ is not required on cables with rated voltage below 6/10 (12) kV.

A new sample may be taken for test e), provided this test sample is submitted previously to tests a) and c) listed in 18.2.2.

18.2.4 Bending test

The sample shall be bent around a test cylinder (for example, the hub of a drum) at ambient temperature for at least one complete turn. It shall then be unwound and the process repeated, except that the bending of the sample shall be in the reverse direction without axial rotation.

This cycle of operation shall be carried out three times.

The diameter of the test cylinder shall not be greater than

- for cables with a lead sheath or with an overlapped metal foil longitudinally applied:
 - $25 (d + D) + 5 \%$ for single-core cables;
 - $20 (d + D) + 5 \%$ for three-core cables;
- for other cables:
 - $20 (d + D) + 5 \%$ for single-core cables;
 - $15 (d + D) + 5 \%$ for three-core cables.

where

D is the actual external diameter of the cable sample, in millimetres, measured according to 17.8;

d is the actual diameter of the conductor, in millimetres.

If the conductor is not circular:

$$d = 1,13\sqrt{S}$$

where S is the nominal cross-section, in square millimetres.

After bending sequences are completed, a visual examination of the cable oversheath shall not show cracks, or plastic deformation of oversheath in such a way that the thickness of the oversheath at the stretched point goes below the minimum value $t_{\min}$ allowed.

On completion of this test, the sample shall be subjected to a partial discharge test and shall comply with the requirements given in 18.2.5.

18.2.5 Partial discharge test

The partial discharge test shall be carried out in accordance with IEC 60885-3, the sensitivity being 5 pC or better.

The test voltage shall be raised gradually to and held at $2 U_0$ for 10 s and then slowly reduced to $1,73 U_0$.

There shall be no detectable discharge exceeding the declared sensitivity from the test object at $1,73 U_0$.

NOTE Any partial discharge from the test object may be harmful.

18.2.6 Tan δ measurement for cables of rated voltage 6/10 (12) kV and above

The sample of completed cable shall be heated by one of the following methods: the sample shall be placed either in a tank of liquid or in an oven, or a heating current shall be passed through either the metal screen or the conductor or both.

The sample shall be heated until the conductor reaches a temperature which shall be 5 K to 10 K above the maximum conductor temperature in normal operation.

In each method, the temperature of the conductor shall be determined either by measuring the conductor resistance or by a suitable temperature measuring device in the bath or oven or on the surface of the screen or on an identically heated reference cable.

The tan δ shall be measured with an alternating voltage of at least 2 kV at the temperature specified above.

The measured values shall not be higher than those given in Table 15.

18.2.7 Heating cycle test

The sample, which has been subjected to the previous tests, shall be laid out on the floor of the test room and heated by passing a current through the conductor, until the conductor reaches a steady temperature 5 K to 10 K above the maximum conductor temperature in normal operation.

For three-core cables, the heating current shall be passed through all conductors.

The heating cycle shall be of at least 8 h duration. The conductor temperature shall be maintained within the stated temperature limits for at least 2 h of each heating period. This shall be followed by at least 3 h of natural cooling in air to a conductor temperature within 10 K of ambient temperature.

This cycle shall be carried out 20 times.

After the last cycle, the sample shall be subjected to a partial discharge test and shall comply with the requirements given in 18.2.5.

18.2.8 Impulse test followed by a voltage test

This test shall be performed on the sample at a conductor temperature 5 K to 10 K above the maximum conductor temperature in normal operation.

The impulse voltage shall be applied according to the procedure given in IEC 60230 and shall have a peak value as given in Table 14.

Table 14 – Impulse voltages

Rated voltage U_0/U (U_m)	kV	3,6/6 (7,2)	6/10 (12)	8,7/15 (17,5)	12/20 (24)	18/30 (36)
Test voltage (peak)	kV	60	75	95	125	170

Each core of the cable shall withstand without failure 10 positive and 10 negative voltage impulses.

After the impulse test, each core of the cable sample shall be subjected, at ambient temperature, to a power frequency voltage test for 15 min. The test voltage shall be as specified in Table 11. No breakdown of the insulation shall occur.

18.2.9 Voltage test for 4 h

This test shall be made at ambient temperature. A power frequency voltage shall be applied for 4 h to the sample between conductor(s) and screen(s).

The test voltage shall be $4 U_0$. The voltage shall be increased gradually to the specified value. No breakdown of the insulation shall occur.

18.2.10 Resistivity of semi-conducting screens

18.2.10.1 General

The resistivity of the extruded semi-conducting screens applied over the conductor and over the insulation shall be determined by measurements on test pieces taken from the core of a sample of cable as made and a sample of cable, which has been subjected to the ageing treatment to test the compatibility of component materials specified in 19.7.

18.2.10.2 Procedure

The test procedure shall be in accordance with Annex D.

The measurements shall be made at a temperature within ± 2 K of the maximum conductor temperature in normal operation.

18.2.10.3 Requirements

The resistivity, both before and after ageing, shall not exceed the following:

- conductor screen: $1\,000\ \Omega \times \text{m}$,
- insulation screen: $500\ \Omega \times \text{m}$.

18.3 Cables of rated voltage 3,6/6 (7,2) kV having unscreened insulation

18.3.1 General

Each core of a sample of completed cable 10 m to 15 m in length shall be subjected to the following tests, applied successively:

- a) insulation resistance measurement at ambient temperature (see 18.3.2);
- b) insulation resistance measurement at maximum conductor temperature in normal operation (see 18.3.3);
- c) voltage test for 4 h (see 18.3.4).

The cables shall also be subjected to an impulse test on a separate sample of completed cable, 10 m to 15 m in length (see 18.3.5).

18.3.2 Insulation resistance measurement at ambient temperature**18.3.2.1 Procedure**

This test shall be made on the sample length before any other electrical test.

All outer coverings shall be removed and the cores shall be immersed in water at ambient temperature for at least 1 h before the test.

The d.c. test voltage shall be 80 V to 500 V and shall be applied for a sufficient time to reach reasonably steady measurement, but for not less than 1 min and not more than 5 min.

The measurement shall be made between each conductor and the water.

If requested, measurement may be confirmed at a temperature of $(20 \pm 1) ^\circ\text{C}$.

18.3.2.2 Calculations

The volume resistivity shall be calculated from the measured insulation resistance by the following formula:

$$\rho = \frac{2 \times \pi \times l \times R}{\ln \frac{D}{d}}$$

where

ρ is the volume resistivity, in ohms $\times$ centimetres;

R is the measured insulation resistance, in ohms;

l is the length of the cable, in centimetres;

D is the outer diameter of the insulation, in millimetres;

d is the inner diameter of the insulation, in millimetres.

The "insulation resistance constant K_i " expressed in megohms $\times$ kilometres may also be calculated, using the formula:

$$K_i = \frac{l \times R \times 10^{-11}}{\lg \frac{D}{d}} = 10^{-11} \times 0,367 \times \rho$$

NOTE For the cores of shaped conductors, the ratio D/d is the ratio of the perimeter over the insulation to the perimeter over the conductor.

18.3.2.3 Requirements

The values calculated from the measurements shall be not less than those specified in Table 15.

18.3.3 Insulation resistance measurement at maximum conductor temperature**18.3.3.1 Procedure**

The cores of the cable sample shall be immersed in water at a temperature within ± 2 K of the maximum conductor temperature in normal operation for at least 1 h before the test.

The d.c. test voltage shall be 80 V to 500 V and shall be applied for a sufficient time to reach reasonably steady measurement, but for not less than 1 min and not more than 5 min.

The measurement shall be made between each conductor and the water.

18.3.3.2 Calculations

The volume resistivity and/or the insulation resistance constant shall be calculated from the insulation resistance by the formulae given in 18.3.2.2.

18.3.3.3 Requirements

The values calculated from the measurements shall be not less than those specified in Table 15.

18.3.4 Voltage test for 4 h

18.3.4.1 Procedure

The cores of the cable sample shall be immersed in water at ambient temperature for at least 1 h.

A power frequency voltage equal to $4 U_0$ shall then be gradually applied and maintained continuously for 4 h between each conductor and the water.

18.3.4.2 Requirements

No breakdown of the insulation shall occur.

18.3.5 Impulse test

18.3.5.1 Procedure

This test shall be performed on the sample at a conductor temperature 5 K to 10 K above the maximum conductor temperature in normal operation.

The impulse voltage shall be applied according to the procedure given in IEC 60230 and shall have a peak value of 60 kV.

Each series of impulses shall be applied in turn between each phase conductor and all the other conductors connected together and to earth.

18.3.5.2 Requirements

Each core of the cable shall withstand without failure 10 positive and 10 negative voltage impulses.

19 Type tests, non-electrical

19.1 General

The non-electrical type tests required by this standard are given in Table 16.

19.2 Measurement of thickness of insulation

19.2.1 Sampling

One sample shall be taken from each insulated cable core.

19.2.2 Procedure

The measurements shall be made as described in IEC 60811-201.

19.2.3 Requirements

See 17.5.2.

19.3 Measurement of thickness of non-metal sheaths (including extruded separation sheaths, but excluding inner coverings)

19.3.1 Sampling

One sample of cable shall be taken.

19.3.2 Procedure

The measurements shall be made as described in IEC 60811-202.

19.3.3 Requirements

See 17.5.3.

19.4 Measurement of thickness of lead sheath

19.4.1 Sampling

One sample of cable shall be taken.

19.4.2 Procedure

The measurements shall be made as described in 17.6.2 or 17.6.3.

19.4.3 Requirements

See 17.6.1.

19.5 Tests for determining the mechanical properties of insulation before and after ageing

19.5.1 Sampling

Sampling and the preparation of the test pieces shall be carried out as described in IEC 60811-501.

19.5.2 Ageing treatments

The ageing treatments shall be carried out as described in IEC 60811-401 under the conditions specified in Table 17.

19.5.3 Conditioning and mechanical tests

Conditioning and the measurement of mechanical properties shall be carried out as described in IEC 60811-501.

19.5.4 Requirements

The test results for unaged and aged test pieces shall comply with the requirements given in Table 17.

19.6 Tests for determining the mechanical properties of non-metal sheaths before and after ageing

19.6.1 Sampling

Sampling and the preparation of the test pieces shall be carried out as described in IEC 60811-501.

19.6.2 Ageing treatments

The ageing treatments shall be carried out as described in IEC 60811-401, under the conditions specified in Table 20.

19.6.3 Conditioning and mechanical tests

Conditioning and the measurement of mechanical properties shall be carried out as described in IEC 60811-501.

19.6.4 Requirements

The test results for unaged and aged test pieces shall comply with the requirements given in Table 20.

19.7 Additional ageing test on pieces of completed cables

19.7.1 General

This test is intended to check that the insulation and non-metal sheaths are not liable to deteriorate in operation due to contact with other components in the cable.

The test is applicable to cables of all types.

19.7.2 Sampling

Samples shall be taken from the completed cable as described in IEC 60811-401.

19.7.3 Ageing treatment

The ageing treatment of the pieces of cable shall be carried out in an air oven, as described in IEC 60811-401, under the following conditions:

- temperature: (10 ± 2) K above the maximum conductor temperature of the cable in normal operation (see Table 17);
- duration: 7×24 h.

19.7.4 Mechanical tests

Test pieces of insulation and oversheath from the aged pieces of cable shall be prepared and subjected to mechanical tests as described in IEC 60811-401.

19.7.5 Requirements

The variations between the median values of tensile strength and elongation-at-break after ageing and the corresponding values obtained without ageing (see 19.5 and 19.6), if applicable, shall not exceed the values applying to the test after ageing in an air oven specified in Table 17 for insulations and Table 20 for non-metal sheaths.

19.8 Loss of mass test on PVC sheaths of type ST₂

19.8.1 Procedure

The sampling and test procedure shall be in accordance with IEC 60811-409.

19.8.2 Requirements

The test results shall comply with the requirements given in Table 21.

19.9 Pressure test at high temperature on insulations and non-metal sheaths

19.9.1 Procedure

The pressure test at high temperature shall be carried out in accordance with IEC 60811-508, employing the test conditions given in the test method and in Table 18, Table 21, Table 22 and Table 25.

19.9.2 Requirements

The test results shall comply with the requirements given IEC 60811-508.

19.10 Test on PVC insulation, PVC sheaths and halogen free sheaths at low temperatures

19.10.1 Procedure

The sampling and test procedures shall be in accordance with IEC 60811-504, IEC 60811-505 and IEC 60811-506, employing the test temperature specified in Table 18, Table 21 and Table 25.

19.10.2 Requirements

The results of the test shall comply with the requirements given in IEC 60811-504, IEC 60811-505 and IEC 60811-506.

19.11 Test for resistance of PVC insulation and sheaths to cracking (heat shock test)

19.11.1 Procedure

The sampling and test procedure shall be in accordance with IEC 60811-509, the test temperature and duration being in accordance with Tables 18 and 21.

19.11.2 Requirements

The results of the tests shall comply with the requirements given in IEC 60811-509.

19.12 Ozone resistance test for EPR and HEPR insulations

19.12.1 Procedure

The sampling and test procedure shall be carried out in accordance with IEC 60811-403. The ozone concentration and test duration shall be in accordance with Table 19.

19.12.2 Requirements

The results of the test shall comply with the requirements given in IEC 60811-403.

19.13 Hot set test for EPR, HEPR and XLPE insulations and elastomeric sheaths

The sampling and test procedure shall be carried out in accordance with 17.10 and shall comply with its requirements.

19.14 Oil immersion test for elastomeric sheaths

19.14.1 Procedure

The sampling and test procedure shall be carried out in accordance with IEC 60811-404 employing the conditions given in Table 23.

19.14.2 Requirements

The results of the test shall comply with the requirements given in Table 23.

19.15 Water absorption test on insulation

19.15.1 Procedure

The sampling and test procedure shall be carried out in accordance with IEC 60811-402 employing the conditions specified in Tables 18 or 19 respectively.

19.15.2 Requirements

The results of the test shall comply with the requirements specified in Tables 18 or 19.

19.16 Test under fire conditions

19.16.1 General

The test in 19.16.2 shall be carried out on ST₁, ST₂ or SE₁ oversheathed cables, as specified in the relevant subclause.

The tests in 19.16.3 to 19.16.8 shall be carried out on ST₈ or ST₁₂ oversheathed cables, as specified in each relevant subclause.

19.16.2 Flame spread test for single cables

This test shall be carried out on ST₁, ST₂ or SE₁ oversheathed cables only when such a fire performance is specially required or declared.

The test method and requirements shall be those specified in IEC 60332-1-2.

19.16.3 Flame spread test for bunched cables

This test shall be carried out on ST₈ or ST₁₂ oversheathed halogen free cables.

The test method and requirements shall be those specified in IEC 60332-3-24.

NOTE Higher performance to meet the requirements of IEC 60332-3-22 or IEC 60332-3-23 can be agreed between the manufacturer and customer.

19.16.4 Measurement of smoke density of cables burning under defined conditions

This test shall be carried out on ST₈ or ST₁₂ oversheathed halogen free cables.

The test method and requirements shall be those specified in IEC 61034-2. The results shall comply with the requirements given in Table 25.

19.16.5 Determination of acidity (by pH measurement) and conductivity of gases evolved during combustion of the non-metallic materials in the cable

This test shall be carried out on the non-metallic components of ST₈ or ST₁₂ oversheathed halogen free cables.

The test specified in IEC 60754-2 shall be carried out on the non-metallic components of the cable. It is not necessary to test non-metallic components if their mass is less than or equal to 1 % of the total non-metallic mass.

The weighted values of pH and conductivity of the non-metallic components of the cable shall be calculated according to IEC 60754-2 and shall comply with the requirements given in Table 25.

19.16.6 Fire performance tests on halogen free oversheath material ST₈**19.16.6.1 Acid gas emission test****19.16.6.1.1 General**

This test shall be carried out on the non-metallic components of ST₈ oversheathed halogen free cables.

19.16.6.1.2 Procedure

The test method shall be that specified in IEC 60754-1.

19.16.6.1.3 Requirements

The results of the test shall comply with the requirements of Table 25.

19.16.6.2 Fluorine content test**19.16.6.2.1 General**

This test shall be carried out on the non-metallic components of ST₈ oversheathed halogen free cables.

19.16.6.2.2 Procedure

The test method shall be that specified in IEC 60684-2.

19.16.6.2.3 Requirements

The results of the test shall comply with the requirements of Table 25.

19.16.7 Fire performance tests on halogen free oversheath material ST₁₂**19.16.7.1 Determination of acidity (by pH measurement) and conductivity of gases evolved during combustion of oversheath**

The test specified in IEC 60754-2 shall be carried out on the oversheath of the cable.

The results shall comply with the requirements given in Table 25.

19.16.7.2 Measurement of halogen content of gases evolved during combustion of the oversheath

The value for the oversheath, H_i , of the individual halogen content for each of the four halogens F, Cl, Br, and I, shall be determined by carrying out the test in accordance with IEC 60754-3.

The values for each of four individual halogens, H_i , and the sum of the values for the oversheath for the four halogens, i.e. ΣH_i , shall comply with the requirements given in Table 25.

19.16.8 Measurement of halogen content of gases evolved during combustion of the non-metallic materials in the cable

This test shall be carried out on the non-metallic components of ST₁₂ oversheathed halogen free cables.

The weighted value for the cable, H'_i , for the four halogens F, Cl, Br, and I, shall be determined by carrying out the test in accordance with IEC 60754-3 either:

- individually on each non-metallic component of the cable, and calculating the weighted value for the cable, for each halogen, as described in Annex I,
- or on a sample representative of the cable construction prepared as described in Annex I, in which case the result for each halogen shall be taken as the weighted value for the cable.

It is not necessary to test non-metallic components if their mass is less than or equal to 1 % of the total non-metallic mass.

The weighted value for the cable, H'_i , for each of the four individual halogens and the sum of the weighted values for the non-metallic components of the cable for the four halogens, i.e. $\Sigma H'_i$, shall comply with the requirements given in Table 25.

19.17 Measurement of carbon black content of black PE oversheaths

19.17.1 Procedure

The sampling and test procedure shall be carried out in accordance with IEC 60811-605.

19.17.2 Requirements

The results of the test shall comply with the requirements of Table 22.

19.18 Shrinkage test for XLPE insulation

19.18.1 Procedure

The sampling and test procedure shall be carried out in accordance with IEC 60811-502 under the conditions specified in Table 19.

19.18.2 Requirements

The results of the test shall comply with the requirements of Table 19.

19.19 Thermal stability test for PVC insulation**19.19.1 Procedure**

The sampling and test procedure shall be carried out in accordance with IEC 60811-405 under the conditions specified in Table 18.

19.19.2 Requirements

The results of the test shall comply with the requirements of Table 18.

19.20 Determination of hardness of HEPR insulation**19.20.1 Procedure**

The sampling and test procedure shall be carried out in accordance with Annex E.

19.20.2 Requirements

The results of the test shall comply with the requirements of Table 19.

19.21 Determination of the elastic modulus of HEPR insulation**19.21.1 Procedure**

Sampling, preparation of the test pieces and the test procedure shall be carried out in accordance with IEC 60811-501.

The loads required for 150 % elongation shall be measured. The corresponding stresses shall be calculated by dividing the loads measured by the cross-sectional areas of the unstretched test pieces. The ratios of the stresses to strains shall be determined to obtain the elastic moduli at 150 % elongation.

The elastic modulus shall be the median value.

19.21.2 Requirements

The results of the test shall comply with the requirements of Table 19.

19.22 Shrinkage test for PE and halogen free oversheaths**19.22.1 Procedure**

The sampling and test procedure shall be carried out in accordance with IEC 60811-503 under the conditions specified in Table 22 and Table 25.

19.22.2 Requirements

The results of the test shall comply with the requirements of Table 22 and Table 25.

19.23 Strippability test for insulation screen**19.23.1 General**

This test shall be carried out when the manufacturer claims that the extruded semiconducting insulation screen is strippable.

19.23.2 Procedure

The test shall be performed three times on both unaged and aged samples, using either three separate pieces of cable or one piece of cable at three positions around the circumference, spaced at approximately 120°.

Core lengths of at least 250 mm shall be taken from the cable to be tested, before and after being aged according to 19.7.3.

Two cuts shall be made in the extruded semiconducting insulation screen of each sample, longitudinally from end to end and radially down to the insulation, the cuts being (10 ± 1) mm apart and parallel to each other.

After removing approximately 50 mm length of the 10 mm strip by pulling it in a direction parallel to the core (i.e. a stripping angle of approximately 180°), the core shall be mounted vertically in a tensile machine with one end of the core held in one grip and the 10 mm strip in the other.

The force to separate the 10 mm strip from the insulation, removing a length of at least 100 mm, shall be measured at a stripping angle of approximately 180° using a pulling speed of (250 ± 50) mm/min.

The test shall be carried out at a temperature of (20 ± 5) °C.

For unaged and aged samples, the stripping force values shall be continuously recorded.

19.23.3 Requirements

The force required to remove the extruded semiconducting screen from the insulation shall be not less than 4 N and not more than 45 N, before and after ageing.

The insulation surface shall not be damaged and no trace of the semiconducting screen shall remain on the insulation.

19.24 Water penetration test

The water penetration test shall be applied to those designs of cable where the manufacturer claims that barriers to longitudinal water penetration have been included. The test is designed to meet the requirements for buried cables and is not intended to apply to cables which are constructed for use as submarine cables.

The test is applicable to the following cable designs:

- a) a barrier is included which prevents longitudinal water penetration in the region of the metal layers;
- b) a barrier is included which prevents longitudinal water penetration along the conductor.

The apparatus, sampling and test procedure shall be in accordance with Annex F and Annex H.

19.25 Additional tests on halogen free oversheath of type ST₈

19.25.1 General

These tests are intended to check that the halogen free oversheaths are not liable to damage during installation and operation.

19.25.2 Water absorption test for halogen free oversheath of type ST₈

19.25.2.1 Procedure

The sampling and test procedure shall be carried out in accordance with IEC 60811-402 employing the conditions and method specified in Table 25 for ST₈.

19.25.2.2 Requirements

The results of the test shall comply with the requirements of Table 25 for ST₈.

19.25.3 Abrasion test on halogen free oversheath of type ST₈

The test method and requirements are under consideration.

19.26 Bending test on interlock armour

The test and examination shall be carried out according to 17.11.

20 Electrical tests after installation

20.1 General

Tests after installation are carried out when the installation of the cable and its accessories has been completed.

A d.c. oversheath test according to 20.2 is recommended and, if required, a test on the insulation according to 20.3. For installations where only the oversheath test according to 20.2 is carried out, quality assurance procedures during installation of accessories may, by agreement between the purchaser and the contractor, replace the insulation test.

20.2 DC voltage test of the oversheath

The voltage level and duration specified in Clause 5 of IEC 60229:2007 shall be applied between each metal sheath or metal screen and the ground.

For the test to be effective, it is necessary that the ground makes good contact with all of the outer surface of the oversheath. A conductive layer on the oversheath can assist in this respect.

20.3 AC voltage test of the insulation

By agreement between the customer and the contractor, an a.c. voltage test in accordance with IEC 60060-3 and in accordance with item a), b) or c) as below may be used:

- a) test for 15 min with the phase-to-phase voltage U , at a frequency between 20 Hz to 300 Hz shall be applied between the conductor and the metal screen/sheath;
- b) test for 24 h with the normal rated voltage U_0 of the system;
- c) test for 15 min with the RMS rated voltage value of $3 U_0$ at a frequency of 0,1 Hz applied between the conductor and the metal screen/sheath.

NOTE 1 During the a.c. test, $\tan \delta$ and/or partial discharge can be monitored.

NOTE 2 For installations which have been in use, lower voltages and/or shorter durations can be used. Values can be negotiated, taking into account the age, environment, history of breakdowns and the purpose of carrying out the test.

NOTE 3 A differentiation in test voltage levels for sinusoidal and cosine-rectangular VLF voltages is under consideration.

Designation of compounds (see 4.2)		PVC/B	EPR/ HEPR	XLPE
Maximum conductor temperature in normal operation (see 4.2)	°C	70	90	90
Volume resistivity ρ *				
– at 20 °C (see 18.3.2)	$\Omega \times \text{cm}$	10^{14}	–	–
– at maximum conductor temperature in normal operation (see 18.3.3)	$\Omega \times \text{cm}$	10^{11}	10^{12}	–
Insulation resistance constant K_i *				
– at 20 °C (see 18.3.2)	$\text{M}\Omega \times \text{km}$	367	–	–
– at maximum conductor temperature in normal operation (see 18.3.3)	$\text{M}\Omega \times \text{km}$	0,37	3,67	–
Tan δ (see 18.2.6)				
– tan δ at maximum conductor temperature in normal operation plus 5 K up to 10 K, maximum	$\times 10^{-4}$	–	400	40
* For unscreened cables according to items a) and b) of Clause 7, rated voltage 3,6/6 (7,2) kV for PVC, EPR and HEPR insulation.				

[illegible]

<i>Fire performance tests</i>											
Flame spread test for single cables (if required)	–	–	–	–	x	x	–	–			x
Flame spread test for bunched cables (if required)	–	–	–	–	–	–	–	–	–	–	–
Measurement of smoke density of cables burning (19.16.4)	–	–	–	–	–	–	–	–	x	x	–
Determination of acidity (by pH) and conductivity (19.16.5)	–	–	–	–	–	–	–	–	x	x	–
Fire performance test on oversheath material	–	–	–	–	–	–	–	–	x	x	–
Measurement of content of halogen gases (IEC 60754-3)	–	–	–	–	–	–	–	–	x	x	–
Water penetration test ***									–	x	
NOTE x indicates that the type test is applied. * For black oversheaths only. ** To be applied to those designs of cable where the manufacturer claims that the insulation screen is strippable. *** To be applied to those designs of cable where the manufacturer claims that barriers to longitudinal water penetration have been included.											

Table 17 – Test requirements for mechanical characteristics of insulating compounds (before and after ageing)

Designation of compounds (see 4.2)		PVC/B	EPR	HEPR	XLPE
Maximum conductor temperature in normal operation (see 4.2)	°C	70	90	90	90
<i>Without ageing</i> (IEC 60811-501)					
Tensile strength, minimum	N/mm ²	12,5	4,2	8,5	12,5
Elongation-at-break, minimum	%	125	200	200	200
<i>After ageing in air oven</i> (IEC 60811-401)					
After ageing without conductor					
Treatment:					
– temperature	°C	100	135	135	135
– tolerance	K	±2	±3	±3	±3
– duration	h	168	168	168	168
Tensile strength:					
a) value after ageing, minimum	N/mm ²	12,5	–	–	–
b) variation*, maximum	%	±25	±30	±30	±25
Elongation-at-break:					
a) value after ageing, minimum	%	125	–	–	–
b) variation*, maximum	%	±25	±30	±30	±25
* Variation: difference between the median value obtained after ageing and the median value obtained without ageing expressed as a percentage of the latter.					

**Table 18 – Test requirements for particular characteristics
for PVC insulating compound**

Designation of compound (see 4.2 and 4.3)		PVC/B
Use of the PVC compound		Insulation
<i>Pressure test at high temperature</i> (IEC 60811-508) Temperature (tolerance ± 2 K)	°C	80
<i>Behaviour at low temperature</i> * (IEC 60811-504, IEC 60811-505 and IEC 60811-506) Test to be carried out without previous ageing: – cold bending test for diameter $< 12,5$ mm – temperature (tolerance ± 2 K) Cold elongation test on dumb-bells: – temperature (tolerance ± 2 K)	°C °C	–5 –5
<i>Heat shock test</i> (IEC 60811-509) Temperature (tolerance ± 3 K) Duration	°C h	150 1
<i>Thermal stability</i> (IEC 60811-405) Temperature (tolerance $\pm 0,5$ K) Minimum time	°C min	200 100
<i>Water absorption</i> (IEC 60811-402) Electrical method: Temperature (tolerance ± 2 K) Duration	°C h	70 240
* Due to climatic conditions, national standards may require the use of a lower temperature.		

Table 19 – Test requirements for particular characteristics of various crosslinked insulating compounds

Designation of compounds (see 4.2)		EPR	HEPR	XLPE
<i>Ozone resistance</i> (IEC 60811-403)				
Ozone concentration (by volume)	%	0,025 to 0,030	0,025 to 0,030	–
Test duration without cracks	h	24	24	–
<i>Hot set test</i> (IEC 60811-507)				
Treatment:				
– air temperature (tolerance ± 3 K)	°C	250	250	200
– time under load	min	15	15	15
– mechanical stress	N/cm ²	20	20	20
Maximum elongation under load	%	175	175	175
Maximum permanent elongation after cooling	%	15	15	15
<i>Water absorption</i> (IEC 60811-402)				
Gravimetric method:				
Temperature (tolerance ± 2 K)	°C	85	85	85
Duration	h	336	336	336
Maximum increase of mass	mg/cm ²	5	5	1 *
<i>Shrinkage test</i> (IEC 60811-502)				
Distance <i>L</i> between marks	mm	–	–	200
Temperature (tolerance ± 3 K)	°C	–	–	130
Duration	h	–	–	1
Maximum shrinkage	%	–	–	4
<i>Determination of hardness</i> (see Annex E)				
IRHD **, minimum		–	80	–
<i>Determination of elastic modulus</i> (see 19.21)				
Modulus at 150 % elongation, minimum	N/mm ²	–	4,5	–
* An increase greater than 1 mg/cm ² is being considered for densities of XLPE greater than 1 g/cm ³ .				
** IRHD: international rubber hardness degree.				

Table 20 – Test requirements for mechanical characteristics of sheathing compounds (before and after ageing)

Designation of compounds (see 4.3)		ST ₁	ST ₂	ST ₃	ST ₇	ST ₈	ST ₁₂	SE ₁
Maximum conductor temperature in normal operation (see 4.3)	°C	80	90	80	90	90	90	85
<i>Without ageing</i> (IEC 60811-501)								
Tensile strength, minimum	N/mm ²	12,5	12,5	10,0	12,5	9,0	12,5	10,0
Elongation-at-break, minimum	%	150	150	300	300	125	300	300
<i>After ageing in air oven</i> (IEC 60811-401)								
Treatment:								
– temperature (tolerance ±2 K)	°C	100	100	100	110	100	110	100
– duration	h	168	168	240	240	168	240	168
Tensile strength:								
a) value after ageing, minimum	N/mm ²	12,5	12,5	–	–	9,0	10	–
b) variation *, maximum	%	±25	±25	–	–	±40	±30	±30
Elongation-at-break:								
a) value after ageing, minimum	%	150	150	300	300	100	300	250
b) variation *, maximum	%	±25	±25	–	–	±40	–	±40
* Variation: difference between the median value obtained after ageing and the median value obtained without ageing expressed as a percentage of the latter.								

Table 21 – Test requirements for particular characteristics for PVC sheathing compounds

Designation of compound (see 4.2 and 4.3)		ST ₁	ST ₂
Use of the PVC compound		Sheath	
<i>Loss of mass in air oven</i> (IEC 60811-409)			
Treatment:			
– temperature (tolerance ±2 K)	°C	–	100
– duration	h	–	168
Maximum loss of mass	mg/cm ²	–	1,5
<i>Pressure test at high temperature</i> (IEC 60811-508)			
Temperature (tolerance ±2 K)	°C	80	90
<i>Behaviour at low temperature</i> * (IEC 60811-504, IEC 60811-505 and IEC 60811-506)			
Test to be carried out without previous ageing:			
– cold bending test for diameter <12,5 mm			
– temperature (tolerance ±2 K)	°C	–15	–15
Cold elongation test on dumb-bells:			
– temperature (tolerance ±2 K)	°C	–15	–15
Cold impact test:			
– temperature (tolerance ±2 K)	°C	–15	–15
<i>Heat shock test</i> (IEC 60811-509)			
Temperature (tolerance ±3 K)	°C	150	150
Duration	h	1	1
* Due to climatic conditions, national standards may require the use of a lower temperature.			

Table 22 – Test requirements for particular characteristics of PE (thermoplastic polyethylene) sheathing compounds

Designation of compounds (see 4.3)		ST ₃	ST ₇
Density * (IEC 60811-606)			
Carbon black content (for black oversheaths only) (IEC 60811-605)			
Nominal value	%	2,5	2,5
Tolerance	%	±0,5	±0,5
Shrinkage test (IEC 60811-503)			
Temperature (tolerance ±2 K)	°C	80	80
Heating, duration	h	5	5
Heating cycles		5	5
Maximum shrinkage	%	3	3
Pressure test at high temperature (IEC 60811-508)			
Temperature (tolerance ±2 K)	°C	–	110

* The measurement of density is only required for the purpose of other tests.

Table 23 – Test requirements for particular characteristics of elastomeric sheathing compound

Designation of compound (see 4.3)		SE ₁
Oil immersion test followed by a determination of the mechanical properties (IEC 60811-404 and IEC 60811-501)		
Treatment:		
– oil temperature (tolerance ±2 K)	°C	100
– duration	h	24
Maximum variation * of:		
a) tensile strength	%	±40
b) elongation-at-break	%	±40
Hot set test (IEC 60811-507)		
Treatment:		
– temperature (tolerance ±3 K)	°C	200
– time under load	min	15
– mechanical stress	N/cm ²	20
Maximum elongation under load	%	175
Maximum permanent elongation after cooling	%	15

* Variation: difference between the median value obtained after treatment and the median value without treatment, expressed as a percentage of the latter.

Table 25 – Test requirements for particular characteristics of halogen free sheathing compounds

Designation of compound (see 4.3)	Unit	ST ₈	ST ₁₂
<i>Behaviour at low temperature *</i>			
Tests to be carried out without previous ageing:			
a) Cold elongation test on dumb-bells (IEC 60811-505)			
Test temperature (tolerance ±2 K)	°C	−15	−15
Requirement	%	≥ 20	≥ 20
b) Cold impact test (IEC 60811-506)			
Test temperature (tolerance ±2 K)	°C	−15	−15
Requirement	–	no cracks	no cracks
<i>Pressure test at high temperature</i> (IEC 60811-508)			
Test temperature (tolerance ±2 K)	°C	80	110
Maximum indentation	%	50	50
<i>Shrinkage test</i> (IEC 60811-503)			
Test temperature (tolerance ±2 K)	°C	–	80
Duration	h	–	5
Number of heating cycles		–	5
Maximum shrinkage allowed	%	–	3,0
<i>Water absorption test</i> (IEC 60811-402)			
Gravimetric method:			
Treatment:			
– temperature (tolerance ±2 K)	°C	70	–
– duration	h	24	–
Maximum increase of mass	mg/cm ²	10	–
<i>Flame spread test on bunched cables (complete cable)</i> (IEC 60332-3-24)			
Upper limit of char above bottom edge of burner	m	≤ 2,5	≤ 2,5
<i>Smoke density test on cables (complete cables)</i> (IEC 61034-2)			
– light transmittance T min	%	60	60
<i>Acid gas emission test</i> (IEC 60754-1)			
– Bromine and chlorine content (expressed as HCl), maximum	%	0,5	–
<i>Fluorine content test</i> (IEC 60684-2)			
– Fluorine content, maximum	%	0,1	–
<i>pH value and conductivity tests, for the oversheath or as weighted values for the cable</i> (IEC 60754-2)			
– pH	–	≥ 4,3	≥ 4,3
– conductivity	µS/mm	≤ 10	≤ 10
<i>Measurement of halogen content of gases evolved during combustion of the oversheath (19.16.7.2)</i> (IEC 60754-3)			
– Value for each of the 4 individual halogens (F, Cl, Br, I) <i>H_i</i>	mg/g	–	≤ 2
– Sum of values for the 4 individual halogens			

Designation of compound (see 4.3)	Unit	ST ₈	ST ₁₂
(F, Cl, Br, I) ΣH_i	mg/g	–	≤ 5
<i>Measurement of halogen content of gases evolved during combustion of the non-metallic materials in the cable (19.16.8)</i> (IEC 60754-3) – Value for each of the 4 individual halogens (F, Cl, Br, I) H'_i	mg/g	–	≤ 2
– Sum of values for the 4 individual halogens (F, Cl, Br, I) $\Sigma H'_i$	mg/g	–	≤ 5
* Because of climatic conditions, national standards can require the use of a lower or higher test temperature.			

Annex A (normative)

Fictitious calculation method for determination of dimensions of protective coverings

A.1 General

The thickness of cable coverings, such as sheaths and armour, has usually been related to nominal cable diameters by means of "step-tables".

This sometimes causes problems. The calculated nominal diameters are not necessarily the same as the actual values achieved in production. In borderline cases, queries can arise if the thickness of a covering does not correspond to the actual diameter because the calculated diameter is slightly different. Variations in shaped conductor dimensions between manufacturers and different methods of calculation cause differences in nominal diameters and may therefore lead to variations in the thicknesses of coverings used on the same basic design of cable.

To avoid these difficulties, the fictitious calculation method shall be used. The idea is to ignore the shape and degree of compaction of conductors and to calculate fictitious diameters from formulae based on the cross-sectional area of conductors, nominal insulation thickness and number of cores. Thicknesses of sheath and other coverings are then related to the fictitious diameters by formulae or by tables. The method of calculating fictitious diameters is precisely specified and there is no ambiguity about the thicknesses of coverings to be used, which are independent of slight differences in manufacturing practices. This standardizes cable designs, thicknesses being pre-calculated and specified for each conductor cross-section.

The fictitious calculation is used only to determine dimensions of sheaths and cable coverings. It is not a replacement for the calculation of actual diameters required for practical purposes, which should be calculated separately.

The following fictitious method of calculating thicknesses of various coverings in a cable has been adopted to ensure that any differences which can arise in independent calculations, for example due to the assumption of conductor dimensions and the unavoidable differences between nominal and actually achieved diameters, are eliminated.

All thickness values and diameters shall be rounded according to the rules in Annex C to the first decimal figure.

Holding strips, for example counter helix over armour, if not thicker than 0,3 mm, are neglected in this calculation method.

A.2 Method

A.2.1 Conductors

The fictitious diameter (d_L) of a conductor, irrespective of shape and compactness, is given for each nominal cross-section in Table A.1.

Table A.1 – Fictitious diameter of conductor

Nominal cross-section of conductor mm ²	d_L mm	Nominal cross-section of conductor mm ²	d_L mm
10	3,6	240	17,5
16	4,5	300	19,5
25	5,6	400	22,6
35	6,7	500	25,2
50	8,0	630	28,3
70	9,4	800	31,9
95	11,0	1 000	35,7
120	12,4	1 200	39,1
150	13,8	1 400	42,2
185	15,3	1 600	45,1

A.2.2 Cores

The fictitious diameter D_c of any core is given by:

a) for cables having cores without semi-conducting layers:

$$D_c = d_L + 2 t_i$$

b) for cables having cores with semi-conducting layers:

$$D_c = d_L + 2 t_i + 3,0$$

where t_i is the nominal thickness of insulation, in millimetres (see Tables 5 to 7).

If a metal screen or a concentric conductor is applied, a further addition shall be made in accordance with A.2.5.

A.2.3 Diameter over laid-up cores

The fictitious diameter over laid-up cores (D_f) is given by:

$$D_f = k D_c$$

where the assembly coefficient k is 2,16 for a three-core cable.

A.2.4 Inner coverings

The fictitious diameter over the inner covering (D_B) is given by:

$$D_B = D_f + 2 t_B$$

where

$t_B = 0,4$ mm for fictitious diameters over laid-up cores (D_f) up to and including 40 mm;

$t_B = 0,6$ mm for D_f exceeding 40 mm.

These fictitious values for t_B apply to

a) three-core cables:

- whether an inner covering is applied or not;
- whether the inner covering is extruded or lapped;

unless a separation sheath complying with 13.3.3 is used in place of or in addition to the inner covering, when A.2.7 applies instead (in which case $D_u = D_f$);

b) single-core cables:

- when an inner covering is applied whether it is extruded or lapped.

A.2.5 Concentric conductors and metal screens

The increase in diameter due to the concentric conductor or metal screen is given in Table A.2.

Table A.2 – Increase of diameter for concentric conductors and metal screens

Nominal cross-section of concentric conductor or metal screen mm ²	Increase in diameter mm	Nominal cross-section of concentric conductor or metal screen mm ²	Increase in diameter mm
1,5	0,5	50	1,7
2,5	0,5	70	2,0
4	0,5	95	2,4
6	0,6	120	2,7
10	0,8	150	3,0
16	1,1	185	4,0
25	1,2	240	5,0
35	1,4	300	6,0

If the cross-section of the concentric conductor or metal screen lies between two of the values given in the table above, then the increase in diameter is that given for the larger of the two cross-sections.

If a metal screen is applied, the cross-sectional area of the screen to be used in the table above shall be calculated in the following manner:

a) tape screen

$$\text{cross-sectional area} = n_t \times t_t \times w_t$$

where

n_t is the number of tapes;

t_t is the nominal thickness of an individual tape, in millimetres;

w_t is the nominal width of an individual tape, in millimetres.

Where the total thickness of the screen is less than 0,15 mm then the increase in diameter shall be zero:

- for a lapped tape screen made of either two tapes or one tape with overlap, the total thickness is twice the thickness of one tape;
- for a longitudinally applied tape screen:
 - if the overlap is below 30 %, the total thickness is the thickness of the tape;

- if the overlap is greater than or equal to 30 %, the total thickness is twice the thickness of the tape.

b) wire screen (with a counter helix, if any)

$$\text{cross-sectional area} = \frac{n_w \times d_w^2 \times \pi}{4} + n_h \times t_h \times w_h$$

where

n_w is the number of wires;

d_w is the diameter of an individual wire, in millimetres;

n_h is the number of a counter helix;

t_h is the thickness of a counter helix, in millimetres, if greater than 0,3 mm;

w_h is the width of a counter helix, in millimetres.

A.2.6 Lead sheath

The fictitious diameter over the lead sheath (D_{pb}) is given by:

$$D_{pb} = D_g + 2 t_{pb}$$

where

D_g is the fictitious diameter under the lead sheath, in millimetres;

t_{pb} is the thickness calculated in accordance with 12.1, in millimetres.

A.2.7 Separation sheath

The fictitious diameter over the separation sheath (D_s) is given by:

$$D_s = D_u + 2 t_s$$

where

D_u is the fictitious diameter under the separation sheath, in millimetres;

t_s is the thickness calculated in accordance with 13.3.3, in millimetres.

A.2.8 Lapped bedding

The fictitious diameter over the lapped bedding (D_{lb}) is given by:

$$D_{lb} = D_{ulb} + 2 t_{lb}$$

where

D_{ulb} is the fictitious diameter under the lapped bedding, in millimetres;

t_{lb} is the thickness of lapped bedding, i.e. 1,5 mm according to 13.3.4.

A.2.9 Additional bedding for tape-armoured cables (provided over the inner covering)

Table A.3 – Increase of diameter for additional bedding

Fictitious diameter under the addition bedding		Increase in diameter for additional bedding mm
Above mm	Up to and including mm	
–	29	1,0
29	–	1,6

A.2.10 Armour

The fictitious diameter over the armour (D_x) is given for:

a) flat or round wire armour by:

$$D_x = D_A + 2 t_A + 2 t_w$$

where

D_A is the diameter under the armour, in millimetres;

t_A is the thickness or diameter of the armour wire, in millimetres;

t_w is the thickness of the counter helix, if any, in millimetres, if greater than 0,3 mm.

b) for double-tape armour by:

$$D_x = D_A + 4 t_A$$

where

D_A is the diameter under the armour, in millimetres;

t_A is the thickness of the armour tape, in millimetres.

c) for interlock metal tape armour by increase in diameter according to Table A.4:

Table A.4 – Increase of diameter over interlocked armour

Fictitious diameter under the armour		Increase in diameter over interlocked armour mm
Above mm	Up to and including mm	
-	20	4,5
20	40	6,5
40	-	8,5

Annex B (informative)

Tabulated continuous current ratings for cables having extruded insulation and a rated voltage from 3,6/6 kV up to 18/30 kV

B.1 General

This annex deals solely with the steady-state continuous current ratings of single-core and three-core cables having extruded insulation. The tabulated current ratings provided in this annex have been calculated for cables having a rated voltage of 6/10 kV and constructions as detailed in Clause B.2.

These ratings can be applied to cables of similar constructions in the voltage range of 3,6/6 kV to 18/30 kV.

Some parameters such as screen cross-sectional area and oversheath thickness have an influence on the rating of large cables. In addition, the method of screen bonding has to be taken into account in the rating of single-core cables.

The tabulated current ratings have been calculated using the methods set out in the IEC 60287 series.

For cyclic current ratings, see the IEC 60853 series.

For short-circuit temperature limits, see the IEC 60986 series.

B.2 Cable constructions

The cable constructions and dimensions for which current ratings have been tabulated are based on those given in this standard. The constructions and dimensions used are not related to specific national designs but reflect different model cables. Armoured three-core cables are assumed to have flat wire armour and single-core cables are assumed to be unarmoured. All the cables have copper tape core screens except the single-core XLPE insulated cable, which has a copper wire screen. The nominal cross-sectional areas of the screens for the model cables is given in Table B.1.

Table B.1 – Nominal screen cross-sectional areas

Nominal area of conductor, mm ²	16	25	35	50	70	95	120	150	185	240	300	400
Nominal cross-sectional area of screen, per core, mm ²												
EPR insulated cable	3	3	4	4	4	5	5	5	6	6	7	8
XLPE insulated cable	16	16	16	16	16	16	16	25	25	25	25	35

The oversheath is taken to be polyethylene for the single core cables and PVC for the three-core cables.

B.3 Temperatures

The maximum conductor temperature for which the tabulated cable ratings have been calculated is 90 °C.

The reference ambient temperatures assumed are as follows:

- for cables in air: 30 °C
- for buried cables, either directly in the soil
or in ducts in the ground: 20 °C

Correction factors for other ambient temperatures are given in Tables B.10 and B.11.

The current ratings for cables in air do not take account of the increase, if any, due to solar or other infra-red radiation. Where the cables are subject to such radiation, the current rating should be derived by the methods specified in the IEC 60287 series.

B.4 Soil thermal resistivity

The tabulated current ratings for cables in ducts or direct in the ground relate to a soil thermal resistivity of 1,5 K·m/W. Information on the likely soil thermal resistivity in various countries is given in IEC 60287-3-1. Correction factors for other values of thermal resistivity are given in Tables B.14 to B.17.

It is assumed that the soil properties are uniform, no allowance has been made for the possibility of moisture migration which can lead to a region of high thermal resistivity around the cable. If partial drying-out of the soil is foreseen, the permissible current rating should be derived by the methods specified in the IEC 60287 series.

B.5 Methods of installation

B.5.1 General

Current ratings are tabulated for cables installed in the following conditions.

B.5.2 Single-core cables in air

The cables are assumed to be spaced at least 0,5 times the cable diameter from any vertical surface and installed on brackets or ladder racks as follows:

- a) three cables in trefoil formation touching throughout their length;
- b) three cables in horizontal flat formation touching throughout their length;
- c) three cables in horizontal flat formation with a clearance of one cable diameter.




Figure B.1a




Figure B.1b




Figure B.1c

IEC 426/05

Key

D_e external diameter of the cable.

Figure B.1 – Single-core cables in air

B.5.3 Single-core cables buried direct

Current ratings are given for cables buried direct in the ground at a depth of 0,8 m under the following conditions:

- a) three cables in trefoil formation touching throughout their length;

- b) three cables in horizontal flat formation with a clearance of one cable diameter, D_e .




Figure B.2a




Figure B.2b

IEC 427/05

Figure B.2 – Single-core cables buried direct

The cable depth is measured to the cable axis or centre of the trefoil group.

B.5.4 Single-core cables in earthenware ducts

Current ratings are given for cables in earthenware ducts buried at a depth of 0,8 m with one cable per duct as follows:

- three cables in trefoil ducts touching throughout their length;
- three cables in horizontal flat formation, ducts touching throughout their length.




Figure B.3a




Figure B.3b

IEC 428/05

Figure B.3 – Single-core cables in earthenware ducts

The ducts are assumed to be earthenware having an inside diameter of 1,5 times the outside diameter of the cable and a wall thickness equal to 6 % of the duct inside diameter. The ratings are based on the assumption that the ducts are air filled. If the ducts have been filled with a material such as Bentonite, then it is usual to adopt the current ratings for cables buried direct.

The tabulated ratings may be applied to cables in ducts having an inside diameter of between 1,2 and 2 times the outside diameter of the cables. For this range of diameters the variation in the rating is less than 2 % of the tabulated value.

B.5.5 Three-core cables

Current ratings are given for three-core cables installed under the following conditions:

- single cable in air spaced at least 0,3 times the cable diameter from any vertical surface;
- single cable buried direct in the ground at a depth of 0,8 m;
- single cable in a buried earthenware duct having dimensions calculated in the same manner as for the single-core cables in ducts. The depth of burial of the duct is 0,8 m.




Figure B.4a





Figure B.4b



IEC 429/05
Figure B.4c

Figure B.4 – Three-core cables

B.6 Screen bonding

All the tabulated ratings for single-core cables assume that the cable screens are solidly bonded, i.e. bonded at both ends of the cables.

B.7 Cable loading

The tabulated ratings relate to circuits carrying a balanced three-phase load at a rated frequency of 50 Hz.






B.8 Rating factors for grouped circuits

The tabulated current ratings apply to a set of three single-core cables or one three-core cable forming a three-phase circuit. When a number of circuits are installed in close proximity the rating should be reduced by the appropriate factor from Tables B.18 to B.23.

These rating factors should also be applied to groups of parallel cables forming the same circuit. In such cases, attention should also be given to the arrangement of the cables to ensure that the load current is shared equally between the parallel cables.






B.9 Correction factors

The correction factors given in Tables B.10 to B.23 for temperature, installation conditions and grouping are averages over a range of conductor sizes and cable types. For particular cases, the correction factor may be calculated using the methods in IEC 60287-2-1.






Nominal area of conductor	Buried direct in the ground		In single-way ducts		In air		
	Trefoil	Flat spaced	Trefoil ducts	Flat touching ducts	Trefoil	Flat touching	Flat spaced
							
mm ²	A	A	A	A	A	A	A
16	109	113	103	104	125	128	150
25	140	144	132	133	163	167	196
35	166	172	157	159	198	203	238
50	196	203	186	188	238	243	286
70	239	246	227	229	296	303	356
95	285	293	271	274	361	369	434
120	323	332	308	311	417	426	500
150	361	366	343	347	473	481	559
185	406	410	387	391	543	550	637
240	469	470	447	453	641	647	745
300	526	524	504	510	735	739	846
400	590	572	564	571	845	837	938
Maximum conductor temperature				90 °C			
Ambient air temperature				30 °C			
Ground temperature				20 °C			
Depth of laying				0,8 m			
Thermal resistivity of soil				1,5 K·m/W			
Thermal resistivity of earthenware ducts				1,2 K·m/W			
Screens bonded at both ends.							

* Current rating calculated for cables having a rated voltage of 6/10 kV.

**Table B.3 – Current ratings for single-core cables with XLPE insulation –
Rated voltage 3,6/6 kV to 18/30 kV * –
Aluminium conductor**






Nominal area of conductor	Buried direct in the ground		In single-way ducts		In air		
	Trefoil	Flat spaced	Trefoil ducts	Flat touching ducts	Trefoil	Flat touching	Flat spaced
							
mm ²	A	A	A	A	A	A	A
16	84	88	80	81	97	99	116
25	108	112	102	103	127	130	153
35	129	134	122	123	154	157	185
50	152	157	144	146	184	189	222
70	186	192	176	178	230	236	278
95	221	229	210	213	280	287	338
120	252	260	240	242	324	332	391
150	281	288	267	271	368	376	440
185	317	324	303	307	424	432	504
240	367	373	351	356	502	511	593
300	414	419	397	402	577	586	677
400	470	466	451	457	673	676	769
Maximum conductor temperature				90 °C			
Ambient air temperature				30 °C			
Ground temperature				20 °C			
Depth of laying				0,8 m			
Thermal resistivity of soil				1,5 K·m/W			
Thermal resistivity of earthenware ducts				1,2 K·m/W			
Screens bonded at both ends.							

* Current rating calculated for cables having a rated voltage of 6/10 kV.

Nominal area of conductor	Buried direct in the ground		In single-way ducts		In air		
	Trefoil	Flat spaced	Trefoil ducts	Flat touching ducts	Trefoil	Flat touching	Flat spaced
							
mm ²	A	A	A	A	A	A	A
16	106	109	99	100	116	119	138
25	136	140	128	129	153	156	181
35	162	167	153	154	186	190	221
50	192	198	181	183	224	229	266
70	234	242	222	224	280	287	334
95	280	289	266	269	343	352	409
120	319	329	303	306	398	407	474
150	357	369	341	344	454	465	540
185	403	417	386	390	522	534	621
240	467	484	449	454	619	634	736
300	526	545	509	515	712	728	843
400	597	618	580	588	825	843	977
Maximum conductor temperature				90 °C			
Ambient air temperature				30 °C			
Ground temperature				20 °C			
Depth of laying				0,8 m			
Thermal resistivity of soil				1,5 K·m/W			
Thermal resistivity of earthenware ducts				1,2 K·m/W			
Screens bonded at both ends.							

* Current rating calculated for cables having a rated voltage of 6/10 kV.

**Table B.5 – Current ratings for single-core cables with EPR insulation –
Rated voltage 3,6/6 kV to 18/30 kV * –
Aluminium conductor**

Nominal area of conductor	Buried direct in the ground		In single-way ducts		In air		
	Trefoil	Flat spaced	Trefoil ducts	Flat touching ducts	Trefoil	Flat touching	Flat spaced
							
mm ²	A	A	A	A	A	A	A
16	82	84	77	78	90	92	107
25	105	109	99	100	119	121	141
35	126	130	118	120	144	147	171
50	149	153	140	142	174	178	207
70	182	188	172	174	218	223	259
95	217	224	206	208	266	273	317
120	247	256	235	238	309	317	368
150	277	287	264	267	352	361	419
185	314	325	300	303	406	417	484
240	364	377	350	354	483	495	575
300	411	426	397	401	556	570	659
400	471	487	456	462	651	667	770
Maximum conductor temperature				90 °C			
Ambient air temperature				30 °C			
Ground temperature				20 °C			
Depth of laying				0,8 m			
Thermal resistivity of soil				1,5 K·m/W			
Thermal resistivity of earthenware ducts				1,2 K·m/W			
Screens bonded at both ends.							
* Current rating calculated for cables having a rated voltage of 6/10 kV.							

**Table B.6 – Current rating for three-core XLPE insulated cables –
Rated voltage 3,6/6 kV to 18/30 kV * –
Copper conductor, armoured and unarmoured**







[illegible]

**Table B.7 – Current rating for three-core XLPE insulated cables –
Rated voltage 3,6/6 kV to 18/30 kV * –
Aluminium conductor, armoured and unarmoured**

[illegible]

[illegible]

**Table B.9 – Current rating for three-core EPR insulated cables –
Rated voltage 3,6/6 kV to 18/30 kV * –
Aluminium conductor, armoured and unarmoured**

Nominal area of conductor	Unarmoured			Armoured		
	Buried direct in ground	In a buried duct	In air	Buried direct in ground	In a buried duct	In air
						
mm ²	A	A	A	A	A	A
16	76	65	80	76	66	81
25	97	84	105	97	85	105
35	116	101	127	116	101	127
50	137	119	151	137	120	153
70	167	147	189	168	147	190
95	200	176	229	200	176	230
120	227	201	263	227	201	264
150	255	226	299	254	226	300
185	289	257	343	288	257	343
240	335	300	406	332	299	402
300	378	340	462	374	338	459
400	432	392	538	426	387	530
Maximum conductor temperature			90 °C			
Ambient air temperature			30 °C			
Ground temperature			20 °C			
Depth of laying			0,8 m			
Thermal resistivity of soil			1,5 K·m/W			
Thermal resistivity of earthenware ducts			1,2 K·m/W			
* Current rating calculated for cables having a rated voltage of 6/10 kV.						

**Table B.10 – Correction factors for ambient
air temperatures other than 30 °C**

Maximum conductor temperature °C	Ambient air temperature °C							
	20	25	35	40	45	50	55	60
90	1,08	1,04	0,96	0,91	0,87	0,82	0,76	0,71

Table B.11 – Correction factors for ambient ground temperatures other than 20 °C

Maximum conductor temperature °C	Ambient ground temperature °C							
	10	15	25	30	35	40	45	50
90	1,07	1,04	0,96	0,93	0,89	0,85	0,80	0,76

Table B.12 – Correction factors for depths of laying other than 0,8 m for direct buried cables

Depth of laying m	Single-core cables		Three-core cables
	Nominal conductor size mm ²		
	≤185 mm ²	>185 mm ²	
0,5	1,04	1,06	1,04
0,6	1,02	1,04	1,03
1	0,98	0,97	0,98
1,25	0,96	0,95	0,96
1,5	0,95	0,93	0,95
1,75	0,94	0,91	0,94
2	0,93	0,90	0,93
2,5	0,91	0,88	0,91
3	0,90	0,86	0,90

Table B.13 – Correction factors for depths of laying other than 0,8 m for cables in ducts

Depth of laying m	Single-core cables		Three-core cable
	Nominal conductor size mm ²		
	≤185 mm ²	>185 mm ²	
0,5	1,04	1,05	1,03
0,6	1,02	1,03	1,02
1	0,98	0,97	0,99
1,25	0,96	0,95	0,97
1,5	0,95	0,93	0,96
1,75	0,94	0,92	0,95
2	0,93	0,91	0,94
2,5	0,91	0,89	0,93
3	0,90	0,88	0,92

**Table B.14 – Correction factors for soil thermal resistivities
other than 1,5 K·m/W for direct buried single-core cables**

Nominal area of conductor mm ²	Values of soil thermal resistivity K·m/W						
	0,7	0,8	0,9	1	2	2,5	3
16	1,29	1,24	1,19	1,15	0,89	0,82	0,75
25	1,30	1,25	1,20	1,16	0,89	0,81	0,75
35	1,30	1,25	1,21	1,16	0,89	0,81	0,75
50	1,32	1,26	1,21	1,16	0,89	0,81	0,74
70	1,33	1,27	1,22	1,17	0,89	0,81	0,74
95	1,34	1,28	1,22	1,18	0,89	0,80	0,74
120	1,34	1,28	1,22	1,18	0,88	0,80	0,74
150	1,35	1,28	1,23	1,18	0,88	0,80	0,74
185	1,35	1,29	1,23	1,18	0,88	0,80	0,74
240	1,36	1,29	1,23	1,18	0,88	0,80	0,73
300	1,36	1,30	1,24	1,19	0,88	0,80	0,73
400	1,37	1,30	1,24	1,19	0,88	0,79	0,73

**Table B.15 – Correction factors for soil thermal resistivities
other than 1,5 K·m/W single-core cables in buried ducts**

Nominal area of conductor mm ²	Values of soil thermal resistivity K·m/W						
	0,7	0,8	0,9	1	2	2,5	3
16	1,20	1,17	1,14	1,11	0,92	0,85	0,79
25	1,21	1,17	1,14	1,12	0,91	0,85	0,79
35	1,21	1,18	1,15	1,12	0,91	0,84	0,79
50	1,21	1,18	1,15	1,12	0,91	0,84	0,78
70	1,22	1,19	1,15	1,12	0,91	0,84	0,78
95	1,23	1,19	1,16	1,13	0,91	0,84	0,78
120	1,23	1,20	1,16	1,13	0,91	0,84	0,78
150	1,24	1,20	1,16	1,13	0,91	0,83	0,78
185	1,24	1,20	1,17	1,13	0,91	0,83	0,78
240	1,25	1,21	1,17	1,14	0,90	0,83	0,77
300	1,25	1,21	1,17	1,14	0,90	0,83	0,77
400	1,25	1,21	1,17	1,14	0,90	0,83	0,77

**Table B.16 – Correction factors for soil thermal resistivities
other than 1,5 K·m/W for direct buried three-core cables**

Nominal area of conductor mm ²	Values of soil thermal resistivity K·m/W						
	0,7	0,8	0,9	1	2	2,5	3
16	1,23	1,19	1,16	1,13	0,91	0,84	0,78
25	1,24	1,20	1,16	1,13	0,91	0,84	0,78
35	1,25	1,21	1,17	1,13	0,91	0,83	0,78
50	1,25	1,21	1,17	1,14	0,91	0,83	0,77
70	1,26	1,21	1,18	1,14	0,90	0,83	0,77
95	1,26	1,22	1,18	1,14	0,90	0,83	0,77
120	1,26	1,22	1,18	1,14	0,90	0,83	0,77
150	1,27	1,22	1,18	1,15	0,90	0,83	0,77
185	1,27	1,23	1,18	1,15	0,90	0,83	0,77
240	1,28	1,23	1,19	1,15	0,90	0,83	0,77
300	1,28	1,23	1,19	1,15	0,90	0,82	0,77
400	1,28	1,23	1,19	1,15	0,90	0,82	0,76

**Table B.17 – Correction factors for soil thermal resistivities
other than 1,5 K·m/W for three-core cables in ducts**

Nominal area of conductor mm ²	Values of soil thermal resistivity K·m/W						
	0,7	0,8	0,9	1	2	2,5	3
16	1,12	1,11	1,09	1,08	0,94	0,89	0,84
25	1,14	1,12	1,10	1,08	0,94	0,89	0,84
35	1,14	1,12	1,10	1,08	0,94	0,88	0,84
50	1,14	1,12	1,10	1,08	0,94	0,88	0,84
70	1,15	1,13	1,11	1,09	0,94	0,88	0,83
95	1,15	1,13	1,11	1,09	0,94	0,88	0,83
120	1,15	1,13	1,11	1,09	0,93	0,88	0,83
150	1,16	1,13	1,11	1,09	0,93	0,88	0,83
185	1,16	1,14	1,11	1,09	0,93	0,87	0,83
240	1,16	1,14	1,12	1,10	0,93	0,87	0,82
300	1,17	1,14	1,12	1,10	0,93	0,87	0,82
400	1,17	1,14	1,12	1,10	0,92	0,86	0,81

**Table B.18 – Correction factors for groups of three-core cables
in horizontal formation laid direct in the ground**

Number of cables in group	Spacing between cable centres mm				
	Touching	200	400	600	800
2	0,80	0,86	0,90	0,92	0,94
3	0,69	0,77	0,82	0,86	0,89
4	0,62	0,72	0,79	0,83	0,87
5	0,57	0,68	0,76	0,81	0,85
6	0,54	0,65	0,74	0,80	0,84
7	0,51	0,63	0,72	0,78	0,83
8	0,49	0,61	0,71	0,78	
9	0,47	0,60	0,70	0,77	–
10	0,46	0,59	0,69	–	–
11	0,45	0,57	0,69	–	–
12	0,43	0,56	0,68	–	–

**Table B.19 – Correction factors for groups of three-phase circuits
of single-core cables laid direct in the ground**

Number of cables in group	Spacing between group centres mm				
	Touching	200	400	600	800
2	0,73	0,83	0,88	0,90	0,92
3	0,60	0,73	0,79	0,83	0,86
4	0,54	0,68	0,75	0,80	0,84
5	0,49	0,63	0,72	0,78	0,82
6	0,46	0,61	0,70	0,76	0,81
7	0,43	0,58	0,68	0,75	0,80
8	0,41	0,57	0,67	0,74	–
9	0,39	0,55	0,66	0,73	–
10	0,37	0,54	0,65	–	–
11	0,36	0,53	0,64	–	–
12	0,35	0,52	0,64	–	–







**Table B.20 – Correction factors for groups of three-core cables
in single way ducts in horizontal formation**

Number of cables in group	Spacing between duct centres mm				
	Touching	200	400	600	800
2	0,85	0,88	0,92	0,94	0,95
3	0,75	0,80	0,85	0,88	0,91
4	0,69	0,75	0,82	0,86	0,89
5	0,65	0,72	0,79	0,84	0,87
6	0,62	0,69	0,77	0,83	0,87
7	0,59	0,67	0,76	0,82	0,86
8	0,57	0,65	0,75	0,81	–
9	0,55	0,64	0,74	0,80	–
10	0,54	0,63	0,73	–	–
11	0,52	0,62	0,73	–	–
12	0,51	0,61	0,72	–	–

**Table B.21 – Correction factors for groups of three-phase circuits
of single-core cables in single-way ducts**

Number of cables in group	Spacing between duct group centres mm				
	Touching	200	400	600	800
2	0,78	0,85	0,89	0,91	0,93
3	0,66	0,75	0,81	0,85	0,88
4	0,59	0,70	0,77	0,82	0,86
5	0,55	0,66	0,74	0,80	0,84
6	0,51	0,64	0,72	0,78	0,83
7	0,48	0,61	0,71	0,77	0,82
8	0,46	0,60	0,70	0,76	–
9	0,44	0,58	0,69	0,76	–
10	0,43	0,57	0,68	–	–
11	0,42	0,56	0,67	–	–
12	0,40	0,55	0,67	–	–

**Table B.22 – Reduction factors for groups of more than one multi-core cable in air –
To be applied to the current-carrying capacity for one multi-core cable in free air**

Method of installation		Number of trays	Number of cables					
			1	2	3	4	6	9
Cables on perforated trays	Touching 	1	1,00	0,88	0,82	0,79	0,76	0,73
		2	1,00	0,87	0,80	0,77	0,73	0,68
		3	1,00	0,86	0,79	0,76	0,71	0,66
	Spaced 	1	1,00	1,00	0,98	0,95	0,91	–
		2	1,00	0,99	0,96	0,92	0,87	–
		3	1,00	0,98	0,95	0,91	0,85	–
Cables on vertical perforated trays	 Touching	1	1,00	0,88	0,82	0,78	0,73	0,72
		2	1,00	0,88	0,81	0,76	0,71	0,70
	 Spaced	1	1,00	0,91	0,89	0,88	0,87	–
		2	1,00	0,91	0,88	0,87	0,85	–
Cables on ladder supports, cleats, etc.	Touching 	1	1,00	0,87	0,82	0,80	0,79	0,78
		2	1,00	0,86	0,80	0,78	0,76	0,73
		3	1,00	0,85	0,79	0,76	0,73	0,70
	Spaced 	1	1,00	1,00	1,00	1,00	1,00	–
		2	1,00	0,99	0,98	0,97	0,96	–
		3	1,00	0,98	0,97	0,96	0,93	–






NOTE 1 Values given are averages for the cable types and range of conductor sizes considered. The spread of values is generally less than 5 %.

NOTE 2 Factors apply to single layer groups of cables as shown above and do not apply when cables are installed in more than one layer touching each other. Values for such installations may be significantly lower and must be determined by an appropriate method.

NOTE 3 Values are given for vertical spacings between trays of 300 mm and at least 20 mm between trays and wall. For closer spacing, the factors should be reduced.

NOTE 4 Values are given for horizontal spacing between trays of 225 mm with trays mounted back to back. For closer spacing, the factors should be reduced.

Table B.23 – Reduction factors for groups of more than one circuit of single-core cables
(Note 2) – To be applied to the current-carrying capacity for one circuit of single-core cables in free air

Method of installation		Number of trays	Number of three-phase circuits (Note 5)			Use as a multiplier to rating for
			1	2	3	
Perforated trays (Note 3)	Touching 	1	0,98	0,91	0,87	Three cables in horizontal formation
		2	0,96	0,87	0,81	
		3	0,95	0,85	0,78	
Ladder supports, cleats etc. (Note 3)	Touching 	1	1,00	0,97	0,96	Three cables in horizontal formation
		2	0,98	0,93	0,89	
		3	0,97	0,90	0,86	
Perforated trays (Note 3)		1	1,00	0,98	0,96	Three cables in trefoil formation
		2	0,97	0,93	0,89	
		3	0,96	0,92	0,86	
Vertical perforated trays (Note 4)	 Spaced	1	1,00	0,91	0,89	
		2	1,00	0,90	0,86	
Ladder supports, cleats, etc. (Note 3)		1	1,00	1,00	1,00	
		2	0,97	0,95	0,93	
		3	0,96	0,94	0,90	

NOTE 1 Values given are averages for the cable types and range of conductor sizes considered. The spread of values is generally less than 5 %.

NOTE 2 Factors are given for single layers of cables (or trefoil groups) as shown in the table and do not apply when cables are installed in more than one layer touching each other. Values for such installations may be significantly lower and should be determined by an appropriate method.

NOTE 3 Values are given for vertical spacings between trays of 300 mm. For closer spacing, the factors should be reduced.

NOTE 4 Values are given for horizontal spacing between trays of 225 mm with trays mounted back to back. For closer spacing, the factors should be reduced.

NOTE 5 For circuits having more than one cable in parallel per phase, each three phase set of conductors should be considered as a circuit for the purpose of this table.

Annex C (normative)

Rounding of numbers

C.1 Rounding of numbers for the purpose of the fictitious calculation method

The following rules apply when rounding numbers in calculating fictitious diameters and determining dimensions of component layers in accordance with Annex A.

When the calculated value at any stage has more than one decimal place, the value shall be rounded to one decimal place, i.e. to the nearest 0,1 mm. The fictitious diameter at each stage shall be rounded to 0,1 mm and, when used to determine the thickness or dimension of an overlying layer, it shall be rounded before being used in the appropriate formula or table. The thickness calculated from the rounded value of the fictitious diameter shall, in turn, be rounded to 0,1 mm as required in Annex A.

To illustrate these rules, the following practical examples are given:

- a) when the figure in the second decimal place before rounding is 0, 1, 2, 3 or 4, then the figure retained in the first decimal place remains unchanged (rounding down);

Examples:

2,12	≈ 2,1
2,449	≈ 2,4
25,0478	≈ 25,0

- b) when the figure in the second decimal place before rounding is 9, 8, 7, 6 or 5, then the figure in the first decimal place is increased by one (rounding up).

Examples:

2,17	≈ 2,2
2,453	≈ 2,5
30,050	≈ 30,1

C.2 Rounding of numbers for other purposes

For purposes other than those considered under Clause C.1, it may be required that values are rounded to more than one decimal place. This may occur, for instance, in calculating the average value of several measurement results, or the minimum value by applying a percentage tolerance to a given nominal value. In these cases, rounding shall be carried out to the number of decimal places specified in the relevant clauses.

The method of rounding shall then be as follows:

- a) if the last figure to be retained is followed, before rounding, by 0, 1, 2, 3 or 4, it shall remain unchanged (rounding down);
- b) if the last figure to be retained is followed, before rounding, by 9, 8, 7, 6 or 5, it shall be increased by one (rounding up).

Examples:

2,449	≈ 2,45	rounded to two decimal places
2,449	≈ 2,4	rounded to one decimal place
25,0478	≈ 25,048	rounded to three decimal places
25,0478	≈ 25,05	rounded to two decimal places
25,0478	≈ 25,0	rounded to one decimal place

Annex D (normative)

Method of measuring resistivity of semi-conducting screens

Each test piece shall be prepared from a 150 mm sample of completed cable.

The conductor screen test piece shall be prepared by cutting a sample of core in half longitudinally and removing the conductor and separator if any (see Figure D.1a). The insulation screen test piece shall be prepared by removing all the coverings from the sample of core (see Figure D.1b).

The procedure for determining the volume resistivity of the screens shall be as follows:

Four silver-painted electrodes A, B, C, and D (see Figures D.1a and D.1b) shall be applied to the semi-conducting surfaces. The two potential electrodes, B and C, shall be 50 mm apart and the two current electrodes, A and D, shall be each placed at least 25 mm beyond the potential electrodes.

Connections shall be made to the electrodes by means of suitable clips. In making connections to the conductor screen electrodes it shall be ensured that the clips are insulated from the insulation screen on the outer surface of the test sample.

The assembly shall be placed in an oven preheated to the specified temperature and, after an interval of at least 30 min, the resistance between the electrodes shall be measured by means of a circuit, the power of which shall not exceed 100 mW.

After the electrical measurements, the diameters over the conductor screen and insulation screen and the thicknesses of the conductor screen and insulation screen shall be measured at ambient temperature, each being the average of six measurements made on the sample shown in Figure D.1b.

The volume resistivity ρ in ohm · metres shall be calculated as follows:

a) conductor screen

$$\rho_c = \frac{R_c \times \pi \times (D_c - T_c) \times T_c}{2L_c}$$

where

ρ_c is the volume resistivity, in ohm · metres;

R_c is the measured resistance, in ohms;

L_c is the distance between potential electrodes, in metres;

D_c is the outer diameter over the conductor screen, in metres;

T_c is the average thickness of conductor screen, in metres.

b) insulation screen

$$\rho_i = \frac{R_i \times \pi \times (D_i - T_i) \times T_i}{L_i}$$

where

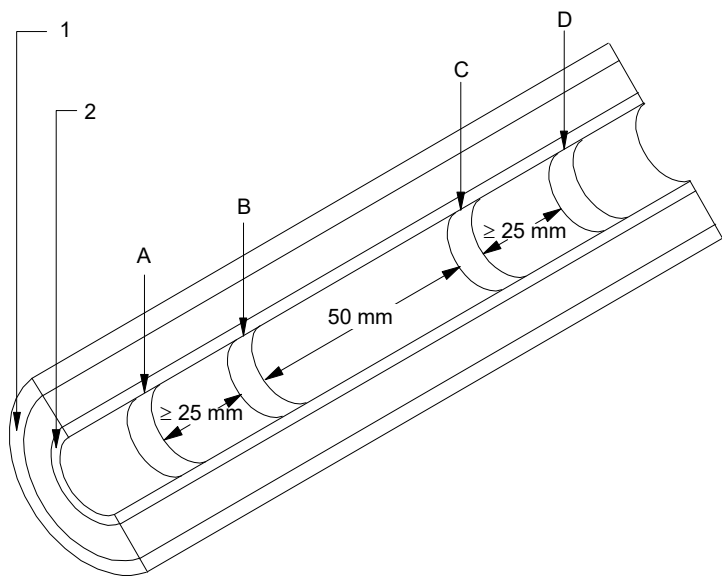
ρ_i is the volume resistivity, in ohm · metres;

R_i is the measured resistance, in ohms;

L_i is the distance between potential electrodes, in metres;

D_i is the outer diameter over the insulation screen, in metres;

T_i is the average thickness of insulation screen, in metres.



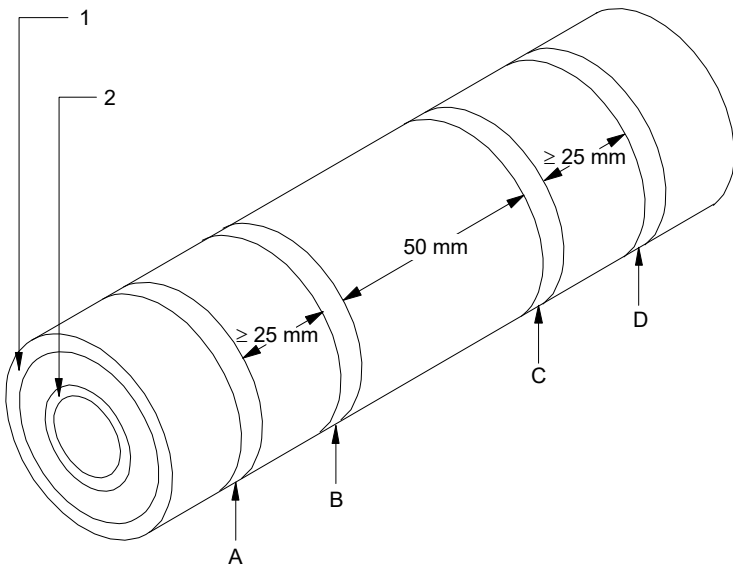
IEC 2417/11

Key

- | | | | |
|---|-------------------|------|----------------------|
| 1 | insulation screen | B, C | potential electrodes |
| 2 | conductor screen | A, D | current electrodes |

Figure D.1a – Measurement of the volume resistivity of the conductor screen

Dimensions in millimetres



IEC 2418/11

Key

- | | | | |
|---|-------------------|------|----------------------|
| 1 | insulation screen | B, C | potential electrodes |
| 2 | conductor screen | A, D | current electrodes |

Figure D.1b – Measurement of the volume resistivity of the insulation screen

Figure D.1 – Preparation of samples for measurement of resistivity of conductor and insulation screens

Annex E (normative)

Determination of hardness of HEPR insulations

E.1 Test piece

The test piece shall be a sample of completed cable with all the coverings, external to the HEPR insulation to be measured, carefully removed. Alternatively, a sample of insulated core may be used.

E.2 Test procedure

E.2.1 General

Tests shall be made in accordance with ISO 48 with exceptions as indicated below.

E.2.2 Surfaces of large radius of curvature

The test instrument, in accordance with ISO 48, shall be constructed so as to rest firmly on the HEPR insulation and permit the presser foot and indenter to make vertical contact with this surface. This is done in one of the following ways:

- a) the instrument is fitted with feet moveable in universal joints so that they adjust themselves to the curved surface;
- b) the base of the instrument is fitted with two parallel rods A and A' at a distance apart depending on the curvature of the surface (see Figure E.1).

These methods may be used on surfaces with radius of curvature down to 20 mm.

When the thickness of HEPR insulation tested is less than 4 mm, an instrument as described in the method in ISO 48 for thin and small test pieces shall be used.

E.2.3 Surfaces of small radius of curvature

On surfaces with too small a radius of curvature for the procedures described in E.2.2, the test piece shall be supported on the same rigid base as the test instrument, in such a way as to minimize bodily movement of the HEPR insulation when the indenting force increment is applied to the indenter and so that the indenter is vertically above the axis of the test piece. Suitable procedures are as follows:

- a) by resting the test piece in a groove or trough in a metal jig (see Figure E.2a);
- b) by resting the ends of the conductor of the test piece in V-blocks (see Figure E.2b).

The smallest radius of curvature of the surface to be measured by these methods shall be at least 4 mm.

For smaller radii, an instrument as described in the method in ISO 48 for thin and small test pieces shall be used.

E.2.4 Conditioning and test temperature

The minimum time between manufacture, i.e. vulcanization and testing, shall be 16 h.

The test shall be carried out at a temperature of $(20 \pm 2) ^\circ\text{C}$ and the test pieces shall be maintained at this temperature for at least 3 h immediately before testing.

E.2.5 Number of measurements

One measurement shall be made at each of three or five different points distributed around the test piece. The median of the results shall be taken as the hardness of the test piece, reported to the nearest whole number in international rubber hardness degrees (IRHD).

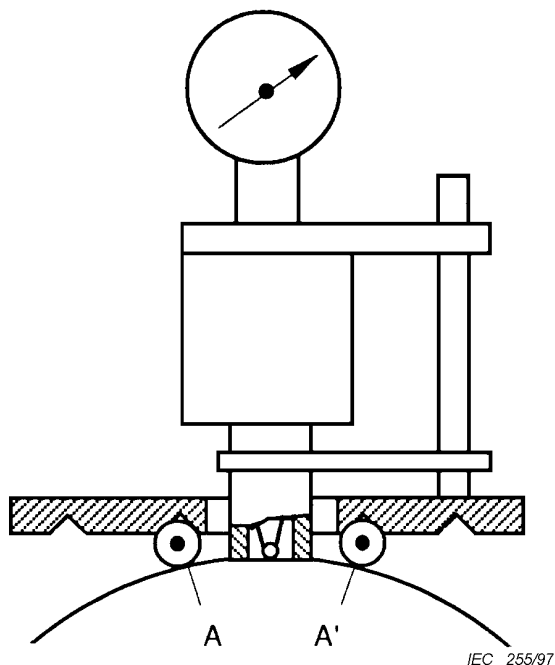


Figure E.1 – Test on surfaces of large radius of curvature

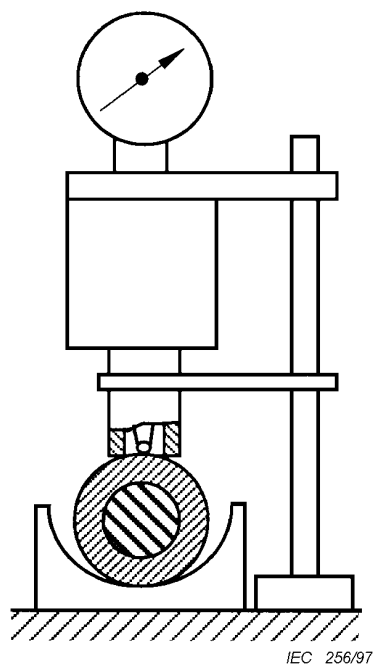


Figure E.2a – Test piece groove

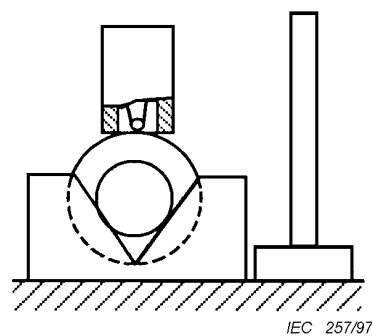


Figure E.2b – Test piece in V-blocks

Figure E.2 – Test on surfaces of small radius of curvature

Annex F (normative)

Water penetration test

F.1 Test piece

A sample of completed cable at least 6 m in length which has not been subjected to any of the tests described in Clause 18 shall be subjected to a bending test described in 18.2.4 without the additional partial discharge test.

A 3 m length of cable shall be cut from the length which has been subjected to the bending test and placed horizontally. A ring approximately 50 mm wide shall be removed from the centre of the length. This ring shall comprise all the layers external to the insulation screen. Where the conductor is also claimed to contain a barrier, the ring shall comprise all layers external to the conductor.

If the cable contains intermittent barriers to longitudinal water penetration then the sample shall contain at least two of these barriers, the ring being removed from between the barriers. In this case, the average distance between the barriers in such cables should be stated and the length of the cable sample shall be determined accordingly.

The surfaces shall be cut so that the interfaces intended to be longitudinally watertight shall be readily exposed to the water. The interfaces not intended to be longitudinally watertight shall be sealed with a suitable material or the outer coverings removed.

Examples of these latter interfaces include:

- when only the conductor of the cable has a barrier;
- the interface between the oversheath and the metal sheath.

Arrange a suitable device (see Figure F.1) to allow a tube having a diameter of at least 10 mm to be placed vertically over the exposed ring and sealed to the surface of the oversheath. The seals where the cable exits the apparatus shall not exert mechanical stress on the cable.

NOTE The response of certain barriers to longitudinal penetration can be dependent on the composition of the water (e.g. pH, ion concentration). Normal tap water should be used for the test, unless otherwise specified.

F.2 Test

The tube is filled within 5 min with water at an ambient temperature of $(20 \pm 10) ^\circ\text{C}$ so that the height of the water in the tube is 1 m above the cable centre (see Figure F.1). The sample shall be allowed to stand for 24 h.

The sample shall then be subjected to 10 heating cycles by passing current through the conductor, until the conductor reaches a steady temperature 5 K to 10 K above the maximum conductor temperature in normal operation and which shall not reach $100 ^\circ\text{C}$.

The duration of the heating cycle shall be at least 8 h. The conductor temperature shall be maintained within the stated temperature limits for at least 2 h of each heating period. This shall be followed by at least 3 h of natural cooling.

The water head shall be maintained at 1 m.

NOTE No voltage being applied throughout the test, it is advisable to connect a dummy cable in series with the cable to be tested, the temperature being measured directly on the conductor of this cable.

F.3 Requirements

During the period of testing no water shall emerge from the ends of the test piece.

Dimensions in millimetres

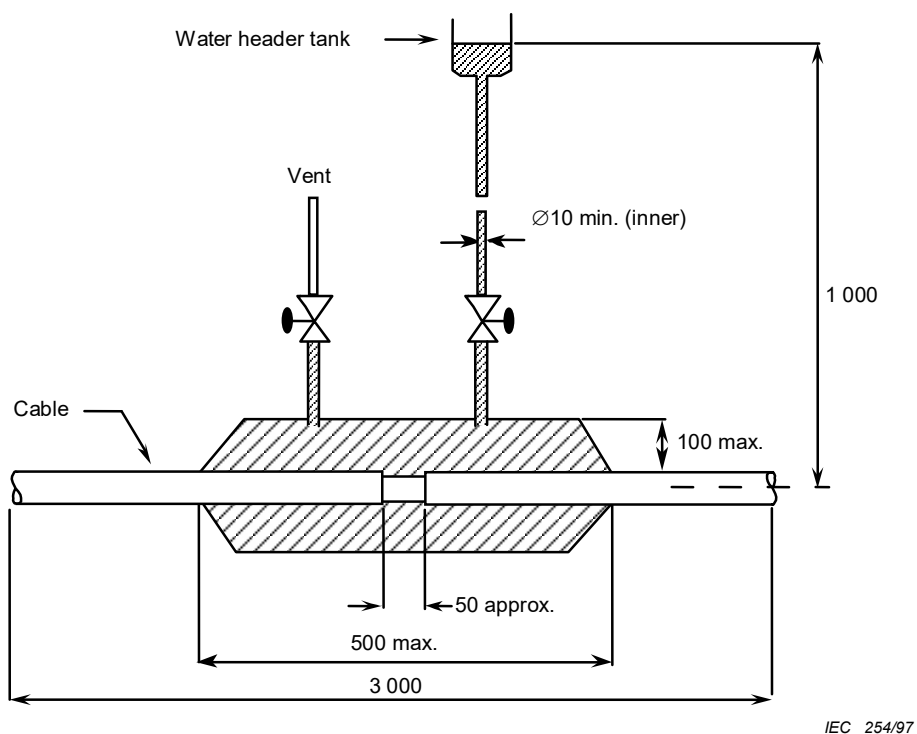


Figure F.1 – Schematic diagram of apparatus for water penetration test

Annex G (informative)

Determination of the cable conductor temperature

G.1 Purpose

For some tests, it is necessary to raise the cable conductor to a given temperature, typically 5 K to 10 K above the maximum temperature in normal operation, while the cable is energized, either at power frequency or under impulse conditions. It is therefore not possible to have access to the conductor to enable direct measurement of temperature.

In addition, the conductor temperature should be maintained within a restricted range (5 K) whereas the ambient temperature may vary over a wider range.

Although preliminary calibration on the cable under test or calculations may be satisfactory in the first place, the variation of ambient conditions throughout the duration of the test may lead to deviations of the temperature of the conductor outside range.

Therefore, methods should be used in which the conductor temperature can be monitored and controlled throughout the duration of the test.

Guidance is given hereafter on commonly used methods.

G.2 Calibration of the temperature of the main test loop

G.2.1 General

The purpose of the calibration is to determine the conductor temperature by direct measurement for a given current within the temperature range required for the test.

The cable used for calibration (hereafter called reference cable) should be taken from same length as the cable used for the main test loop.

G.2.2 Installation of cable and temperature sensors

The calibration should be performed on a minimum cable length of 5 m, taken from the same cable as tested. The length should be such that the longitudinal heat transfer to the cable ends does not affect the temperature in the centre 2 m of cable by more than 2 K.

At the middle of the reference cable, two temperature sensors should be attached: one on the conductor (TC_{1c}), and one on the external surface or directly under the external surface (TC_{1s}).

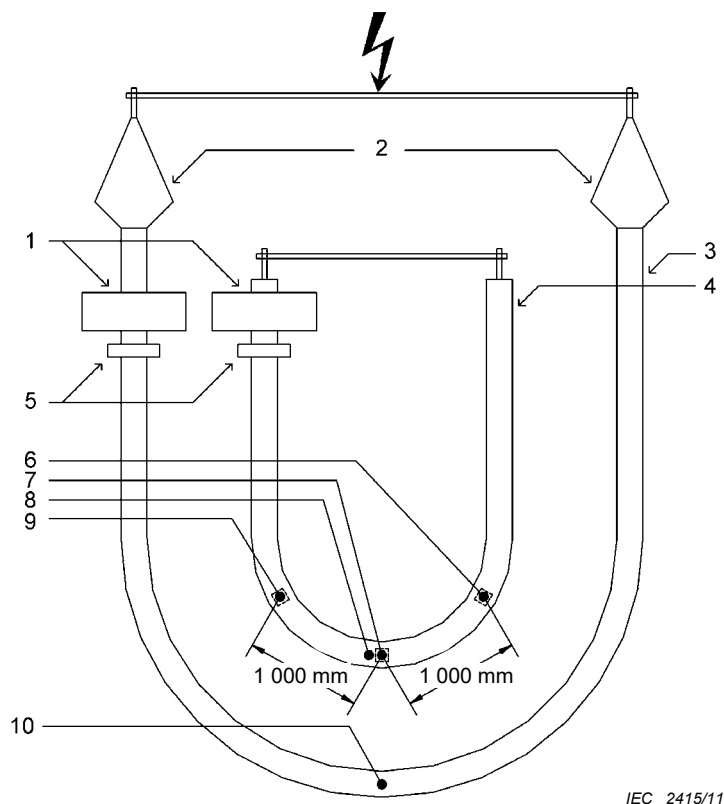
Two other temperature sensors, TC_{2c} and TC_{3c} , should be installed on the conductor of the reference cable (see Figure G.1), each one about 1 m away from the middle.

The temperature sensors should be attached to the conductor by mechanical means since they may move due to vibrations of the cable during heating. Care should be taken to maintain good thermal contact during the tests and to prevent leakage of heat to the ambient. It is recommended to mount the thermocouple(s) as shown in Figure G.2 between two strands of a stranded conductor or between the (solid) conductor and the conductor screen. To enable access to the conductor in the middle of the reference cable, a small hatch should be made by careful removal of the layers above the conductor. After installing the temperature sensor(s),

the layers that have been removed may be put back. This may restore the thermal behaviour of the reference cable.

NOTE To prove a negligible heat transfer towards the cable ends, the difference between the readings of TC_{1C} , TC_{2C} and TC_{3C} should be less than 2 K.

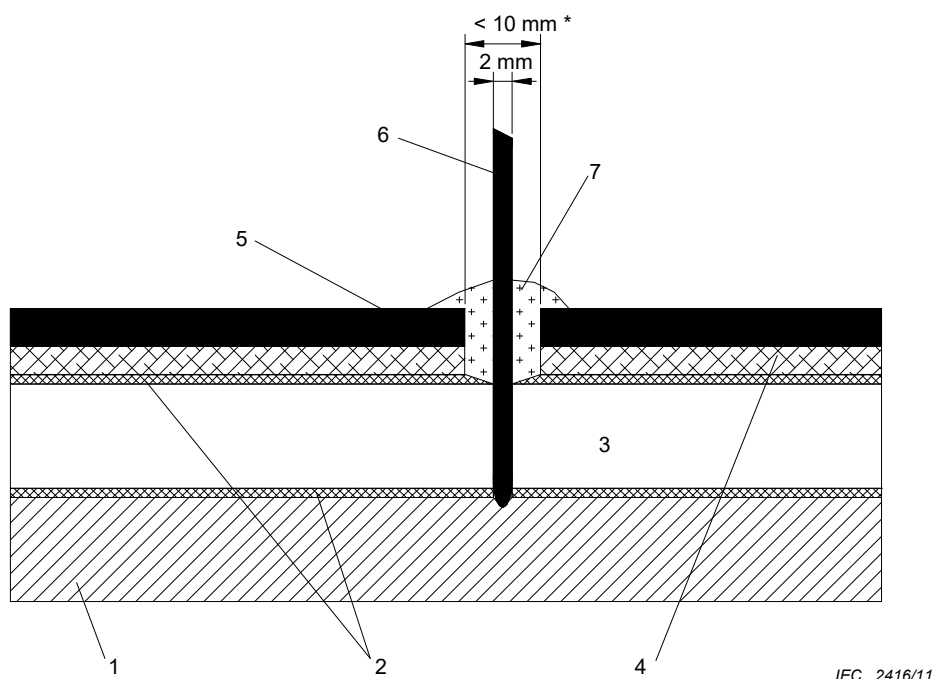
If the main test loop includes several individual cable lengths installed close to each other, these lengths will be subjected to thermal proximity effect. The calibration should therefore be carried out, taking into account the actual test arrangement, measurements being performed on the hottest cable length (usually the middle length).



Key

- | | | | |
|---|--------------------------------|----|-----------------------|
| 1 | current inducing transformers | 6 | TC_{3C} (conductor) |
| 2 | terminations | 7 | TC_{1C} (conductor) |
| 3 | cable under test | 8 | TC_{1S} (sheath) |
| 4 | reference cable (≥ 5 m) | 9 | TC_{2C} (conductor) |
| 5 | current measuring transformers | 10 | TC_S (sheath) |

Figure G.1 – Typical test set-up for the reference loop and the main test loop



Key

1	conductor	5	cable oversheath
2	semi-conducting screens	6	temperature sensor
3	insulation	7	flexible thermal insulating compound
4	metal sheath	*	as small as possible

Figure G.2 – Example of an arrangement of the temperature sensors on the conductor of the reference loop

G.2.3 Calibration method

The calibration should be carried out in a draught-free situation at a temperature of $(20 \pm 15) ^\circ\text{C}$.

Temperature recorders should be used to measure the conductor, oversheath and ambient temperatures simultaneously.

The cable should be heated until the conductor temperatures, indicated by temperature sensors $\text{TC}_{1\text{C}}$ of Figure G.1, have stabilized and reached the following temperatures: between 5 K and 10 K above the maximum conductor temperature of the cable in normal operation, as given in Table 1.

When stabilization has been reached, the following should be noted:

- conductor temperature: average value at positions 1, 2 and 3;
- oversheath temperature at position $\text{TC}_{1\text{S}}$;
- ambient temperature;
- heating current.

G.3 Heating for the test

G.3.1 Method 1 – Test using a reference cable

In this method, a reference cable identical to the cable used for the test is heated with the same current value as the main test loop.

The installation of cable and temperature sensors for both loops should be as given in Clause G.2.

The test arrangement should be such that

- the reference cable carries the same current as the main test loop at any time;
- it is installed in such a way that mutual heating effects are taken into account throughout the test.

The heating current of both loops should be adjusted such that the conductor temperature is kept within the specified limits.

A temperature sensor (TC_S) should be mounted on or under the external surface of the main test loop at the hottest spot, usually in the middle of it, in the same way as temperature sensor TC_{1s} is mounted on the hottest spot of the reference cable.

NOTE 1 The temperature measured with the temperature sensors on or under the oversheath of the main test loop (TC_S) and on the reference loop (TC_{1s}) are used to check whether the oversheath of both loops has the same temperature.

The temperature measured with temperature sensor TC_{1C} on the conductor of the reference loop may be considered as to be representative for the conductor temperature of the energized test loop.

NOTE 2 The temperature of the conductor of the main test loop may be slightly higher than that of the reference loop because of dielectric losses. If necessary, a correction should be made.

All temperature sensors should be connected to a recorder to enable temperature monitoring. The heating current of each loop should also be recorded to prove that the two currents are of the same value throughout the duration of the test. The difference between the heating currents should be kept within ± 1 %.

The reference cable may be connected in series with the test cable if the temperature is measured via an optical fibre link or equivalent.

G.3.2 Method 2 – Test using conductor temperature calculations and measurement of the surface temperature

G.3.2.1 Calibration of the test cable conductor temperature

The purpose of the calibration is to determine the conductor temperature by direct measurement for a given current, within the temperature range required for the test.

The cable used for calibration should be identical to that to be used for the test, and the way of heating should be identical.

The installation of cable and temperature sensors for the calibration should be as given in Clause G.2.

The calibration should be carried out in accordance with G.2.3 for the reference cable.

G.3.2.2 Test based on measurement of the external temperature

During calibration and during the test of the main loop, the cable conductor temperature of the main test loop should be calculated in accordance with IEC 60853-2, based on the measured external temperature of the oversheath (TC_S). The measurement should be done with a temperature sensor at the hottest spot, attached to or under the external surface, in the same way as for the reference cable.

NOTE As an alternative, IEC 60287-2 (all parts 2) may be used if demonstrated that asymptotic transient temperature is reached within the specified time

The heating current should be adjusted to obtain the required value of the calculated conductor temperature, based on the measured external temperature of the oversheath.

Annex H

(normative)

Test for water penetration in the conductor

H.1 General

This test is applied only for stranded conductors having a nominal cross-sectional area larger than 630 mm².

H.2 Test piece

A 1,5 m sample of cable which has been subjected to the bending test of 18.2.4 shall be placed horizontally.

All layers external to the insulation screen shall be removed from the sample and the full cross-section of the conductor shall be exposed at both ends of the test piece.

Arrange a suitable chamber to enclose one end of the test piece. The chamber shall be fitted with an air vent and a separate vertical tube, both of at least 10 mm internal diameter, with a header tank to allow the application of a 1 m head of water (see Figure H.1). The chamber shall be sealed to the surface of the insulation screen. The seal where the cable exits the chamber shall not deform the insulation during the test.

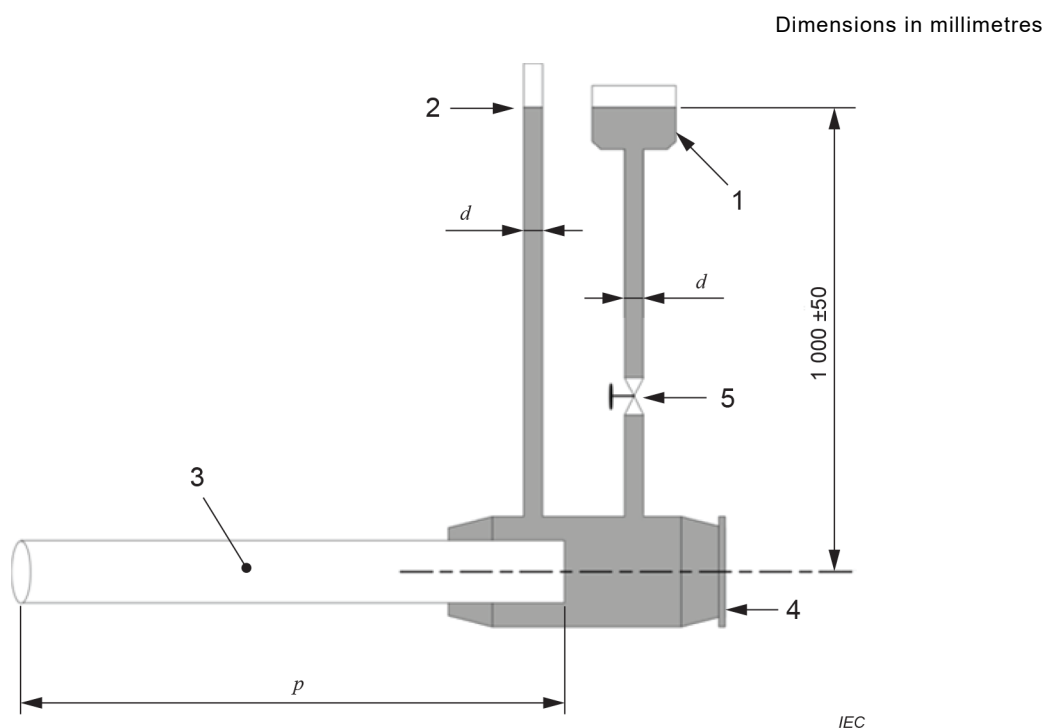
NOTE The response of certain barriers to longitudinal penetration can be dependent on the composition of the water (e.g. pH, ion concentration). Normal tap water is used for the test unless otherwise specified.

H.3 Test

The tube shall be filled within 5 min with tap water at a temperature of $(20 \pm 10) ^\circ\text{C}$ so that the height of the water in the tube is 1 m above the cable centre (see Figure H.1). The sample shall be allowed to stand for 11 days at ambient temperature.

H.4 Requirements

During the period of testing, no water shall emerge from the end of the test piece.



Key

- 1 water header tank
- 2 air vent
- 3 test piece
- 4 chamber
- 5 full bore valve (optional)
- d internal $\varnothing \geq 10$ mm
- p length $\leq (1\,500 \pm 50)$ mm

Figure H.1 – Schematic diagram of apparatus for water penetration test in the conductor

Annex I

(normative)

Methods of determining the weighted value of halogen content of the non-metallic materials in the cable

I.1 Calculating the weighted value of the cable when the halogen content of individual materials is tested

Measure the weight, w_i , of each non-metallic material, i , per unit length of cable.

The weighted value of halogen content of non-metallic materials in the cable, H'_i , for each halogen, is calculated as follows:

$$H'_i = \frac{\sum(H_i \times w_i)}{\sum w_i}$$

where

H'_i is the halogen content of the individual material of weight w_i .

The sum of the weighted values of the halogen content of non-metallic materials in the cable of the four individual halogens (F, Cl, Br, I), i.e. $\sum H'_i$ shall be calculated.

I.2 Preparation of the test sample for measurement of halogen content on a sample representative of the non-metallic materials in the cable

A sample of approximate length 15 mm to 25 mm of the complete cable shall be cut into small pieces after all metal elements have been removed. The sample shall be of sufficient length to give the required weight of the test specimen. The cable components shall be cut into small pieces no larger than 3 mm.

The pieces should be well mixed and the test sample shall be taken from the mixture.

Bibliography

IEC 60287 (all parts), *Electric cables – Calculation of the current rating*

IEC 60502-1, *Power cables with extruded insulation and their accessories for rated voltages from 1 kV ($U_m = 1,2$ kV) up to 30 kV ($U_m = 36$ kV) – Part 1: Cables for rated voltages of 1 kV ($U_m = 1,2$ kV) and 3 kV ($U_m = 3,6$ kV)*

IEC 60332-3-22, *Tests on electric and optical fibre cables under fire conditions – Part 3-22: Test for vertical flame spread of vertically-mounted bunched wires or cables – Category A*

IEC 60332-3-23, *Tests on electric and optical fibre cables under fire conditions – Part 3-23: Test for vertical flame spread of vertically-mounted bunched wires or cables – Category B*

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

3, rue de Varembé
PO Box 131
CH-1211 Geneva 20
Switzerland

Tel: + 41 22 919 02 11
info@iec.ch
www.iec.ch